

APPENDIX A
CEPEI PM2.5 EMISSION TEST SUMMARY

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa						Run 1				Run 2				Run 3				Average
2	Parameter	Type	Units				Value				Value				Value				Value
3	k1	Calibration					0.8517				0.8517				0.8517				0.8517
4	n1	Calibration					0.5				0.5				0.5				0.5
5	k2	Calibration					10.545				10.545				10.545				10.545
6	n2	Calibration					0.5				0.5				0.5				0.5
7	Cdmfm1	Calibration					1.018				1.018				1.018				1.018
8	Csmfm1	Calibration					1.01				1.01				1.01				1.01
9	Csmfm2	Calibration					1.012				1.012				1.012				1.012
10	T1m	Measured	F				308.26				302.18				319.26				309.90
11	T1	Calculated	R				768.26				762.18				779.26				769.90
12	T2m	Measured	F				69.61				76.61				66.01				70.74
13	T2	Calculated	R				529.61				536.61				526.01				530.74
14	Stack T	Measured	F				749				751				751				750
15	Filter T	Measured	F				77.75				73.72				85.29				78.92
16	T3m	Measured	F				54.18				54.88				56.47				55.17
17	T3	Calculated	R				514.18				514.88				516.47				515.17
18	Pbar	Measured	in. Hg				27.83				27.83				27.69				27.78
19	Ps	Measured	iwc				1.690				1.637				1.689				1.672
20	Pst	Calculated	in. Hg				27.96				27.95				27.81				27.90
21	Cyclone dP	Measured	iwc				-5.59				-3.16				-5.74				-4.83
22	P1	Calculated	in. Hg				27.54				27.71				27.39				27.55
23	Sample venturi dP	Measured	iwc				0.538				0.539				0.537				0.538
24	Dil venturi dP	Measured	iwc				0.76				1.05				0.70				0.84
25	P2	Calculated	in. Hg				27.59				27.77				27.43				27.59
26	Exhaust Vac	Measured	iwc				29.78				30.07				27.97				29.27
27	P3	Calculated	in. Hg				25.64				25.61				25.63				25.63
28	%O2	Measured	%vd				11.31				11.22				11.09				11.21
29	%CO2	Measured	%vd				5.53				5.74				5.56				5.61
30	Ms	Calculated	lb/lb-mole				29.34				29.37				29.33				29.35
31	Mws	Calculated	lb/lb-mole				28.66				28.69				28.65				28.67
32	Mwdil	Calculated	lb/lb-mole				28.92				28.92				28.91				28.91
33	Q1	Calculated	wacf/min				0.616				0.612				0.622				0.617
34	Q2	Calculated	wacf/min				7.49				8.83				7.18				7.84
35	RHdil	Measured	%				18.88				14.10				23.25				18.74
36	RH mix	Measured	%				47.55				42.40				47.80				45.92
37	Bwdil	Calculated v/v					0.00500				0.00469				0.00546				0.00505
38	Bwds	Calculated v/v					0.00785				0.00719				0.00858				0.00787
39	Qmix,std	Calculated	wacf/min				7.28				8.46				7.00				7.58
40	Bws	Calculated v/v					0.0595				0.0594				0.0602				0.0597
42	PM2.5 Concentration																		
43	Run duration	Measured	minutes				238.89				239.40				239.40				239.23
44	mf47ds	Measured	mg			ADL	0.700			ADL	0.604			ADL	0.746			ADL	0.683
45	mf47dab	Measured	mg			ADL	0.008			ADL	0.011			ADL	0.013			ADL	0.011
46	mf47ds-stfb1	Measured	mg			ADL	0.004			ADL	0.004			ADL	0.004			ADL	0.004
47	mf47dab-stfb1	Measured	mg			ADL	0.022			ADL	0.022			ADL	0.022			ADL	0.022
48	mf47ds-stfb2	Measured	mg			ADL	0.003			ADL	0.003			ADL	0.003			ADL	0.003
49	mf47dab-stfb2	Measured	mg			ADL	0.008			ADL	0.008			ADL	0.008			ADL	0.008
50	qf47ds,tq	Calculated	wacm/min				0.03707				0.03666				0.03706				0.03693
51	Vf47ds,tq(std)	Calculated	dscm				8.79				8.71				8.80				8.77
52	qf47ds,q	Calculated	wacm/min				0.03715				0.03702				0.03705				0.03707
53	Vf47ds,q(std)	Calculated	dscm				8.80				8.80				8.79				8.80
54	qf47dab	Calculated	wacm/min				0.03738				0.03727				0.03732				0.03732
55	Vf47dab(std)	Calculated	dscm				8.89				8.88				8.89				8.88
57	Vdv(std)	Calculated	dscm				45.84				54.10				44.11				48.02
58	Vd(std)	Calculated	dscm				36.95				45.22				35.23				39.13
59	Vs(std)	Calculated	dscm				2.51				2.51				2.45				2.49
60	Vds(std)	Calculated	dscm				39.46				47.73				37.68				41.62
61	DR	Calculated	v/v				15.74				19.05				15.36				16.72
62	Cpm2.5	Calculated mg/dscm				ADL	1.24			ADL	1.30			ADL	1.28			ADL	1.273
64																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S				
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average							
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>							
65	PM2.5 Emission Factor																						
66	Fd	Input	dscf/MMBtu	8618.8				8618.8				8618.8				8618.8							
67	Epm2.5	Calculated	lb/MMBtu	ADL	1.46E-03				ADL	1.51E-03				ADL	1.47E-03				1.48E-03				
68	Epm2.5	Calculated	kg/GJ	ADL	6.26E-04				ADL	6.49E-04				ADL	6.31E-04				6.35E-04				
69																							
70	Stack gas flow rate																						
71	Qfuel(15C)	Input	lb/hr	9.11E+02				8.97E+02				8.92E+02				9.00E+02							
72	HHV(15C)	Input	Btu/lb	2.17E+04				2.17E+04				2.18E+04				2.17E+04							
73	Qstk,dry(25C)	Calculated	dscf/hr	3.77E+05				3.68E+05				3.63E+05				3.69E+05							
74	Qstk,dry(25C)	Calculated	dscfm	6.28E+03				6.13E+03				6.05E+03				6.16E+03							
75	PM2.5 Mass Flow Rate																						
76	Mpm2.5	Calculated	lb/hr	ADL	2.92E+01				ADL	2.98E+01				ADL	2.90E+01				ADL	2.94E+01			
77																							
78																							

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa						Run 1				Run 2				Run 3				
2	Parameter	Type	Units				Value				Value				Value				
79	Species Lab Results - Samples																		
80	<u>Carbon</u>																		
81	OC	Measured	µg			ADL	6.36E+02			ADL	6.27E+02			ADL	7.07E+02			ADL	6.57E+02
82	EC	Measured	µg			ADL	6.65E+00			ADL	1.30E+01			ADL	1.21E+01			ADL	1.06E+01
83	Total C	Measured	µg			ADL	6.43E+02			ADL	6.40E+02			ADL	7.19E+02			ADL	6.67E+02
84	OC Backup	Measured	µg			ADL	1.22E+02			ADL	1.24E+02			ADL	1.13E+02			ADL	1.19E+02
85	EC Backup	Measured	µg			ADL	3.21E+00			BDL	7.63E-01			ADL	1.43E+00			DLL	1.80E+00
86	Total C Backup	Measured	µg			ADL	1.25E+02			ADL	1.24E+02			ADL	1.14E+02			ADL	1.21E+02
87																			
88	<u>Elements</u>																		
89	Ag	Measured	µg			ADL	3.24E-02			BDL	3.34E-02			BDL	3.34E-02			DLL	3.31E-02
90	Al	Measured	µg			BDL	4.61E-01			ADL	6.50E-03			BDL	4.61E-01			DLL	3.09E-01
91	As	Measured	µg			BDL	1.33E-02			BDL	1.33E-02			BDL	1.33E-02			BDL	1.33E-02
92	Au	Measured	µg			BDL	3.66E-02			ADL	2.71E-02			ADL	2.24E-02			DLL	2.87E-02
93	Ba	Measured	µg			BDL	1.21E-01			ADL	5.21E-01			BDL	1.22E-01			DLL	2.55E-01
94	Br	Measured	µg			ADL	3.24E-02			ADL	1.95E-02			ADL	8.90E-03			ADL	2.03E-02
95	Ca	Measured	µg			ADL	4.46E+00			ADL	4.10E+00			ADL	3.44E+00			ADL	4.00E+00
96	Cd	Measured	µg			BDL	6.66E-02			ADL	5.07E-02			BDL	6.66E-02			DLL	6.13E-02
97	Ce	Measured	µg			ADL	1.87E-01			BDL	4.66E-01			BDL	4.69E-01			DLL	3.74E-01
98	Cl	Measured	µg			ADL	3.23E-01			ADL	6.51E-01			ADL	3.95E-02			ADL	3.38E-01
99	Co	Measured	µg			BDL	3.40E-03			BDL	3.40E-03			BDL	3.40E-03			BDL	3.40E-03
100	Cr	Measured	µg			ADL	4.84E-02			BDL	1.33E-02			ADL	6.00E-03			DLL	2.26E-02
101	Cs	Measured	µg			ADL	4.24E-02			ADL	1.65E-01			BDL	1.69E-01			DLL	1.25E-01
102	Cu	Measured	µg			ADL	4.80E-03			BDL	1.16E-02			BDL	1.16E-02			DLL	9.33E-03
103	Eu	Measured	µg			BDL	9.80E-01			ADL	8.72E-01			BDL	9.88E-01			DLL	9.47E-01
104	Fe	Measured	µg			ADL	2.57E-01			ADL	7.42E-02			ADL	1.04E-01			ADL	1.45E-01
105	Ga	Measured	µg			BDL	1.16E-02			BDL	1.16E-02			BDL	1.16E-02			BDL	1.16E-02
106	Hf	Measured	µg			BDL	1.67E-01			BDL	1.67E-01			BDL	1.67E-01			BDL	1.67E-01
107	Hg	Measured	µg			BDL	2.50E-02			BDL	2.50E-02			BDL	2.50E-02			BDL	2.50E-02
108	In	Measured	µg			BDL	3.17E-02			BDL	3.17E-02			BDL	3.17E-02			BDL	3.17E-02
109	Ir	Measured	µg			BDL	3.66E-02			BDL	3.66E-02			BDL	3.66E-02			BDL	3.66E-02
110	K	Measured	µg			ADL	1.59E-01			ADL	8.13E-02			ADL	3.30E-02			ADL	9.11E-02
111	La	Measured	µg			ADL	3.54E-02			ADL	1.45E-01			BDL	1.99E-01			DLL	1.27E-01
112	Mg	Measured	µg			BDL	1.86E+00			BDL	1.85E+00			BDL	1.85E+00			BDL	1.85E+00
113	Mn	Measured	µg			BDL	3.34E-02			BDL	3.34E-02			ADL	5.90E-03			DLL	2.42E-02
114	Mo	Measured	µg			BDL	1.84E-02			BDL	1.84E-02			BDL	1.84E-02			BDL	1.84E-02
115	Na	Measured	µg			BDL	7.79E+00			BDL	7.60E+00			BDL	7.94E+00			BDL	7.78E+00
116	Nb	Measured	µg			BDL	1.00E-02			BDL	1.00E-02			BDL	1.00E-02			BDL	1.00E-02
117	Ni	Measured	µg			ADL	1.42E-02			BDL	6.60E-03			BDL	6.60E-03			DLL	9.13E-03
118	Pb	Measured	µg			ADL	1.77E-02			ADL	4.13E-02			ADL	2.12E-02			ADL	2.67E-02
119	Pd	Measured	µg			BDL	6.00E-02			BDL	6.00E-02			BDL	6.00E-02			BDL	6.00E-02
120	P	Measured	µg			ADL	2.56E-01			ADL	3.23E-01			ADL	4.95E-01			ADL	3.58E-01
121	Rb	Measured	µg			BDL	3.40E-03			ADL	5.90E-03			ADL	1.20E-03			DLL	3.50E-03
122	S	Measured	µg			ADL	6.08E+00			ADL	2.92E+00			ADL	2.76E+00			ADL	3.92E+00
123	Sb	Measured	µg			BDL	8.33E-02			ADL	3.71E-02			ADL	3.13E-02			DLL	5.06E-02
124	Sc	Measured	µg			BDL	3.57E-01			BDL	3.58E-01			BDL	3.57E-01			BDL	3.57E-01
125	Se	Measured	µg			BDL	1.50E-02			BDL	1.50E-02			BDL	1.50E-02			BDL	1.50E-02
126	Si	Measured	µg			ADL	4.61E-01			ADL	1.96E-01			ADL	9.75E-01			ADL	5.44E-01
127	Sm	Measured	µg			ADL	2.44E-01			BDL	6.61E-01			BDL	6.60E-01			DLL	5.21E-01
128	Sn	Measured	µg			ADL	4.95E-02			ADL	1.30E-03			BDL	6.00E-02			DLL	3.69E-02
129	Sr	Measured	µg			ADL	2.00E-02			ADL	1.88E-02			ADL	2.00E-02			ADL	1.96E-02
130	Ta	Measured	µg			BDL	1.67E-01			BDL	1.67E-01			BDL	1.67E-01			BDL	1.67E-01
131	Tb	Measured	µg			BDL	4.76E-01			BDL	4.83E-01			BDL	4.79E-01			BDL	4.79E-01
132	Ti	Measured	µg			ADL	1.18E-01			ADL	1.21E-01			ADL	4.54E-02			ADL	9.49E-02
133	Tl	Measured	µg			ADL	1.01E-02			ADL	1.01E-02			ADL	5.40E-03			ADL	8.53E-03
134	U	Measured	µg			BDL	3.49E-02			ADL	2.13E-02			ADL	1.00E-04			DLL	1.88E-02
135	V	Measured	µg			BDL	3.40E-03			BDL	3.40E-03			BDL	3.40E-03			BDL	3.40E-03
136	W	Measured	µg			ADL	1.21E-01			ADL	9.31E-02			ADL	2.13E-02			ADL	7.86E-02
137	Y	Measured	µg			ADL	2.13E-02			ADL	2.40E-03			BDL	1.16E-02			DLL	1.18E-02
138	Zn	Measured	µg			ADL	7.33E-01			ADL	6.75E-01			ADL	5.12E-01			ADL	6.40E-01
139	Zr	Measured	µg			BDL	1.50E-02			BDL	1.50E-02			BDL	1.50E-02			BDL	1.50E-02
140																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
141	Ions																		
142	NH4+	Measured	µg	BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02	BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02
143	Cl-	Measured	µg	BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02	BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02
144	NO3-	Measured	µg	ADL	2.05E+00		ADL	2.78E+00		ADL	1.26E+00	ADL	2.03E+00		ADL	2.03E+00		ADL	2.03E+00
145	K+	Measured	µg	BDL	5.01E-01		BDL	5.01E-01		BDL	5.01E-01	BDL	5.01E-01		BDL	5.01E-01		BDL	5.01E-01
146	Na+	Measured	µg	ADL	3.42E-01		ADL	6.19E-02		BDL	1.67E-02	DLL	1.40E-01		DLL	1.40E-01		DLL	1.40E-01
147	SO42-	Measured	µg	ADL	3.99E+00		ADL	3.93E+00		ADL	3.56E+00	ADL	3.82E+00		ADL	3.82E+00		ADL	3.82E+00

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
149	Species Lab Results - Run Dilution Air																		
150	<u>Carbon</u>																		
151	OC	Measured	µg																
152	EC	Measured	µg																
153	Total C	Measured	µg																
154	OC Backup	Measured	µg	ADL	2.42E+01		ADL	1.91E+01		ADL	1.28E+01		ADL	1.87E+01		ADL	1.87E+01		
155	EC Backup	Measured	µg	ADL	3.21E+00		BDL	7.63E-01		ADL	1.43E+00		DLL	1.80E+00					
156	Total C Backup	Measured	µg	ADL	1.25E+02		ADL	1.24E+02		ADL	1.14E+02		ADL	1.21E+02					
157																			
158	<u>Elements</u>																		
159	Ag	Measured	µg	BDL	3.34E-02		BDL	3.34E-02		BDL	3.34E-02		BDL	3.34E-02		BDL	3.34E-02		
160	Al	Measured	µg	ADL	2.81E-01		BDL	4.62E-01		BDL	4.62E-01		DLL	4.02E-01					
161	As	Measured	µg	BDL	1.33E-02		BDL	1.33E-02		BDL	1.33E-02		BDL	1.33E-02		BDL	1.33E-02		
162	Au	Measured	µg	BDL	3.66E-02		BDL	3.66E-02		ADL	5.90E-03		DLL	2.64E-02					
163	Ba	Measured	µg	BDL	1.18E-01		BDL	1.18E-01		BDL	1.19E-01		BDL	1.18E-01		BDL	1.18E-01		
164	Br	Measured	µg	ADL	1.80E-03		BDL	1.16E-02		ADL	2.18E-02		DLL	1.17E-02					
165	Ca	Measured	µg	BDL	1.33E-02		BDL	1.25E-02		BDL	1.33E-02		BDL	1.30E-02		BDL	1.30E-02		
166	Cd	Measured	µg	BDL	6.66E-02		BDL	6.66E-02		BDL	6.66E-02		BDL	6.66E-02		BDL	6.66E-02		
167	Ce	Measured	µg	ADL	2.10E-01		ADL	2.50E-01		BDL	4.66E-01		DLL	3.09E-01					
168	Cl	Measured	µg	ADL	2.54E-02		ADL	1.24E-02		ADL	1.36E-02		ADL	1.71E-02					
169	Co	Measured	µg	BDL	3.40E-03		BDL	3.40E-03		BDL	3.40E-03		BDL	3.40E-03		BDL	3.40E-03		
170	Cr	Measured	µg	ADL	8.30E-03		ADL	9.50E-03		ADL	2.13E-02		ADL	1.30E-02					
171	Cs	Measured	µg	BDL	1.68E-01		ADL	4.59E-02		ADL	1.07E-01		DLL	1.07E-01					
172	Cu	Measured	µg	ADL	1.54E-02		BDL	1.16E-02		BDL	1.16E-02		DLL	1.29E-02					
173	Eu	Measured	µg	ADL	4.89E-01		ADL	2.23E-01		BDL	9.79E-01		DLL	5.63E-01					
174	Fe	Measured	µg	ADL	1.20E-03		ADL	7.77E-02		BDL	5.50E-02		DLL	4.46E-02					
175	Ga	Measured	µg	BDL	1.16E-02		BDL	1.16E-02		BDL	1.16E-02		BDL	1.16E-02		BDL	1.16E-02		
176	Hf	Measured	µg	BDL	1.67E-01		BDL	1.67E-01		BDL	1.67E-01		BDL	1.67E-01		BDL	1.67E-01		
177	Hg	Measured	µg	ADL	1.00E-04		BDL	2.58E-02		BDL	2.50E-02		DLL	1.70E-02					
178	In	Measured	µg	BDL	3.17E-02		ADL	4.20E-03		BDL	3.17E-02		DLL	2.25E-02					
179	Ir	Measured	µg	BDL	3.66E-02		BDL	3.66E-02		BDL	3.66E-02		BDL	3.66E-02		BDL	3.66E-02		
180	K	Measured	µg	ADL	2.71E-02		BDL	2.16E-02		ADL	7.10E-03		DLL	1.86E-02					
181	La	Measured	µg	ADL	3.66E-02		ADL	3.60E-03		BDL	1.97E-01		DLL	7.92E-02					
182	Mg	Measured	µg	ADL	1.69E-01		BDL	1.86E+00		BDL	1.86E+00		DLL	1.30E+00					
183	Mn	Measured	µg	BDL	3.34E-02		BDL	3.34E-02		BDL	3.34E-02		BDL	3.34E-02		BDL	3.34E-02		
184	Mo	Measured	µg	BDL	1.84E-02		BDL	1.84E-02		BDL	1.84E-02		BDL	1.84E-02		BDL	1.84E-02		
185	Na	Measured	µg	BDL	7.47E+00		BDL	7.60E+00		BDL	7.56E+00		BDL	7.55E+00		BDL	7.55E+00		
186	Nb	Measured	µg	ADL	4.80E-03		BDL	1.00E-02		ADL	2.40E-03		DLL	5.73E-03					
187	Ni	Measured	µg	BDL	6.60E-03		BDL	6.60E-03		BDL	6.60E-03		BDL	6.60E-03		BDL	6.60E-03		
188	Pb	Measured	µg	ADL	1.53E-02		BDL	1.99E-02		ADL	4.71E-02		DLL	2.74E-02					
189	Pd	Measured	µg	BDL	6.00E-02		BDL	6.00E-02		BDL	6.00E-02		BDL	6.00E-02		BDL	6.00E-02		
190	P	Measured	µg	ADL	1.24E-02		ADL	4.65E-02		BDL	2.66E-02		DLL	2.85E-02					
191	Rb	Measured	µg	ADL	3.60E-03		ADL	9.50E-03		ADL	8.30E-03		ADL	7.13E-03					
192	S	Measured	µg	BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02		BDL	1.67E-02		
193	Sb	Measured	µg	ADL	1.12E-02		ADL	1.59E-02		ADL	2.54E-02		ADL	1.75E-02					
194	Sc	Measured	µg	ADL	9.50E-03		BDL	3.57E-01		ADL	7.55E-02		DLL	1.47E-01					
195	Se	Measured	µg	BDL	1.50E-02		ADL	6.50E-03		BDL	1.50E-02		DLL	1.22E-02					
196	Si	Measured	µg	ADL	2.49E-01		ADL	3.24E-02		ADL	1.86E-01		ADL	1.56E-01					
197	Sm	Measured	µg	ADL	1.64E-01		BDL	6.59E-01		BDL	6.59E-01		DLL	4.94E-01					
198	Sn	Measured	µg	BDL	6.00E-02		BDL	6.00E-02		ADL	5.43E-02		DLL	5.81E-02					
199	Sr	Measured	µg	BDL	1.16E-02		BDL	1.16E-02		ADL	3.50E-03		DLL	8.90E-03					
200	Ta	Measured	µg	BDL	1.67E-01		BDL	1.67E-01		BDL	1.67E-01		BDL	1.67E-01		BDL	1.67E-01		
201	Tb	Measured	µg	BDL	4.75E-01		ADL	3.20E-01		BDL	4.80E-01		DLL	4.25E-01					
202	Ti	Measured	µg	ADL	4.20E-03		BDL	8.30E-03		BDL	8.30E-03		DLL	6.93E-03					
203	Tl	Measured	µg	BDL	1.33E-02		BDL	1.33E-02		ADL	7.70E-03		DLL	1.14E-02					
204	U	Measured	µg	BDL	3.49E-02		BDL	3.49E-02		BDL	3.49E-02		BDL	3.49E-02		BDL	3.49E-02		
205	V	Measured	µg	ADL	2.40E-03		BDL	3.40E-03		BDL	3.40E-03		DLL	3.07E-03					
206	W	Measured	µg	ADL	1.66E-02		BDL	1.67E-01		ADL	5.42E-02		DLL	7.91E-02					
207	Y	Measured	µg	BDL	1.16E-02		ADL	4.80E-03		ADL	2.36E-02		DLL	1.33E-02					
208	Zn	Measured	µg	ADL	1.06E-02		ADL	8.20E-03		ADL	8.20E-03		ADL	9.00E-03					
209	Zr	Measured	µg	ADL	2.77E-02		BDL	1.50E-02		ADL	6.50E-03		DLL	1.64E-02					

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
211	Ions																		
212	NH4+	Measured	µg																
213	Cl-	Measured	µg																
214	NO3-	Measured	µg																
215	K+	Measured	µg																
216	Na+	Measured	µg																
217	SO42-	Measured	µg																
219																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa						Run 1				Run 2				Run 3				Average
2	Parameter	Type	Units				Value				Value				Value				Value
220	Species Lab Results - STFB Samples																		
221	<u>Carbon</u>																		
222	OC	Measured	µg			ADL	2.50E+00			ADL	3.63E+00							DLL	3.07E+00
223	EC	Measured	µg			BDL	7.63E-01			BDL	7.63E-01							DLL	7.63E-01
224	Total C	Measured	µg			ADL	2.50E+00			ADL	3.63E+00							DLL	3.07E+00
225	OC Backup	Measured	µg			ADL	4.03E+00			ADL	1.49E+01							DLL	9.47E+00
226	EC Backup	Measured	µg			BDL	7.63E-01			ADL	2.70E-01							DLL	5.17E-01
227	Total C Backup	Measured	µg			ADL	4.03E+00			ADL	1.52E+01							DLL	9.61E+00
228																			
229	<u>Elements</u>																		
230	Ag	Measured	µg			BDL	3.34E-02			BDL	3.34E-02							DLL	3.34E-02
231	Al	Measured	µg			ADL	2.17E-01			BDL	4.62E-01							DLL	3.40E-01
232	As	Measured	µg			BDL	1.33E-02			BDL	1.33E-02							DLL	1.33E-02
233	Au	Measured	µg			BDL	3.66E-02			ADL	2.00E-02							DLL	2.83E-02
234	Ba	Measured	µg			ADL	6.54E-02			BDL	1.19E-01							DLL	9.23E-02
235	Br	Measured	µg			ADL	6.50E-03			BDL	1.16E-02							DLL	9.05E-03
236	Ca	Measured	µg			BDL	1.33E-02			BDL	1.33E-02							DLL	1.33E-02
237	Cd	Measured	µg			BDL	6.66E-02			ADL	5.90E-03							DLL	3.63E-02
238	Ce	Measured	µg			BDL	4.67E-01			ADL	4.01E-01							DLL	4.34E-01
239	Cl	Measured	µg			ADL	8.90E-03			ADL	1.48E-02							DLL	1.19E-02
240	Co	Measured	µg			BDL	3.40E-03			BDL	3.40E-03							DLL	3.40E-03
241	Cr	Measured	µg			ADL	2.84E-02			BDL	1.33E-02							DLL	2.09E-02
242	Cs	Measured	µg			ADL	9.42E-02			ADL	9.89E-02							DLL	9.66E-02
243	Cu	Measured	µg			BDL	1.16E-02			BDL	1.16E-02							DLL	1.16E-02
244	Eu	Measured	µg			BDL	9.82E-01			BDL	9.83E-01							DLL	9.82E-01
245	Fe	Measured	µg			ADL	2.83E-02			ADL	1.30E-02							DLL	2.07E-02
246	Ga	Measured	µg			BDL	1.16E-02			BDL	1.16E-02							DLL	1.16E-02
247	Hf	Measured	µg			BDL	1.67E-01			BDL	1.67E-01							DLL	1.67E-01
248	Hg	Measured	µg			BDL	2.50E-02			BDL	2.50E-02							DLL	2.50E-02
249	In	Measured	µg			BDL	3.17E-02			BDL	3.17E-02							DLL	3.17E-02
250	Ir	Measured	µg			BDL	3.66E-02			BDL	3.66E-02							DLL	3.66E-02
251	K	Measured	µg			BDL	2.16E-02			BDL	2.16E-02							DLL	2.16E-02
252	La	Measured	µg			ADL	7.66E-02			ADL	1.94E-01							DLL	1.36E-01
253	Mg	Measured	µg			BDL	1.85E+00			BDL	1.85E+00							DLL	1.85E+00
254	Mn	Measured	µg			ADL	3.60E-03			BDL	3.34E-02							DLL	1.85E-02
255	Mo	Measured	µg			BDL	1.84E-02			ADL	6.00E-04							DLL	9.50E-03
256	Na	Measured	µg			BDL	7.70E+00			BDL	7.70E+00							DLL	7.70E+00
257	Nb	Measured	µg			ADL	3.60E-03			BDL	1.00E-02							DLL	6.80E-03
258	Ni	Measured	µg			ADL	1.20E-03			BDL	6.60E-03							DLL	3.90E-03
259	Pb	Measured	µg			ADL	2.36E-02			BDL	1.99E-02							DLL	2.18E-02
260	Pd	Measured	µg			BDL	6.00E-02			ADL	5.54E-02							DLL	5.77E-02
261	P	Measured	µg			BDL	2.66E-02			ADL	5.01E-02							DLL	3.84E-02
262	Rb	Measured	µg			ADL	9.50E-03			ADL	8.30E-03							DLL	8.90E-03
263	S	Measured	µg			BDL	1.67E-02			BDL	1.67E-02							DLL	1.67E-02
264	Sb	Measured	µg			ADL	3.01E-02			ADL	3.01E-02							DLL	3.01E-02
265	Sc	Measured	µg			ADL	8.49E-02			BDL	3.57E-01							DLL	2.21E-01
266	Se	Measured	µg			BDL	1.50E-02			ADL	1.36E-02							DLL	1.43E-02
267	Si	Measured	µg			ADL	1.35E-01			ADL	1.43E-01							DLL	1.39E-01
268	Sm	Measured	µg			ADL	4.84E-01			BDL	6.61E-01							DLL	5.72E-01
269	Sn	Measured	µg			BDL	6.00E-02			ADL	1.30E-02							DLL	3.65E-02
270	Sr	Measured	µg			BDL	1.16E-02			BDL	1.16E-02							DLL	1.16E-02
271	Ta	Measured	µg			BDL	1.67E-01			BDL	1.67E-01							DLL	1.67E-01
272	Tb	Measured	µg			BDL	4.76E-01			BDL	4.74E-01							DLL	4.75E-01
273	Ti	Measured	µg			ADL	1.01E-02			BDL	8.30E-03							DLL	9.20E-03
274	Tl	Measured	µg			ADL	6.50E-03			BDL	1.33E-02							DLL	9.90E-03
275	U	Measured	µg			BDL	3.49E-02			BDL	3.49E-02							DLL	3.49E-02
276	V	Measured	µg			BDL	3.40E-03			ADL	5.90E-03							DLL	4.65E-03
277	W	Measured	µg			ADL	8.30E-03			BDL	1.67E-01							DLL	8.75E-02
278	Y	Measured	µg			ADL	7.10E-03			ADL	1.00E-04							DLL	3.60E-03
279	Zn	Measured	µg			BDL	1.99E-02			ADL	8.20E-03							DLL	1.41E-02
280	Zr	Measured	µg			ADL	1.83E-02			ADL	1.80E-03							DLL	1.01E-02

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
282	Ions																		
283	NH4+	Measured	µg	BDL	1.67E-02			BDL	1.67E-02							DLL	1.67E-02		
284	Cl-	Measured	µg	BDL	1.67E-02			BDL	1.67E-02							DLL	1.67E-02		
285	NO3-	Measured	µg	ADL	1.95E-01			ADL	7.57E-02							DLL	1.35E-01		
286	K+	Measured	µg	BDL	5.01E-01			BDL	5.01E-01							DLL	5.01E-01		
287	Na+	Measured	µg	BDL	5.82E-01			BDL	1.67E-02							DLL	2.99E-01		
288	SO42-	Measured	µg	BDL	1.67E-02			BDL	1.67E-02							DLL	1.67E-02		
289																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa						Run 1				Run 2				Run 3				Average
2	Parameter	Type	Units				Value				Value				Value				Value
291	Species Lab Results - STFB Dilution Air																		
292	<u>Carbon</u>																		
293	OC	Measured	µg																
294	EC	Measured	µg																
295	Total C	Measured	µg																
296	OC Backup	Measured	µg		ADL		7.14E+00		ADL		4.58E+00					DLL		5.86E+00	
297	EC Backup	Measured	µg		BDL		7.63E-01		BDL		7.63E-01					DLL		7.63E-01	
298	Total C Backup	Measured	µg		ADL		7.14E+00		ADL		4.58E+00					DLL		5.86E+00	
300	<u>Elements</u>																		
301	Ag	Measured	µg		BDL		3.34E-02		BDL		3.34E-02					DLL		3.34E-02	
302	Al	Measured	µg		BDL		4.63E-01		BDL		4.61E-01					DLL		4.62E-01	
303	As	Measured	µg		BDL		1.33E-02		BDL		1.33E-02					DLL		1.33E-02	
304	Au	Measured	µg		BDL		3.66E-02		ADL		4.70E-03					DLL		2.07E-02	
305	Ba	Measured	µg		BDL		1.18E-01		BDL		1.18E-01					DLL		1.18E-01	
306	Br	Measured	µg		ADL		1.12E-02		ADL		5.30E-03					DLL		8.25E-03	
307	Ca	Measured	µg		BDL		1.33E-02		BDL		1.25E-02					DLL		1.29E-02	
308	Cd	Measured	µg		BDL		6.66E-02		BDL		6.66E-02					DLL		6.66E-02	
309	Ce	Measured	µg		ADL		1.87E-01		ADL		3.55E-01					DLL		2.71E-01	
310	Cl	Measured	µg		BDL		1.16E-02		BDL		1.16E-02					DLL		1.16E-02	
311	Co	Measured	µg		BDL		3.40E-03		BDL		3.40E-03					DLL		3.40E-03	
312	Cr	Measured	µg		ADL		3.60E-03		ADL		2.40E-03					DLL		3.00E-03	
313	Cs	Measured	µg		ADL		1.45E-01		ADL		8.72E-02					DLL		1.16E-01	
314	Cu	Measured	µg		ADL		2.40E-03		ADL		1.54E-02					DLL		8.90E-03	
315	Eu	Measured	µg		BDL		9.81E-01		ADL		7.50E-01					DLL		8.66E-01	
316	Fe	Measured	µg		BDL		5.50E-02		BDL		5.50E-02					DLL		5.50E-02	
317	Ga	Measured	µg		BDL		1.16E-02		BDL		1.16E-02					DLL		1.16E-02	
318	Hf	Measured	µg		BDL		1.67E-01		BDL		1.67E-01					DLL		1.67E-01	
319	Hg	Measured	µg		BDL		2.50E-02		BDL		2.50E-02					DLL		2.50E-02	
320	In	Measured	µg		BDL		3.17E-02		BDL		3.17E-02					DLL		3.17E-02	
321	Ir	Measured	µg		BDL		3.66E-02		BDL		3.66E-02					DLL		3.66E-02	
322	K	Measured	µg		ADL		1.41E-02		BDL		2.16E-02					DLL		1.79E-02	
323	La	Measured	µg		BDL		1.98E-01		BDL		1.98E-01					DLL		1.98E-01	
324	Mg	Measured	µg		BDL		1.86E+00		BDL		1.86E+00					DLL		1.86E+00	
325	Mn	Measured	µg		BDL		3.34E-02		ADL		1.07E-02					DLL		2.21E-02	
326	Mo	Measured	µg		BDL		1.84E-02		ADL		2.90E-03					DLL		1.07E-02	
327	Na	Measured	µg		BDL		7.78E+00		BDL		7.42E+00					DLL		7.60E+00	
328	Nb	Measured	µg		ADL		7.10E-03		ADL		4.80E-03					DLL		5.95E-03	
329	Ni	Measured	µg		BDL		6.60E-03		BDL		6.60E-03					DLL		6.60E-03	
330	Pb	Measured	µg		ADL		1.53E-02		ADL		2.01E-02					DLL		1.77E-02	
331	Pd	Measured	µg		BDL		6.00E-02		BDL		6.00E-02					DLL		6.00E-02	
332	P	Measured	µg		BDL		2.66E-02		ADL		1.00E-02					DLL		1.83E-02	
333	Rb	Measured	µg		BDL		3.40E-03		ADL		3.60E-03					DLL		3.50E-03	
334	S	Measured	µg		BDL		1.67E-02		BDL		1.67E-02					DLL		1.67E-02	
335	Sb	Measured	µg		ADL		6.89E-02		BDL		8.33E-02					DLL		7.61E-02	
336	Sc	Measured	µg		BDL		3.58E-01		BDL		3.57E-01					DLL		3.57E-01	
337	Se	Measured	µg		BDL		1.50E-02		BDL		1.50E-02					DLL		1.50E-02	
338	Si	Measured	µg		BDL		5.12E-02		ADL		1.02E-01					DLL		7.66E-02	
339	Sm	Measured	µg		BDL		6.59E-01		ADL		4.71E-02					DLL		3.53E-01	
340	Sn	Measured	µg		ADL		3.66E-02		BDL		6.00E-02					DLL		4.83E-02	
341	Sr	Measured	µg		BDL		1.16E-02		ADL		3.50E-03					DLL		7.55E-03	
342	Ta	Measured	µg		BDL		1.67E-01		BDL		1.67E-01					DLL		1.67E-01	
343	Tb	Measured	µg		ADL		1.27E-01		BDL		4.82E-01					DLL		3.04E-01	
344	Ti	Measured	µg		ADL		2.19E-02		BDL		8.30E-03					DLL		1.51E-02	
345	Tl	Measured	µg		BDL		1.33E-02		BDL		1.33E-02					DLL		1.33E-02	
346	U	Measured	µg		BDL		3.49E-02		BDL		3.49E-02					DLL		3.49E-02	
347	V	Measured	µg		ADL		9.40E-03		ADL		4.70E-03					DLL		7.05E-03	
348	W	Measured	µg		ADL		2.36E-02		BDL		1.67E-01					DLL		9.51E-02	
349	Y	Measured	µg		ADL		7.10E-03		ADL		1.19E-02					DLL		9.50E-03	
350	Zn	Measured	µg		ADL		8.20E-03		ADL		1.88E-02					DLL		1.35E-02	
351	Zr	Measured	µg		BDL		1.50E-02		ADL		5.40E-03					DLL		1.02E-02	

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
353	Ions																		
354	NH4+	Measured	µg																
355	Cl-	Measured	µg																
356	NO3-	Measured	µg																
357	K+	Measured	µg																
358	Na+	Measured	µg																
359	SO42-	Measured	µg																
360																			
361																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
362	Species Concentrations (with dilution air blank subtraction)																		
365	Carbon																		
366	OC	Calculated	mg/dscm	ADL		1.14E+00	ADL		1.36E+00	ADL		1.23E+00	#	ADL		1.24E+00			
367	EC	Calculated	mg/dscm	ADL		1.19E-02	ADL		2.82E-02	ADL		2.11E-02	#	ADL		2.04E-02			
368	Total C	Calculated	mg/dscm	ADL		1.15E+00	ADL		1.39E+00	ADL		1.26E+00	#	ADL		1.26E+00			
369	OC Backup	Calculated	mg/dscm	ADL		1.77E-01	ADL		2.29E-01	ADL		1.76E-01	ADL		1.94E-01				
370	EC Backup	Calculated	mg/dscm	B	ADL	4.13E-04	BDL		1.01E-04	FB	B	ADL	1.87E-04	FB	B	DLL	2.34E-04		
371	Total C Backup	Calculated	mg/dscm	B	ADL	1.61E-02	B	ADL	1.64E-02	B	ADL	1.49E-02	B	ADL	1.58E-02				
373	Elements																		
374	Ag	Calculated	mg/dscm	BBL		5.54E-05	BDL		5.12E-06	BDL		4.34E-06	DLL		2.16E-05				
375	Al	Calculated	mg/dscm	BDL		3.59E-04	FB	BBL	9.38E-04	BDL		5.73E-05	FB	B	DLL	4.52E-04			
376	As	Calculated	mg/dscm	BDL		1.76E-06	BDL		2.04E-06	BDL		1.73E-06	BDL		1.84E-06				
377	Au	Calculated	mg/dscm	BDL		4.85E-06	FB	BBL	7.44E-05	FB	B	ADL	2.96E-05	FB	B	DLL	3.63E-05		
378	Ba	Calculated	mg/dscm	BDL		2.03E-05	ADL		9.00E-04	BDL		2.00E-05	FB	DLL	3.14E-04				
379	Br	Calculated	mg/dscm	FB	ADL	5.51E-05	FB	ADL	1.91E-05	FB	B	BBL	3.52E-05	FB	B	DLL	3.64E-05		
380	Ca	Calculated	mg/dscm	ADL		7.97E-03	ADL		8.94E-03	ADL		5.98E-03	ADL		7.63E-03				
381	Cd	Calculated	mg/dscm	BDL		8.83E-06	FB	BBL	1.35E-04	BDL		8.65E-06	FB	DLL	5.10E-05				
382	Ce	Calculated	mg/dscm	FB	B	BBL	3.49E-04	BDL	5.10E-04	BDL		6.48E-05	FB	B	DLL	3.08E-04			
383	Cl	Calculated	mg/dscm	ADL		5.37E-04	ADL		1.40E-03	FB	B	ADL	4.70E-05	ADL		6.61E-04			
384	Co	Calculated	mg/dscm	BDL		4.51E-07	BDL		5.22E-07	BDL		4.42E-07	BDL		4.71E-07				
385	Cr	Calculated	mg/dscm	FB	ADL	7.29E-05	BDL		9.77E-06	FB	B	BBL	3.44E-05	FB	B	DLL	3.90E-05		
386	Cs	Calculated	mg/dscm	FB	BBL	2.79E-04	FB	B	ADL	2.67E-04	BDL	1.22E-04	FB	B	DLL	2.23E-04			
387	Cu	Calculated	mg/dscm	B	BBL	2.56E-05	BDL		1.78E-06	BDL		1.51E-06	B	DLL	9.61E-06				
388	Eu	Calculated	mg/dscm	BDL		9.45E-04	B	ADL	1.45E-03	BDL		1.43E-04	B	DLL	8.47E-04				
389	Fe	Calculated	mg/dscm	ADL		4.58E-04	FB	B	BBL	1.58E-04	ADL	9.22E-05	B	DLL	2.36E-04				
390	Ga	Calculated	mg/dscm	BDL		1.54E-06	BDL		1.78E-06	BDL		1.51E-06	BDL		1.61E-06				
391	Hf	Calculated	mg/dscm	BDL		2.21E-05	BDL		2.56E-05	BDL		2.17E-05	BDL		2.31E-05				
392	Hg	Calculated	mg/dscm	BDL		4.46E-05	BDL		5.25E-05	BDL		3.25E-06	BDL		3.34E-05				
393	In	Calculated	mg/dscm	BDL		4.20E-06	BDL		6.08E-05	BDL		4.12E-06	BDL		2.30E-05				
394	Ir	Calculated	mg/dscm	BDL		4.85E-06	BDL		5.62E-06	BDL		4.76E-06	BDL		5.08E-06				
395	K	Calculated	mg/dscm	ADL		2.40E-04	ADL		1.34E-04	B	ADL	4.61E-05	B	ADL	1.40E-04				
396	La	Calculated	mg/dscm	FB	B	BBL	6.07E-05	FB	ADL	3.10E-04	BDL	2.86E-05	FB	B	DLL	1.33E-04			
397	Mg	Calculated	mg/dscm	BDL		3.05E-03	BDL		2.50E-04	BDL		2.36E-04	BDL		1.18E-03				
398	Mn	Calculated	mg/dscm	BDL		4.43E-06	BDL		5.12E-06	FB	BBL	5.40E-05	FB	DLL	2.12E-05				
399	Mo	Calculated	mg/dscm	BDL		2.44E-06	BDL		2.82E-06	BDL		2.39E-06	BDL		2.55E-06				
400	Na	Calculated	mg/dscm	BDL		1.55E-03	BDL		1.17E-03	BDL		1.64E-03	BDL		1.45E-03				
401	Nb	Calculated	mg/dscm	BDL		9.95E-06	BDL		1.53E-06	BDL		1.36E-05	BDL		8.36E-06				
402	Ni	Calculated	mg/dscm	FB	ADL	1.45E-05	BDL		1.01E-06	BDL		8.58E-07	FB	DLL	5.45E-06				
403	Pb	Calculated	mg/dscm	FB	B	ADL	6.33E-06	FB	ADL	4.98E-05	FB	B	BBL	7.61E-05	FB	B	DLL	4.41E-05	
404	Pd	Calculated	mg/dscm	BDL		7.96E-06	BDL		9.21E-06	BDL		7.80E-06	BDL		8.32E-06				
405	P	Calculated	mg/dscm	ADL		4.38E-04	ADL		6.13E-04	ADL		8.22E-04	ADL		6.24E-04				
406	Rb	Calculated	mg/dscm	BDL		5.97E-06	FB	B	BBL	1.93E-05	FB	B	BBL	1.34E-05	FB	B	DLL	1.29E-05	
407	S	Calculated	mg/dscm	ADL		1.09E-02	ADL		6.36E-03	ADL		4.79E-03	ADL		7.34E-03				
408	Sb	Calculated	mg/dscm	BDL		1.31E-04	FB	B	ADL	4.88E-05	FB	B	ADL	1.36E-05	FB	B	DLL	6.44E-05	
409	Sc	Calculated	mg/dscm	BDL		6.24E-04	BDL		5.67E-05	BDL		5.01E-04	BDL		3.94E-04				
410	Se	Calculated	mg/dscm	BDL		1.99E-06	BDL		1.96E-05	BDL		1.95E-06	BDL		7.84E-06				
411	Si	Calculated	mg/dscm	FB	B	ADL	4.13E-04	FB	ADL	3.63E-04	ADL	1.40E-03	FB	B	ADL	7.26E-04			
412	Sm	Calculated	mg/dscm	FB	B	ADL	1.65E-04	BDL	1.05E-04	BDL		8.70E-05	FB	B	DLL	1.19E-04			
413	Sn	Calculated	mg/dscm	FB	BBL	9.95E-05	FB	BBL	1.22E-04	BDL		1.70E-05	FB	B	DLL	7.95E-05			
414	Sr	Calculated	mg/dscm	ADL		1.66E-05	ADL		1.75E-05	ADL		2.93E-05	B	ADL	2.11E-05				
415	Ta	Calculated	mg/dscm	BDL		2.21E-05	BDL		2.56E-05	BDL		2.17E-05	BDL		2.31E-05				
416	Tb	Calculated	mg/dscm	BDL		6.44E-05	BDL		4.06E-04	BDL		6.08E-05	BDL		1.77E-04				
417	Ti	Calculated	mg/dscm	ADL		2.05E-04	ADL		2.47E-04	FB	ADL	6.58E-05	ADL		1.73E-04				
418	Tl	Calculated	mg/dscm	FB	BBL	2.21E-05	FB	BBL	2.70E-05	FB	B	BBL	1.24E-05	FB	B	BBL	2.05E-05		
419	U	Calculated	mg/dscm	BDL		4.63E-06	BBL		7.10E-05	BBL		5.64E-05	DLL		4.40E-05				
420	V	Calculated	mg/dscm	BDL		2.11E-06	BDL		5.22E-07	BDL		4.42E-07	BDL		1.02E-06				
421	W	Calculated	mg/dscm	FB	ADL	1.90E-04	FB	BBL	3.39E-04	FB	B	BBL	8.76E-05	FB	B	DLL	2.05E-04		
422	Y	Calculated	mg/dscm	ADL		1.89E-05	FB	B	BBL	9.76E-06	BDL	3.81E-05	FB	B	DLL	2.23E-05			
423	Zn	Calculated	mg/dscm	ADL		1.30E-03	ADL		1.46E-03	ADL		8.81E-04	ADL		1.21E-03				
424	Zr	Calculated	mg/dscm	BDL		4.60E-05	BDL		2.30E-06	BDL		1.57E-05	BDL		2.13E-05				

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa						Run 1				Run 2				Run 3				
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>	<u>Value</u>			
426	Ions																		
427	NH4+	Calculated	mg/dscm				BDL	2.98591E-05		BDL	3.61656E-05		BDL	2.91603E-05		BDL			3.17283E-05
428	Cl-	Calculated	mg/dscm				BDL	2.98591E-05		BDL	3.61656E-05		BDL	2.91603E-05		BDL			3.17283E-05
429	NO3-	Calculated	mg/dscm	#	ADL		0.003673327		#	ADL	0.006015448		#	ADL	0.002193416		#	ADL	0.00396073
430	K+	Calculated	mg/dscm				BDL	0.000896067		BDL	0.001085306		BDL	0.000875082		BDL			0.000952152
431	Na+	Calculated	mg/dscm	#	ADL		0.000611143		#	ADL	0.000134053		BDL	2.91603E-05		#	DLL		0.000258119
432	SO42-	Calculated	mg/dscm	#	ADL		0.007132594		#	ADL	0.008502171		#	ADL	0.006211186		#	ADL	0.007281984

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
435	Reconstructed Mass (applying oxide factors for elements and 1/2 RL for BDL, subtract OC Backup and dilution air blank)																		
436	OC	Calculated	mg/dscm	ADL			1.04E+00	ADL			1.22E+00	ADL			1.14E+00	ADL			1.13E+00
437	EC	Calculated	mg/dscm	ADL			1.19E-02	ADL			2.82E-02	ADL			2.11E-02	ADL			2.04E-02
438	Total C	Calculated	mg/dscm																
439	OC Backup	Calculated	mg/dscm																
440	EC Backup	Calculated	mg/dscm																
441	Total C Backup	Calculated	mg/dscm																
443	Elements																		
444	Ag	Calculated	mg/dscm	BBL			7.18E-05	BDL			3.32E-06	BDL			2.81E-06	DLL			2.60E-05
445	Al	Calculated	mg/dscm	BDL			3.39E-04	BBL			1.77E-03	BDL			5.41E-05	DLL			7.22E-04
446	As	Calculated	mg/dscm	BDL			1.35E-06	BDL			1.57E-06	BDL			1.33E-06	BDL			1.41E-06
447	Au	Calculated	mg/dscm	BDL			2.72E-06	BBL			8.35E-05	ADL			3.32E-05	DLL			3.98E-05
448	Ba	Calculated	mg/dscm	BDL			1.25E-05	ADL			1.11E-03	BDL			1.23E-05	DLL			3.78E-04
449	Br	Calculated	mg/dscm	ADL			7.71E-05	ADL			2.67E-05	BBL			4.93E-05	DLL			5.10E-05
450	Ca	Calculated	mg/dscm	ADL			1.43E-02	ADL			1.61E-02	ADL			1.08E-02	ADL			1.37E-02
451	Cd	Calculated	mg/dscm	BDL			5.04E-06	BBL			1.55E-04	BDL			4.94E-06	DLL			5.49E-05
452	Ce	Calculated	mg/dscm	BBL			4.29E-04	BDL			3.13E-04	BDL			3.98E-05	DLL			2.61E-04
453	Cl	Calculated	mg/dscm	ADL			1.39E-03	ADL			3.61E-03	ADL			1.21E-04	ADL			1.70E-03
454	Co	Calculated	mg/dscm	BDL			3.07E-07	BDL			3.55E-07	BDL			3.01E-07	BDL			3.21E-07
455	Cr	Calculated	mg/dscm	ADL			1.40E-04	BDL			9.39E-06	BBL			6.62E-05	DLL			7.20E-05
456	Cs	Calculated	mg/dscm	BBL			2.96E-04	ADL			2.83E-04	BDL			6.47E-05	DLL			2.15E-04
457	Cu	Calculated	mg/dscm	BBL			3.20E-05	BDL			1.11E-06	BDL			9.44E-07	DLL			1.13E-05
458	Eu	Calculated	mg/dscm	BDL			5.47E-04	ADL			1.68E-03	BDL			8.29E-05	DLL			7.71E-04
459	Fe	Calculated	mg/dscm	ADL			6.55E-04	BBL			2.26E-04	ADL			1.32E-04	DLL			3.38E-04
460	Ga	Calculated	mg/dscm	BDL			1.03E-06	BDL			1.20E-06	BDL			1.01E-06	BDL			1.08E-06
461	Hf	Calculated	mg/dscm	BDL			1.30E-05	BDL			1.51E-05	BDL			1.28E-05	BDL			1.36E-05
462	Hg	Calculated	mg/dscm	BDL			2.41E-05	BDL			2.83E-05	BDL			1.75E-06	BDL			1.81E-05
463	In	Calculated	mg/dscm	BDL			2.54E-06	BDL			3.67E-05	BDL			2.49E-06	BDL			1.39E-05
464	Ir	Calculated	mg/dscm	BDL			2.83E-06	BDL			3.28E-06	BDL			2.77E-06	BDL			2.96E-06
465	K	Calculated	mg/dscm	ADL			4.36E-04	ADL			2.43E-04	ADL			8.39E-05	ADL			2.55E-04
466	La	Calculated	mg/dscm	BBL			7.12E-05	ADL			3.63E-04	BDL			1.68E-05	DLL			1.50E-04
467	Mg	Calculated	mg/dscm	BDL			3.53E-03	BDL			2.89E-04	BDL			2.73E-04	BDL			1.36E-03
468	Mn	Calculated	mg/dscm	BDL			4.47E-06	BDL			5.17E-06	BBL			1.09E-04	DLL			3.95E-05
469	Mo	Calculated	mg/dscm	BDL			1.83E-06	BDL			2.12E-06	BDL			1.79E-06	BDL			1.91E-06
470	Na	Calculated	mg/dscm	BDL			1.86E-03	BDL			1.40E-03	BDL			1.96E-03	BDL			1.74E-03
471	Nb	Calculated	mg/dscm	BDL			7.12E-06	BDL			1.10E-06	BDL			9.71E-06	BDL			5.98E-06
472	Ni	Calculated	mg/dscm	ADL			2.04E-05	BDL			7.13E-07	BDL			6.04E-07	DLL			7.25E-06
473	Pb	Calculated	mg/dscm	ADL			7.31E-06	ADL			5.75E-05	BBL			8.78E-05	DLL			5.09E-05
474	Pd	Calculated	mg/dscm	BDL			5.18E-06	BDL			5.99E-06	BDL			5.07E-06	BDL			5.41E-06
475	P	Calculated	mg/dscm	ADL			1.00E-03	ADL			1.40E-03	ADL			1.88E-03	ADL			1.43E-03
476	Rb	Calculated	mg/dscm	BDL			4.10E-06	BBL			2.65E-05	BBL			1.84E-05	DLL			1.64E-05
477	S	Calculated	mg/dscm	ADL			3.26E-02	ADL			1.91E-02	ADL			1.43E-02	ADL			2.20E-02
478	Sb	Calculated	mg/dscm	BDL			8.68E-05	ADL			6.48E-05	ADL			1.81E-05	DLL			5.66E-05
479	Sc	Calculated	mg/dscm	BDL			4.78E-04	BDL			4.35E-05	BDL			3.84E-04	BDL			3.02E-04
480	Se	Calculated	mg/dscm	BDL			1.60E-06	BDL			1.57E-05	BDL			1.57E-06	BDL			6.30E-06
481	Si	Calculated	mg/dscm	ADL			8.83E-04	ADL			7.77E-04	ADL			3.00E-03	ADL			1.55E-03
482	Sm	Calculated	mg/dscm	ADL			1.92E-04	BDL			6.08E-05	BDL			5.05E-05	DLL			1.01E-04
483	Sn	Calculated	mg/dscm	BBL			1.26E-04	BBL			1.55E-04	BDL			1.08E-05	DLL			9.74E-05
484	Sr	Calculated	mg/dscm	ADL			2.26E-05	ADL			2.39E-05	ADL			3.99E-05	ADL			2.88E-05
485	Ta	Calculated	mg/dscm	BDL			1.35E-05	BDL			1.56E-05	BDL			1.32E-05	BDL			1.41E-05
486	Tb	Calculated	mg/dscm	BDL			3.79E-05	BDL			2.39E-04	BDL			3.57E-05	BDL			1.04E-04
487	Ti	Calculated	mg/dscm	ADL			3.42E-04	ADL			4.12E-04	ADL			1.10E-04	ADL			2.88E-04
488	Tl	Calculated	mg/dscm	BBL			2.47E-05	BBL			3.02E-05	BBL			1.39E-05	BBL			2.29E-05
489	U	Calculated	mg/dscm	BDL			2.78E-06	BBL			8.53E-05	BBL			6.78E-05	DLL			5.19E-05
490	V	Calculated	mg/dscm	BDL			1.88E-06	BDL			4.66E-07	BDL			3.94E-07	BDL			9.15E-07
491	W	Calculated	mg/dscm	ADL			2.40E-04	BBL			4.27E-04	BBL			1.10E-04	DLL			2.59E-04
492	Y	Calculated	mg/dscm	ADL			2.40E-05	BBL			1.24E-05	BDL			2.42E-05	DLL			2.02E-05
493	Zn	Calculated	mg/dscm	ADL			1.93E-03	ADL			2.17E-03	ADL			1.31E-03	ADL			1.81E-03
494	Zr	Calculated	mg/dscm	BDL			3.10E-05	BDL			1.55E-06	BDL			1.06E-05	BDL			1.44E-05

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
496	Ions																		
497	NH4+	Calculated	mg/dscm	BDL			1.49E-05	BDL			1.81E-05	BDL			1.46E-05	BDL			1.59E-05
498	Cl-	Calculated	mg/dscm	BDL			3.85E-05	BDL			4.66E-05	BDL			3.76E-05	BDL			4.09E-05
499	NO3-	Calculated	mg/dscm	ADL			3.67E-03	ADL			6.02E-03	ADL			2.19E-03	ADL			3.96E-03
500	K+	Calculated	mg/dscm	BDL			8.15E-04	BDL			9.87E-04	BDL			7.96E-04	BDL			8.66E-04
501	Na+	Calculated	mg/dscm	ADL			1.46E-03	ADL			3.21E-04	BDL			3.49E-05	DLL			6.06E-04
502	SO42-	Calculated	mg/dscm	ADL			1.19E-02	ADL			1.42E-02	ADL			1.03E-02	ADL			1.21E-02
503																			
504	Reconstructed mas	Calculated	mg/dscm	DLL			1.12E+00	DLL			1.31E+00	DLL			1.20E+00	DLL			1.21E+00
505	Species mass closure		%				90%				101%				94%				95%
509																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
658	Species Profile (fraction of sum of species, with dilution air blank)																		
659	OC	Calculated	mg/mg	0	ADL	0.92983	0	ADL	0.93290	0	ADL	0.95052	#	ADL	0.93779				
660	EC	Calculated	mg/mg	0	ADL	0.01066	0	ADL	0.02154	0	ADL	0.01756	#	ADL	0.01687				
661	Total C	Calculated	mg/mg	0	ADL	0.00000	0	ADL	0.00000	0	ADL	0.00000	#	ADL	0.00000				
662	OC Backup	Calculated	mg/mg																
663	EC Backup	Calculated	mg/mg																
664	Total C Backup	Calculated	mg/mg																
665																			
666	Elements (as oxides)																		
667	Ag	Calculated	mg/mg	BBL		0.00006	BDL		0.00000	BDL		0.00000	DLL		0.00002				
668	Al	Calculated	mg/mg	BDL		0.00030	FB	BBL	0.00135	BDL		0.00005	FB	B	DLL	0.00060			
669	As	Calculated	mg/mg	BDL		0.00000		BDL	0.00000	BDL		0.00000		BDL	0.00000				
670	Au	Calculated	mg/mg	BDL		0.00000	FB	BBL	0.00006	FB	B	ADL	0.00003	FB	B	DLL	0.00003		
671	Ba	Calculated	mg/mg	BDL		0.00001		ADL	0.00085	BDL		0.00001	FB		DLL	0.00031			
672	Br	Calculated	mg/mg	FB	ADL	0.00007	FB	ADL	0.00002	FB	B	BBL	0.00004	FB	B	DLL	0.00004		
673	Ca	Calculated	mg/mg		ADL	0.01285		ADL	0.01229		ADL	0.00895		ADL	0.01136				
674	Cd	Calculated	mg/mg		BDL	0.00000	FB	BBL	0.00012		BDL	0.00000	FB		DLL	0.00005			
675	Ce	Calculated	mg/mg	FB	B	BBL	0.00038		BDL	0.00024		BDL	0.00003	FB	B	DLL	0.00022		
676	Cl	Calculated	mg/mg		ADL	0.00124		ADL	0.00276	FB	B	ADL	0.00010		ADL	0.00141			
677	Co	Calculated	mg/mg		BDL	0.00000		BDL	0.00000		BDL	0.00000		BDL	0.00000				
678	Cr	Calculated	mg/mg	FB	ADL	0.00013		BDL	0.00001	FB	B	BBL	0.00006	FB	B	DLL	0.00006		
679	Cs	Calculated	mg/mg	FB	BBL	0.00027	FB	B	ADL	0.00022		BDL	0.00005	FB	B	DLL	0.00018		
680	Cu	Calculated	mg/mg	B	BBL	0.00003		BDL	0.00000		BDL	0.00000		B	DLL	0.00001			
681	Eu	Calculated	mg/mg		BDL	0.00049		B	ADL	0.00129		BDL	0.00007	B	DLL	0.00064			
682	Fe	Calculated	mg/mg		ADL	0.00059	FB	B	BBL	0.00017		ADL	0.00011	B	DLL	0.00028			
683	Ga	Calculated	mg/mg		BDL	0.00000		BDL	0.00000		BDL	0.00000		BDL	0.00000				
684	Hf	Calculated	mg/mg		BDL	0.00001		BDL	0.00001		BDL	0.00001		BDL	0.00001				
685	Hg	Calculated	mg/mg		BDL	0.00002		BDL	0.00002		BDL	0.00000		BDL	0.00001				
686	In	Calculated	mg/mg		BDL	0.00000		BDL	0.00003		BDL	0.00000		BDL	0.00001				
687	Ir	Calculated	mg/mg		BDL	0.00000		BDL	0.00000		BDL	0.00000		BDL	0.00000				
688	K	Calculated	mg/mg		ADL	0.00039		ADL	0.00019		B	ADL	0.00007	B	ADL	0.00021			
689	La	Calculated	mg/mg	FB	B	BBL	0.00006	FB	ADL	0.00028		BDL	0.00001	FB	B	DLL	0.00012		
690	Mg	Calculated	mg/mg		BDL	0.00317		BDL	0.00022		BDL	0.00023		BDL	0.00113				
691	Mn	Calculated	mg/mg		BDL	0.00000		BDL	0.00000	FB	BBL	0.00009	FB		DLL	0.00003			
692	Mo	Calculated	mg/mg		BDL	0.00000		BDL	0.00000		BDL	0.00000		BDL	0.00000				
693	Na	Calculated	mg/mg		BDL	0.00166		BDL	0.00107		BDL	0.00163		BDL	0.00144				
694	Nb	Calculated	mg/mg		BDL	0.00001		BDL	0.00000		BDL	0.00001		BDL	0.00000				
695	Ni	Calculated	mg/mg	FB	ADL	0.00002		BDL	0.00000		BDL	0.00000	FB		DLL	0.00001			
696	Pb	Calculated	mg/mg	FB	B	ADL	0.00001	FB	ADL	0.00004	FB	B	BBL	0.00007	FB	B	DLL	0.00004	
697	Pd	Calculated	mg/mg		BDL	0.00000		BDL	0.00000		BDL	0.00000		BDL	0.00000				
698	P	Calculated	mg/mg		ADL	0.00090		ADL	0.00107		ADL	0.00157		ADL	0.00118				
699	Rb	Calculated	mg/mg		BDL	0.00000	FB	B	BBL	0.00002	FB	B	BBL	0.00002	FB	B	DLL	0.00001	
700	S	Calculated	mg/mg		ADL	0.02919		ADL	0.01456		ADL	0.01194		ADL	0.01819				
701	Sb	Calculated	mg/mg		BDL	0.00008	FB	B	ADL	0.00005	FB	B	ADL	0.00002	FB	B	DLL	0.00005	
702	Sc	Calculated	mg/mg		BDL	0.00043		BDL	0.00003		BDL	0.00032		BDL	0.00025				
703	Se	Calculated	mg/mg		BDL	0.00000		BDL	0.00001		BDL	0.00000		BDL	0.00001				
704	Si	Calculated	mg/mg	FB	B	ADL	0.00079	FB	ADL	0.00059		ADL	0.00250	FB	B	ADL	0.00129		
705	Sm	Calculated	mg/mg	FB	B	ADL	0.00017		BDL	0.00005		BDL	0.00004	FB	B	DLL	0.00008		
706	Sn	Calculated	mg/mg	FB	BBL	0.00011	FB	BBL	0.00012		BDL	0.00001	FB	B	DLL	0.00008			
707	Sr	Calculated	mg/mg		ADL	0.00002		ADL	0.00002		ADL	0.00003		B	ADL	0.00002			
708	Ta	Calculated	mg/mg		BDL	0.00001		BDL	0.00001		BDL	0.00001		BDL	0.00001				
709	Tb	Calculated	mg/mg		BDL	0.00003		BDL	0.00018		BDL	0.00003		BDL	0.00009				
710	Ti	Calculated	mg/mg		ADL	0.00031		ADL	0.00032	FB	ADL	0.00009		ADL	0.00024				
711	Tl	Calculated	mg/mg	FB	BBL	0.00002	FB	BBL	0.00002	FB	B	BBL	0.00001	FB	B	BBL	0.00002		
712	U	Calculated	mg/mg		BDL	0.00000		BBL	0.00007		BBL	0.00006		DLL	0.00004				
713	V	Calculated	mg/mg		BDL	0.00000		BDL	0.00000		BDL	0.00000		BDL	0.00000				
714	W	Calculated	mg/mg	FB	ADL	0.00021	FB	BBL	0.00033	FB	B	BBL	0.00009	FB	B	DLL	0.00021		
715	Y	Calculated	mg/mg		ADL	0.00002	FB	B	BBL	0.00001		BDL	0.00002	FB	B	DLL	0.00002		
716	Zn	Calculated	mg/mg		ADL	0.00173		ADL	0.00166		ADL	0.00109		ADL	0.00149				
717	Zr	Calculated	mg/mg		BDL	0.00003		BDL	0.00000		BDL	0.00001		BDL	0.00001				
718																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
719	Ions (Cl-, K+,Na+ as oxides)																		
720	NH4+	Calculated	mg/mg	BDL	0.00001			BDL	0.00001			BDL	0.00001			BDL	0.00001		
721	Cl-	Calculated	mg/mg	BDL	0.00003			BDL	0.00004			BDL	0.00003			BDL	0.00003		
722	NO3-	Calculated	mg/mg	# ADL	0.00329			# ADL	0.00460			# ADL	0.00183			# ADL	0.00328		
723	K+	Calculated	mg/mg	BDL	0.00073			BDL	0.00075			BDL	0.00066			BDL	0.00072		
724	Na+	Calculated	mg/mg	# ADL	0.00131			# ADL	0.00025			BDL	0.00003			# ADL	0.00050		
725	SO42-	Calculated	mg/mg	# ADL	0.01065			# ADL	0.01083			# ADL	0.00861			# ADL	0.01004		
726																			
727																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Alfa			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	<u>Value</u>				<u>Value</u>				<u>Value</u>				<u>Value</u>			
797	Results for 142-mm filter and recovery rinses (with dilution air blank correction)																		
798	Vds(std)'	Calculated	dscm	21.867				30.218				20.090							
799	mar,probe	Calculated	mg	FB	BDL	1.740	FB	BDL	1.880	FB	BDL	1.040	FB	BDL	1.553	FB	BDL	1.553	
800	mar,venturi-chamb	Calculated	mg	FB	BDL	2.170	FB	BDL	3.050	FB	BDL	2.790	FB	BDL	2.670	FB	BDL	2.670	
801	mwr,chamber	Calculated	mg	FB	BDL	0.430	FB	BDL	0.970	FB	BDL	0.070	FB	BDL	0.490	FB	BDL	0.490	
802	mf142mm	Calculated	mg	ADL 6.670				ADL 4.130				ADL 8.600				ADL 6.467			
803	Cpm,probe	Calculated	mg/dscm	FB	BDL	0.694	FB	BDL	0.750	FB	BDL	0.424	FB	BDL	0.623	FB	BDL	0.623	
804	Cpm,venturi-cham	Calculated	mg/dscm	FB	BDL	0.866	FB	BDL	1.218	FB	BDL	1.137	FB	BDL	1.073	FB	BDL	1.073	
805	Cpm,chamber	Calculated	mg/dscm	FB	BDL	0.172	FB	BDL	0.387	FB	BDL	0.029	FB	BDL	0.196	FB	BDL	0.196	
806	Cpm,142mmf	Calculated	mg/dscm	ADL 4.789				ADL 2.582				ADL 6.553				ADL 4.641			
807																			
808	Results for 142mm and 47mm filters with recovery rinses (with dilution air blank correction)																		
809	mf47q,est	Calculated	mg	estimated	0.701	estimated	0.610	estimated	0.746	estimated	0.686								
810	Cs,f+r,total	Calculated	mg/dscm	FB	DLL	4.939	FB	DLL	4.466	FB	DLL	5.681	FB	DLL	5.029	FB	DLL	5.029	
811	Es,f+r,total	Calculated	lb/MMBtu	FB	DLL	5.79E-03	FB	DLL	5.19E-03	FB	DLL	6.51E-03	FB	DLL	5.83E-03	FB	DLL	5.83E-03	
812	Es,f+r,total	Calculated	kg/GJ	FB	DLL	2.49E-03	FB	DLL	2.23E-03	FB	DLL	2.80E-03	FB	DLL	2.51E-03	FB	DLL	2.51E-03	
816																			
817	Results for 142mm and 47mm filters without recovery rinses (with dilution air blank correction)																		
818	Cs,f,total	Calculated	mg/dscm	ADL 3.21				ADL 2.11				ADL 4.09				ADL 3.14			
819	Es,f,total	Calculated	lb/MMBtu	ADL 3.76E-03				ADL 2.45E-03				ADL 4.69E-03				ADL 3.63E-03			
820	Es,f,total	Calculated	kg/GJ	ADL 1.62E-03				ADL 1.05E-03				ADL 2.02E-03				ADL 1.56E-03			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
3	k1	Calibration					0.8517				0.8517				0.8517				0.8517
4	n1	Calibration					0.5				0.5				0.5				0.5
5	k2	Calibration					10.545				10.545				10.545				10.545
6	n2	Calibration					0.5				0.5				0.5				0.5
7	Cdmfm1	Calibration					1.018				1.018				1.018				1.018
8	Csmfm1	Calibration					1.01				1.01				1.01				1.01
9	Csmfm2	Calibration					1.012				1.012				1.012				1.012
10	T1m	Measured	F				503.0072937				340.128112				326.7581944				389.9645334
11	T1	Calculated	R				963.0072937				800.128112				786.7581944				849.9645334
12	T2m	Measured	F				99.15396429				76.68254427				92.64943452				89.49531436
13	T2	Calculated	R				559.1539643				536.6825443				552.6494345				549.4953144
14	Stack T	Measured	F				884.0136091				928.1606406				942.4025357				918.1922618
15	Filter T	Measured	F				93.32527976				91.596				103.12				96.01375992
16	T3m	Measured	F				88.02492063				87.66473698		estir		99.12				91.6032192
17	T3	Calculated	R				548.0249206				547.664737				559.12				551.6032192
18	Pbar	Measured	in. Hg				26.5649127				26.3136875				26.07756746				26.31872255
19	Ps	Measured	iwc				-0.911251984				-0.957630208				-0.848501984				-0.905794726
20	Pst	Calculated	in. Hg				26.49790888				26.24327351				26.01517761				26.25212
21	Cyclone dP	Measured	iwc				-2.400680556				-2.470742188				-2.209071429				-2.360164724
22	P1	Calculated	in. Hg				26.32138825				26.06160129				25.85274589				26.07857848
23	Sample venturi dP	Measured	iwc				0.767597222				0.574338542				0.53828373				0.626739831
24	Dil venturi dP	Measured	iwc				0.405111111				1.469791667				1.229202381				1.03470172
25	P2	Calculated	in. Hg				26.3474916				26.12470286				25.90983173				26.12734206
26	Exhaust Vac	Measured	iwc				5.544498016				9.158914062				7.954144841				7.552518973
27	P3	Calculated	in. Hg				26.15722902				25.64023794				25.49270387				25.76339028
28	%O2	Measured	%vd				15.34				15.15				15.24				15.24333333
29	%CO2	Measured	%vd				3.94				3.94				3.98				3.95333333
30	Ms	Calculated	lb/lb-mole				29.244				29.2364				29.2464				29.24226667
31	Mws	Calculated	lb/lb-mole				28.31875712				27.92525726				28.54640638				28.26347358
32	Mwdil	Calculated	lb/lb-mole				28.9544123				28.9181686				28.89105169				28.92121087
33	Q1	Calculated	wacf/min				0.848157766				0.676785823				0.645184389				0.723375993
34	Q2	Calculated	wacf/min				5.746089036				10.77512053				10.04544485				8.855551472
35	RHdil	Measured	%				1.987734127				13.33089844				12.07700397				9.131878844
36	RH mix	Measured	%				16.36461508				18.21423698				12.96345437				15.84743547
37	Bwdil	Calculated	v/v				0.001420939				0.004724832				0.007196746				0.004447505
38	Bwds	Calculated	v/v				0.008359156				0.009384166				0.009567895				0.009103739
39	Qmix,std	Calculated	wacf/min				5.187169258				9.64512079				8.685188261				7.839159436
40	Bws	Calculated	v/v				0.082287698				0.116687083				0.062241573				0.087072118
41																			
42	PM2.5 Concentration																		
43	Run duration	Measured	minutes				237.9				178.4				238.4166667				218.2388889
44	mf47ds	Measured	mg		ADL		0.758		ADL		0.01		ADL		0.009		ADL		0.259
45	mf47dab	Measured	mg		ADL		0.011		ADL		0.008		ADL		0.007		ADL		0.008666667
46	mf47ds-stfb1	Measured	mg		ADL		0.008		ADL		0.008		ADL		0.008		ADL		0.008
47	mf47dab-stfb1	Measured	mg		ADL		0.004		ADL		0.004		ADL		0.004		ADL		0.004
48	mf47ds-stfb2	Measured	mg		ADL		0.008		ADL		0.008		ADL		0.008		ADL		0.008
49	mf47dab-stfb2	Measured	mg		ADL		0.006		ADL		0.006		ADL		0.006		ADL		0.006
50	qf47ds,tq	Calculated	wacm/min				0.036299911				0.036968315				0.03683153				0.036699918
51	Vf47ds,tq(std)	Calculated	dscm				8.563561256				6.533257365				8.69723246				7.93135036
52	qf47ds,q	Calculated	wacm/min				0.03641229				0.03712152				0.036965077				0.036832962
53	Vf47ds,q(std)	Calculated	dscm				8.590072758				6.560332703				8.728767721				7.959724394
54	qf47dab	Calculated	wacm/min				0.036975853				0.037224005				0.037200505				0.037133454
55	Vf47dab(std)	Calculated	dscm				8.784055957				6.609386022				8.805390958				8.066277646
57	Vdv(std)	Calculated	dscm				29.53558339				46.17583764				55.41314592				
58	Vd(std)	Calculated	dscm				20.75152743				39.56645162				46.60775496				37.64882117
59	Vs(std)	Calculated	dscm				2.479305741				1.747712896				2.100455274				2.10915797
60	Vds(std)	Calculated	dscm				23.23083317				41.31416452				48.70821024				37.75106931
61	DR	Calculated	v/v				9.369894479				23.63898819				23.18935844				18.73274704
62	Cpm2.5	Calculated	mg/dscm		ADL		0.818890885		FB B ADL		0.008780317		FB B ADL		0.006356805		ADL		0.278009336
64																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S				
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average							
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value							
65	PM2.5 Emission Factor																						
66	Fd	Input	dscf/MMBtu	8615				8615				8615				8615							
67	Epm2.5	Calculated	lb/MMBtu	ADL	0.00165551				FB B ADL	1.71642E-05				FB B ADL	1.26242E-05				0.000561766				
68	Epm2.5	Calculated	kg/GJ	ADL	0.000711712				FB B ADL	7.37896E-06				FB B ADL	5.42719E-06				0.000241506				
69																							
70	Stack gas flow rate																						
71	Qfuel(15C)	Input	lb/hr	estir	10045.61898				estir	10850.44241				10799				10565.02046					
72	HHV(15C)	Input	Btu/lb	21901				21687				21702				21763.33333							
73	Qstk,dry(25C)	Calculated	dscf/hr	7246295.944				7494269.258				7582581.392				7441048.865							
74				1263.346596				1364.561956				1358.09251											
75	PM2.5 Mass Flow Rate			75.94360703				82.02797022				81.63907213											
76	Mpm2.5	Calculated	lb/hr	ADL	370.4428329				FB B ADL	4.10788791				FB B ADL	3.009089341				ADL	125.85327			
77																							
78																							

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1			Run 2			Run 3			Average						
2	Parameter	Type	Units	Value			Value			Value			Value						
79	Species Lab Results - Samples																		
80	<u>Carbon</u>																		
81	OC	Measured	µg	ADL		387.11548	ADL		49.20986	ADL		57.29804	ADL		164.5411267				
82	EC	Measured	µg	ADL		24.90398	ADL		1.7841	BDL		0.763166667	DLL		9.150415556				
83	Total C	Measured	µg	ADL		412.01945	ADL		50.99396	ADL		57.29804	ADL		173.43715				
84	OC Backup	Measured	µg	ADL		81.57181	ADL		37.95779	ADL		47.93059	ADL		55.82006333				
85	EC Backup	Measured	µg	ADL		12.75143	ADL		0.28678	ADL		0.21856	ADL		4.418923333				
86	Total C Backup	Measured	µg	ADL		94.32324	ADL		38.24458	ADL		48.14915	ADL		60.23899				
87																			
88	<u>Elements</u>																		
89	Ag	Measured	µg	BDL		0.0334	BDL		0.0334	BDL		0.0334	BDL		0.0334	BDL		0.0334	
90	Al	Measured	µg	BDL		0.4573	BDL		0.4623	BDL		0.4615	BDL		0.460366667				
91	As	Measured	µg	BDL		0.0133	BDL		0.0133	BDL		0.0133	BDL		0.0133	BDL		0.0133	
92	Au	Measured	µg	BDL		0.0366	BDL		0.0366	BDL		0.0366	BDL		0.0366	BDL		0.0366	
93	Ba	Measured	µg	ADL		0.0419	BDL		0.1182	BDL		0.1175	DLL		0.092533333				
94	Br	Measured	µg	ADL		0.6851	ADL		0.0301	ADL		0.0018	ADL		0.239				
95	Ca	Measured	µg	ADL		0.0801	ADL		0.0083	BDL		0.0125	DLL		0.033633333				
96	Cd	Measured	µg	ADL		0.0436	BDL		0.0666	ADL		0.0507	DLL		0.053633333				
97	Ce	Measured	µg	BDL		0.4685	BDL		0.4668	ADL		0.1974	DLL		0.377566667				
98	Cl	Measured	µg	ADL		0.2433	ADL		0.0171	ADL		0.0277	ADL		0.096033333				
99	Co	Measured	µg	BDL		0.0034	BDL		0.0034	BDL		0.0034	BDL		0.0034	BDL		0.0034	
100	Cr	Measured	µg	ADL		0.0013	BDL		0.0133	ADL		0.0236	DLL		0.012733333				
101	Cs	Measured	µg	BDL		0.1683	BDL		0.1691	ADL		0.1343	DLL		0.157233333				
102	Cu	Measured	µg	ADL		0.0012	BDL		0.0116	BDL		0.0116	DLL		0.008133333				
103	Eu	Measured	µg	BDL		0.9813	ADL		0.0707	BDL		0.982	DLL		0.678				
104	Fe	Measured	µg	ADL		0.0825	ADL		0.0035	ADL		0.0848	ADL		0.056933333				
105	Ga	Measured	µg	BDL		0.0116	BDL		0.0116	BDL		0.0116	BDL		0.0116	BDL		0.0116	
106	Hf	Measured	µg	BDL		0.1666	BDL		0.1666	BDL		0.1666	BDL		0.1666	BDL		0.1666	
107	Hg	Measured	µg	ADL		0.0012	BDL		0.025	ADL		0.0024	DLL		0.009533333				
108	In	Measured	µg	ADL		0.0172	BDL		0.0317	BDL		0.0317	DLL		0.026866667				
109	Ir	Measured	µg	BDL		0.0366	BDL		0.0366	BDL		0.0366	BDL		0.0366	BDL		0.0366	
110	K	Measured	µg	ADL		0.1614	ADL		0.0236	BDL		0.0216	DLL		0.068866667				
111	La	Measured	µg	BDL		0.1974	BDL		0.1974	BDL		0.1974	BDL		0.1974	BDL		0.1974	
112	Mg	Measured	µg	BDL		1.8308	ADL		0.2009	BDL		1.8563	DLL		1.296				
113	Mn	Measured	µg	ADL		0.0048	ADL		0.0001	ADL		0.0201	ADL		0.008333333				
114	Mo	Measured	µg	BDL		0.0184	BDL		0.0184	BDL		0.0184	BDL		0.0184	BDL		0.0184	
115	Na	Measured	µg	BDL		7.1858	ADL		3.8757	BDL		7.6982	DLL		6.253233333				
116	Nb	Measured	µg	BDL		0.01	BDL		0.01	BDL		0.01	BDL		0.01	BDL		0.01	
117	Ni	Measured	µg	BDL		0.0066	ADL		0.0012	BDL		0.0066	DLL		0.0048				
118	Pb	Measured	µg	ADL		0.0236	BDL		0.0199	ADL		0.0165	DLL		0.02				
119	Pd	Measured	µg	BDL		0.06	BDL		0.06	BDL		0.06	BDL		0.06	BDL		0.06	
120	Ph	Measured	µg	ADL		2.4308	ADL		0.0383	ADL		0.0124	ADL		0.827166667				
121	Rb	Measured	µg	BDL		0.0034	BDL		0.0034	ADL		0.0024	DLL		0.003066667				
122	S	Measured	µg	BDL		0.0167	BDL		0.0167	BDL		0.0167	BDL		0.0167	BDL		0.0167	
123	Sb	Measured	µg	BDL		0.0833	BDL		0.0833	ADL		0.0536	DLL		0.0734				
124	Sc	Measured	µg	BDL		0.3569	BDL		0.3578	BDL		0.3569	BDL		0.3572	BDL		0.3572	
125	Se	Measured	µg	BDL		0.015	ADL		0.0089	BDL		0.015	DLL		0.012966667				
126	Si	Measured	µg	ADL		124.123	ADL		0.2928	ADL		0.0478	ADL		41.48786667				
127	Sm	Measured	µg	ADL		0.4477	ADL		0.0236	BDL		0.6648	DLL		0.3787				
128	Sn	Measured	µg	ADL		0.0578	BDL		0.06	BDL		0.06	DLL		0.059266667				
129	Sr	Measured	µg	ADL		0.0023	BDL		0.0116	BDL		0.0116	DLL		0.0085				
130	Ta	Measured	µg	BDL		0.1666	BDL		0.1666	BDL		0.1666	BDL		0.1666	BDL		0.1666	
131	Tb	Measured	µg	BDL		0.4857	ADL		0.1738	BDL		0.4748	DLL		0.3781				
132	Ti	Measured	µg	ADL		0.0054	ADL		0.0301	BDL		0.0083	DLL		0.0146				
133	Tl	Measured	µg	ADL		0.0054	ADL		0.0124	BDL		0.0133	DLL		0.010366667				
134	U	Measured	µg	BDL		0.0349	ADL		0.0095	ADL		0.0224	DLL		0.022266667				
135	V	Measured	µg	BDL		0.0034	ADL		0.0059	BDL		0.0034	DLL		0.004233333				
136	W	Measured	µg	BDL		0.1666	ADL		0.0071	ADL		0.0248	DLL		0.066166667				
137	Yt	Measured	µg	ADL		0.0272	BDL		0.0116	ADL		0.0083	DLL		0.0157				
138	Zn	Measured	µg	ADL		0.0035	BDL		0.0199	ADL		0.0023	DLL		0.008566667				
139	Zr	Measured	µg	BDL		0.015	ADL		0.0077	ADL		0.0112	DLL		0.0113				

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
141	Ions																		
142	NH4+	Measured	µg	BDL		0.0167		BDL		0.0167		BDL		0.0167		BDL		0.0167	
143	Cl-	Measured	µg	BDL		0.0167		BDL		0.0167		BDL		0.0167		BDL		0.0167	
144	NO3-	Measured	µg	ADL		0.419238725		ADL		0.100402133		ADL		0.250457916		ADL		0.256699591	
145	K+	Measured	µg	BDL		0.502022499		BDL		0.501172873		BDL		0.50115676		BDL		0.50145071	
146	Na+	Measured	µg	ADL		0.159182184		BDL		0.569839361		BDL		0.574558161		DLL		0.434526569	
147	SO42-	Measured	µg	BDL		0.0167		BDL		0.0167		BDL		0.0167		BDL		0.0167	
148																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick						Run 1				Run 2				Run 3				
2	Parameter	Type	Units				Value				Value				Value		Average Value		
149	Species Lab Results - Run Dilution Air																		
150	<u>Carbon</u>																		
151	OC	Measured	µg																
152	EC	Measured	µg																
153	Total C	Measured	µg																
154	OC Backup	Measured	µg	ADL		32.05789	ADL		32.67148	ADL		29.43353	ADL		31.38763333				
155	EC Backup	Measured	µg	ADL		12.75143	ADL		0.28678	ADL		0.21856	ADL		4.418923333				
156	Total C Backup	Measured	µg	ADL		94.32324	ADL		38.24458	ADL		48.14915	ADL		60.23899				
157																			
158	<u>Elements</u>																		
159	Ag	Measured	µg	BDL		0.0334	BDL		0.0334	BDL		0.0334	BDL		0.0334				
160	Al	Measured	µg	BDL		0.4623	ADL		0.202	BDL		0.4607	DLL		0.375				
161	As	Measured	µg	BDL		0.0133	BDL		0.0133	BDL		0.0133	BDL		0.0133				
162	Au	Measured	µg	ADL		0.0259	BDL		0.0366	ADL		0.0153	DLL		0.025933333				
163	Ba	Measured	µg	ADL		0.0666	BDL		0.1199	BDL		0.1175	DLL		0.101333333				
164	Br	Measured	µg	ADL		0.0124	ADL		0.0006	BDL		0.0116	DLL		0.0082				
165	Ca	Measured	µg	ADL		0.0165	BDL		0.0133	BDL		0.0133	DLL		0.014366667				
166	Cd	Measured	µg	BDL		0.0666	ADL		0.0153	BDL		0.0666	DLL		0.0495				
167	Ce	Measured	µg	ADL		0.4059	ADL		0.2916	BDL		0.4668	DLL		0.3881				
168	Cl	Measured	µg	ADL		0.228	ADL		0.0089	ADL		0.0324	ADL		0.089766667				
169	Co	Measured	µg	BDL		0.0034	BDL		0.0034	BDL		0.0034	BDL		0.0034				
170	Cr	Measured	µg	BDL		0.0133	ADL		0.0166	BDL		0.0133	DLL		0.0144				
171	Cs	Measured	µg	BDL		0.1699	BDL		0.1683	ADL		0.0023	DLL		0.1135				
172	Cu	Measured	µg	ADL		0.0024	ADL		0.0849	BDL		0.0116	DLL		0.032966667				
173	Eu	Measured	µg	ADL		0.0094	ADL		0.781	BDL		0.9804	DLL		0.590266667				
174	Fe	Measured	µg	ADL		0.0141	ADL		0.0024	ADL		0.0683	ADL		0.028266667				
175	Ga	Measured	µg	BDL		0.0116	BDL		0.0116	BDL		0.0116	BDL		0.0116				
176	Hf	Measured	µg	BDL		0.1666	BDL		0.1666	BDL		0.1666	BDL		0.1666				
177	Hg	Measured	µg	BDL		0.025	ADL		0.0059	BDL		0.025	DLL		0.018633333				
178	In	Measured	µg	BDL		0.0317	BDL		0.0317	BDL		0.0317	BDL		0.0317				
179	Ir	Measured	µg	BDL		0.0366	BDL		0.0366	BDL		0.0366	BDL		0.0366				
180	K	Measured	µg	ADL		0.0024	ADL		0.0118	ADL		0.0024	ADL		0.005533333				
181	La	Measured	µg	ADL		0.0613	ADL		0.1143	BDL		0.1991	DLL		0.1249				
182	Mg	Measured	µg	BDL		1.8612	ADL		1.7865	ADL		0.5083	DLL		1.385333333				
183	Mn	Measured	µg	BDL		0.0334	BDL		0.0334	BDL		0.0334	BDL		0.0334				
184	Mo	Measured	µg	BDL		0.0184	ADL		0.0041	BDL		0.0184	DLL		0.013633333				
185	Na	Measured	µg	BDL		7.4912	BDL		7.7062	BDL		7.4184	BDL		7.5386				
186	Nb	Measured	µg	ADL		0.0036	BDL		0.01	BDL		0.01	DLL		0.007866667				
187	Ni	Measured	µg	BDL		0.0066	BDL		0.0066	BDL		0.0066	BDL		0.0066				
188	Pb	Measured	µg	ADL		0.0377	ADL		0.0401	ADL		0.0094	ADL		0.029066667				
189	Pd	Measured	µg	BDL		0.06	ADL		0.0001	BDL		0.06	DLL		0.040033333				
190	Ph	Measured	µg	ADL		0.0135	BDL		0.0266	ADL		0.0218	DLL		0.020633333				
191	Rb	Measured	µg	ADL		0.0012	BDL		0.0034	ADL		0.0001	DLL		0.001566667				
192	S	Measured	µg	BDL		0.0167	BDL		0.0167	BDL		0.0167	BDL		0.0167				
193	Sb	Measured	µg	BDL		0.0833	ADL		0.0631	ADL		0.0631	DLL		0.069833333				
194	Sc	Measured	µg	BDL		0.3578	ADL		0.1391	BDL		0.3569	DLL		0.2846				
195	Se	Measured	µg	BDL		0.015	BDL		0.015	BDL		0.015	BDL		0.015				
196	Si	Measured	µg	ADL		0.4447	ADL		0.096	ADL		0.129	ADL		0.223233333				
197	Sm	Measured	µg	BDL		0.6597	BDL		0.6648	ADL		0.0083	DLL		0.444266667				
198	Sn	Measured	µg	BDL		0.06	ADL		0.0236	ADL		0.0201	DLL		0.034566667				
199	Sr	Measured	µg	ADL		0.0059	BDL		0.0116	ADL		0.0118	DLL		0.009766667				
200	Ta	Measured	µg	BDL		0.1666	BDL		0.1666	BDL		0.1666	BDL		0.1666				
201	Tb	Measured	µg	BDL		0.4731	BDL		0.4806	ADL		0.0183	DLL		0.324				
202	Ti	Measured	µg	ADL		0.0089	ADL		0.003	BDL		0.0083	DLL		0.006733333				
203	Tl	Measured	µg	BDL		0.0133	BDL		0.0133	BDL		0.0133	BDL		0.0133				
204	U	Measured	µg	BDL		0.0349	ADL		0.0071	BDL		0.0349	DLL		0.025633333				
205	V	Measured	µg	ADL		0.0094	ADL		0.0094	ADL		0.0024	ADL		0.007066667				
206	W	Measured	µg	ADL		0.0177	ADL		0.079	BDL		0.1666	DLL		0.087766667				
207	Yt	Measured	µg	ADL		0.0095	BDL		0.0116	ADL		0.0095	DLL		0.0102				
208	Zn	Measured	µg	ADL		0.0177	ADL		0.0235	BDL		0.0199	DLL		0.020366667				
209	Zr	Measured	µg	ADL		0.0042	BDL		0.015	ADL		0.0112	DLL		0.010133333				

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value			
211	Ions																		
212	NH4+	Measured	µg																
213	Cl-	Measured	µg																
214	NO3-	Measured	µg																
215	K+	Measured	µg																
216	Na+	Measured	µg																
217	SO42-	Measured	µg																
218																			
219																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick						Run 1				Run 2				Run 3				
2	Parameter	Type	Units				Value				Value				Value	Average Value			
220	Species Lab Results - STFB Samples																		
221	<u>Carbon</u>																		
222	OC	Measured	µg	ADL			8.04047	ADL			3.90335							DLL	5.97191
223	EC	Measured	µg	ADL			0.09622	BDL			0.763166667							DLL	0.429693333
224	Total C	Measured	µg	ADL			8.13669	ADL			3.90335							DLL	6.02002
225	OC Backup	Measured	µg	ADL			7.23388	ADL			6.96475							DLL	7.099315
226	EC Backup	Measured	µg	BDL			0.763166667	BDL			0.763166667							DLL	0.763166667
227	Total C Backup	Measured	µg	ADL			7.23388	ADL			6.96475							DLL	7.099315
229	<u>Elements</u>																		
230	Ag	Measured	µg	BDL			0.0334	BDL			0.0334							DLL	0.0334
231	Al	Measured	µg	BDL			0.4615	BDL			0.4615							DLL	0.4615
232	As	Measured	µg	BDL			0.0133	BDL			0.0133							DLL	0.0133
233	Au	Measured	µg	ADL			0.0177	ADL			0.0036							DLL	0.01065
234	Ba	Measured	µg	ADL			0.089	BDL			0.1175							DLL	0.10325
235	Br	Measured	µg	ADL			0.0207	ADL			0.0089							DLL	0.0148
236	Ca	Measured	µg	BDL			0.0133	BDL			0.0125							DLL	0.0129
237	Cd	Measured	µg	BDL			0.0666	ADL			0.0436							DLL	0.0551
238	Ce	Measured	µg	ADL			0.1432	BDL			0.4668							DLL	0.305
239	Cl	Measured	µg	ADL			0.0065	BDL			0.0116							DLL	0.00905
240	Co	Measured	µg	BDL			0.0034	BDL			0.0034							DLL	0.0034
241	Cr	Measured	µg	ADL			0.0048	ADL			0.0013							DLL	0.00305
242	Cs	Measured	µg	BDL			0.1674	ADL			0.033							DLL	0.1002
243	Cu	Measured	µg	BDL			0.0116	BDL			0.0116							DLL	0.0116
244	Eu	Measured	µg	BDL			0.9779	ADL			0.3416							DLL	0.65975
245	Fe	Measured	µg	ADL			0.0047	ADL			0.0212							DLL	0.01295
246	Ga	Measured	µg	BDL			0.0116	BDL			0.0116							DLL	0.0116
247	Hf	Measured	µg	BDL			0.1666	BDL			0.1666							DLL	0.1666
248	Hg	Measured	µg	BDL			0.025	BDL			0.025							DLL	0.025
249	In	Measured	µg	ADL			0.0289	ADL			0.0183							DLL	0.0236
250	Ir	Measured	µg	BDL			0.0366	BDL			0.0366							DLL	0.0366
251	K	Measured	µg	ADL			0.0012	BDL			0.0216							DLL	0.0114
252	La	Measured	µg	BDL			0.1966	ADL			0.132							DLL	0.1643
253	Mg	Measured	µg	BDL			1.8612	BDL			1.8605							DLL	1.86085
254	Mn	Measured	µg	BDL			0.0334	BDL			0.0334							DLL	0.0334
255	Mo	Measured	µg	ADL			0.0053	BDL			0.0184							DLL	0.01185
256	Na	Measured	µg	ADL			0.5408	BDL			7.5397							DLL	4.04025
257	Nb	Measured	µg	BDL			0.01	BDL			0.01							DLL	0.01
258	Ni	Measured	µg	BDL			0.0066	BDL			0.0066							DLL	0.0066
259	Pb	Measured	µg	ADL			0.0106	ADL			0.0224							DLL	0.0165
260	Pd	Measured	µg	BDL			0.06	BDL			0.06							DLL	0.06
261	Ph	Measured	µg	ADL			0.0265	ADL			0.0029							DLL	0.0147
262	Rb	Measured	µg	BDL			0.0034	ADL			0.0048							DLL	0.0041
263	S	Measured	µg	BDL			0.0167	BDL			0.0167							DLL	0.0167
264	Sb	Measured	µg	ADL			0.0548	BDL			0.0833							DLL	0.06905
265	Sc	Measured	µg	BDL			0.3569	BDL			0.3569							DLL	0.3569
266	Se	Measured	µg	BDL			0.015	BDL			0.015							DLL	0.015
267	Si	Measured	µg	ADL			0.1773	BDL			0.0512							DLL	0.11425
268	Sm	Measured	µg	BDL			0.6606	BDL			0.6597							DLL	0.66015
269	Sn	Measured	µg	ADL			0.059	ADL			0.0295							DLL	0.04425
270	Sr	Measured	µg	BDL			0.0116	BDL			0.0116							DLL	0.0116
271	Ta	Measured	µg	BDL			0.1666	BDL			0.1666							DLL	0.1666
272	Tb	Measured	µg	BDL			0.4764	BDL			0.4723							DLL	0.47435
273	Ti	Measured	µg	ADL			0.0325	ADL			0.0042							DLL	0.01835
274	Tl	Measured	µg	ADL			0.0113	BDL			0.0133							DLL	0.0123
275	U	Measured	µg	BDL			0.0349	BDL			0.0349							DLL	0.0349
276	V	Measured	µg	ADL			0.0012	BDL			0.0034							DLL	0.0023
277	W	Measured	µg	BDL			0.1666	BDL			0.1666							DLL	0.1666
278	Yt	Measured	µg	ADL			0.013	ADL			0.0012							DLL	0.0071
279	Zn	Measured	µg	ADL			0.0129	BDL			0.0199							DLL	0.0164
280	Zr	Measured	µg	ADL			0.0018	ADL			0.016							DLL	0.0089

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value			
282	Ions																		
283	NH4+	Measured	µg	BDL			0.0167	BDL			0.0167					DLL			0.0167
284	Cl-	Measured	µg	BDL			0.0167	BDL			0.0167					DLL			0.0167
285	NO3-	Measured	µg	ADL			0.088581817	ADL			0.159572873					DLL			0.124077345
286	K+	Measured	µg	BDL			0.501154035	BDL			0.501166498					DLL			0.501160267
287	Na+	Measured	µg	BDL			0.580636343	ADL			0.035211205					DLL			0.307923774
288	SO42-	Measured	µg	BDL			0.0167	BDL			0.0167					DLL			0.0167
289																			
290																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
291	Species Lab Results - STFB Dilution Air																		
292	<u>Carbon</u>																		
293	OC	Measured	µg																
294	EC	Measured	µg																
295	Total C	Measured	µg																
296	OC Backup	Measured	µg	ADL		8.16895	ADL		7.27283					DLL		7.72089			
297	EC Backup	Measured	µg	BDL		0.763166667	ADL		0.05896					DLL		0.411063333			
298	Total C Backup	Measured	µg	ADL		8.16895	ADL		7.3318					DLL		7.750375			
300	<u>Elements</u>																		
301	Ag	Measured	µg	BDL		0.0334	BDL		0.0334					DLL		0.0334			
302	Al	Measured	µg	BDL		0.4615	BDL		0.4623					DLL		0.4619			
303	As	Measured	µg	BDL		0.0133	BDL		0.0133					DLL		0.0133			
304	Au	Measured	µg	BDL		0.0366	BDL		0.0366					DLL		0.0366			
305	Ba	Measured	µg	BDL		0.1191	BDL		0.1182					DLL		0.11865			
306	Br	Measured	µg	ADL		0.0053	ADL		0.003					DLL		0.00415			
307	Ca	Measured	µg	BDL		0.0133	BDL		0.0125					DLL		0.0129			
308	Cd	Measured	µg	BDL		0.0666	BDL		0.0666					DLL		0.0666			
309	Ce	Measured	µg	ADL		0.2398	BDL		0.4668					DLL		0.3533			
310	Cl	Measured	µg	ADL		0.195	ADL		0.0195					DLL		0.10725			
311	Co	Measured	µg	BDL		0.0034	BDL		0.0034					DLL		0.0034			
312	Cr	Measured	µg	BDL		0.0133	BDL		0.0133					DLL		0.0133			
313	Cs	Measured	µg	ADL		0.0389	BDL		0.1683					DLL		0.1036			
314	Cu	Measured	µg	BDL		0.0116	ADL		0.0118					DLL		0.0117			
315	Eu	Measured	µg	BDL		0.9804	BDL		0.9796					DLL		0.98			
316	Fe	Measured	µg	ADL		0.0177	ADL		0.0766					DLL		0.04715			
317	Ga	Measured	µg	BDL		0.0116	BDL		0.0116					DLL		0.0116			
318	Hf	Measured	µg	BDL		0.1666	BDL		0.1666					DLL		0.1666			
319	Hg	Measured	µg	BDL		0.025	BDL		0.025					DLL		0.025			
320	In	Measured	µg	ADL		0.0042	ADL		0.0183					DLL		0.01125			
321	Ir	Measured	µg	BDL		0.0366	BDL		0.0366					DLL		0.0366			
322	K	Measured	µg	BDL		0.0216	BDL		0.0216					DLL		0.0216			
323	La	Measured	µg	BDL		0.1983	BDL		0.1974					DLL		0.19785			
324	Mg	Measured	µg	BDL		1.8513	BDL		1.8588					DLL		1.85505			
325	Mn	Measured	µg	ADL		0.0177	ADL		0.0071					DLL		0.0124			
326	Mo	Measured	µg	BDL		0.0184	BDL		0.0184					DLL		0.0184			
327	Na	Measured	µg	BDL		7.7524	BDL		7.8645					DLL		7.80845			
328	Nb	Measured	µg	BDL		0.01	BDL		0.01					DLL		0.01			
329	Ni	Measured	µg	BDL		0.0066	BDL		0.0066					DLL		0.0066			
330	Pb	Measured	µg	ADL		0.0212	ADL		0.0248					DLL		0.023			
331	Pd	Measured	µg	BDL		0.06	BDL		0.06					DLL		0.06			
332	Ph	Measured	µg	BDL		0.0266	BDL		0.0266					DLL		0.0266			
333	Rb	Measured	µg	ADL		0.0036	ADL		0.0024					DLL		0.003			
334	S	Measured	µg	BDL		0.0167	BDL		0.0167					DLL		0.0167			
335	Sb	Measured	µg	ADL		0.0466	ADL		0.0678					DLL		0.0572			
336	Sc	Measured	µg	BDL		0.3569	BDL		0.3569					DLL		0.3569			
337	Se	Measured	µg	BDL		0.015	ADL		0.0112					DLL		0.0131			
338	Si	Measured	µg	ADL		0.3046	ADL		0.0866					DLL		0.1956			
339	Sm	Measured	µg	BDL		0.6597	BDL		0.6581					DLL		0.6589			
340	Sn	Measured	µg	ADL		0.0425	ADL		0.0236					DLL		0.03305			
341	Sr	Measured	µg	BDL		0.0116	ADL		0.0035					DLL		0.00755			
342	Ta	Measured	µg	BDL		0.1666	BDL		0.1666					DLL		0.1666			
343	Tb	Measured	µg	BDL		0.4756	ADL		0.0784					DLL		0.277			
344	Ti	Measured	µg	ADL		0.0348	ADL		0.0018					DLL		0.0183			
345	Tl	Measured	µg	BDL		0.0133	ADL		0.0042					DLL		0.00875			
346	U	Measured	µg	BDL		0.0349	BDL		0.0349					DLL		0.0349			
347	V	Measured	µg	BDL		0.0034	BDL		0.0034					DLL		0.0034			
348	W	Measured	µg	ADL		0.0743	ADL		0.0189					DLL		0.0466			
349	Yt	Measured	µg	ADL		0.0001	ADL		0.0095					DLL		0.0048			
350	Zn	Measured	µg	ADL		0.0012	ADL		0.0071					DLL		0.00415			
351	Zr	Measured	µg	BDL		0.015	ADL		0.0148					DLL		0.0149			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value			
353	Ions																		
354	NH4+	Measured	µg																
355	Cl-	Measured	µg																
356	NO3-	Measured	µg																
357	K+	Measured	µg																
358	Na+	Measured	µg																
359	SO42-	Measured	µg																
360																			
361																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
362	Species Concentrations (with dilution air blank subtraction)																		
365	Carbon																		
366	OC	Calculated	mg/dscm	ADL			0.422258495	ADL			0.177318949	ADL			0.152221348	ADL			0.250599597
367	EC	Calculated	mg/dscm	ADL			0.027164807	FB	ADL		0.006428686	BDL			0.002027474	DLL			0.011873655
368	Total C	Calculated	mg/dscm	ADL			0.449423291	ADL			0.183747635	ADL			0.152221348	ADL			0.261797425
369	OC Backup	Calculated	mg/dscm	B	ADL		0.058430655	B	ADL		0.024865203	B	ADL		0.053163491	B	ADL		0.04548645
370	EC Backup	Calculated	mg/dscm	B	ADL		0.001758817	B	ADL		5.10592E-05	B	ADL		2.98738E-05	B	ADL		0.00061325
371	Total C Backup	Calculated	mg/dscm	B	ADL		0.013010096	B	ADL		0.00680918	B	ADL		0.00658125	B	ADL		0.008800175
373	Elements																		
374	Ag	Calculated	mg/dscm	BDL			4.71968E-06	BDL			6.4454E-06	BDL			4.887E-06	BDL			5.35069E-06
375	Al	Calculated	mg/dscm	BDL			5.98558E-05	BDL			0.000980813	BDL			6.95415E-05	BDL			0.00037007
376	As	Calculated	mg/dscm	BDL			1.87939E-06	BDL			2.56658E-06	BDL			1.94602E-06	BDL			2.13067E-06
377	Au	Calculated	mg/dscm	BDL			1.53674E-05	BDL			7.06292E-06	BDL			5.90307E-05	BDL			2.71537E-05
378	Ba	Calculated	mg/dscm	FB	B	BBL	6.34599E-05	BDL			0.000410691	BDL			1.71923E-05	FB	B	DLL	0.000163781
379	Br	Calculated	mg/dscm	ADL			0.000737793	FB	ADL		0.000106854	FB	BBL		2.92317E-05	DLL			0.000291293
380	Ca	Calculated	mg/dscm	B	ADL		7.19201E-05	BBL			4.55562E-05	BDL			3.35157E-05	B	DLL		5.03306E-05
381	Cd	Calculated	mg/dscm	FB	BBL		6.34599E-05	BDL			0.000188569	FB	BBL		0.00016783	FB	B	DLL	0.000139953
382	Ce	Calculated	mg/dscm	BDL			0.000125851	BDL			0.00069019	FB	BBL		0.001176324	FB	B	DLL	0.000664122
383	Cl	Calculated	mg/dscm	B	ADL		4.89588E-05	FB	B	ADL	3.13872E-05	FB	B	BBL	8.16472E-05	B	DLL		5.39977E-05
384	Co	Calculated	mg/dscm	BDL			4.80447E-07	BDL			6.56118E-07	BDL			4.97479E-07	BDL			5.44681E-07
385	Cr	Calculated	mg/dscm	FB	BBL		1.26729E-05	BDL			5.68596E-05	ADL			2.94088E-05	FB	B	DLL	3.29805E-05
386	Cs	Calculated	mg/dscm	BDL			2.22576E-05	BDL			3.53725E-05	FB	ADL		0.000352287	FB	B	DLL	0.000136639
387	Cu	Calculated	mg/dscm	B	BBL		2.28684E-06	BDL			0.000290806	BDL			1.69728E-06	B	DLL		9.82634E-05
388	Eu	Calculated	mg/dscm	BDL			0.001064741	FB	B	BBL	0.002675143	BDL			0.000147716	FB	B	DLL	0.001295866
389	Fe	Calculated	mg/dscm	ADL			7.68329E-05	FB	B	ADL	4.44322E-06	B	ADL		5.39873E-05	FB	B	ADL	4.50878E-05
390	Ga	Calculated	mg/dscm	BDL			1.63917E-06	BDL			2.23852E-06	BDL			1.69728E-06	BDL			1.85832E-06
391	Hf	Calculated	mg/dscm	BDL			2.35419E-05	BDL			3.21498E-05	BDL			2.43765E-05	BDL			2.66894E-05
392	Hg	Calculated	mg/dscm	BBL			2.38213E-05	BDL			7.02472E-05	BBL			6.29994E-05	B	DLL		5.23559E-05
393	In	Calculated	mg/dscm	FB	BBL		3.02054E-05	BDL			6.11734E-06	BDL			4.63826E-06	FB	DLL		1.36537E-05
394	Ir	Calculated	mg/dscm	BDL			5.17187E-06	BDL			7.06292E-06	BDL			5.35522E-06	BDL			5.86334E-06
395	K	Calculated	mg/dscm	ADL			0.00017431	FB	B	ADL	4.49725E-05	BDL			5.1544E-05	DLL			9.02756E-05
396	La	Calculated	mg/dscm	BDL			0.000157577	BDL			0.000322734	BDL			2.45991E-05	BDL			0.000168303
397	Mg	Calculated	mg/dscm	BDL			0.00022974	B	BBL		0.00611926	BDL			0.003668534	B	DLL		0.003339178
398	Mn	Calculated	mg/dscm	BBL			3.18252E-05	BBL			0.000114404	BBL			8.41671E-05	BBL			7.67989E-05
399	Mo	Calculated	mg/dscm	BDL			2.60006E-06	BDL			5.25322E-05	BDL			2.69224E-06	BDL			1.92748E-05
400	Na	Calculated	mg/dscm	BDL			0.007137996	FB	BBL		0.026395882	BDL			0.00183147	FB	DLL		0.011788449
401	Nb	Calculated	mg/dscm	BDL			7.51132E-06	BDL			1.92976E-06	BDL			1.46317E-06	BDL			3.63475E-06
402	Ni	Calculated	mg/dscm	BDL			9.32632E-07	BBL			2.26068E-05	BDL			9.65695E-07	DLL			8.16839E-06
403	Pb	Calculated	mg/dscm	FB	B	BBL	3.59225E-05	BDL			0.000137354	FB	B	ADL	2.03061E-05	FB	B	DLL	6.45274E-05
404	Pd	Calculated	mg/dscm	BDL			8.47847E-06	BDL			0.000216753	BDL			8.77905E-06	BDL			7.80034E-05
405	P	Calculated	mg/dscm	ADL			0.002646817	FB	ADL		4.74667E-05	FB	B	BBL	5.49354E-05	DLL			0.000916406
406	Rb	Calculated	mg/dscm	BDL			2.57672E-06	BDL			6.56118E-07	FB	ADL		6.1471E-06	FB	B	DLL	3.12665E-06
407	S	Calculated	mg/dscm	BDL			2.35984E-06	BDL			3.2227E-06	BDL			2.4435E-06	BDL			2.67535E-06
408	Sb	Calculated	mg/dscm	BDL			1.17709E-05	BDL			8.52655E-05	FB	B	BBL	0.00015901	FB	B	DLL	8.53489E-05
409	Sc	Calculated	mg/dscm	BDL			4.95752E-05	BDL			0.000818155	BDL			5.22207E-05	BDL			0.00030665
410	Se	Calculated	mg/dscm	BDL			2.11962E-06	BBL			5.13792E-05	BDL			2.19476E-06	DLL			1.85645E-05
411	Si	Calculated	mg/dscm	ADL			0.135386519	FB	B	ADL	0.000730598	FB	B	BBL	0.000325077	DLL			0.045480731
412	Sm	Calculated	mg/dscm	BBL			0.000628596	BBL			0.002277125	BDL			0.001751635	B	DLL		0.001552452
413	Sn	Calculated	mg/dscm	FB	BBL		5.7171E-05	BDL			0.000136259	BDL			0.000109326	FB	B	DLL	0.000100919
414	Sr	Calculated	mg/dscm	B	BBL		5.62182E-06	BDL			2.23852E-06	BDL			2.97357E-05	B	DLL		1.2532E-05
415	Ta	Calculated	mg/dscm	BDL			2.35419E-05	BDL			3.21498E-05	BDL			2.43765E-05	BDL			2.66894E-05
416	Tb	Calculated	mg/dscm	BDL			8.06391E-05	BBL			0.001646189	BDL			0.00121984	B	DLL		0.000982223
417	Ti	Calculated	mg/dscm	FB	B	BBL	8.48037E-06	FB	ADL		9.86336E-05	BDL			1.21443E-06	FB	B	DLL	3.61095E-05
418	Tl	Calculated	mg/dscm	FB	BBL		1.26729E-05	FB	BBL		4.55562E-05	BDL			1.94602E-06	FB	DLL		2.00584E-05
419	U	Calculated	mg/dscm	BDL			4.93164E-06	B	ADL		1.00539E-05	BBL			8.79471E-05	B	DLL		3.43109E-05
420	V	Calculated	mg/dscm	BDL			8.9568E-06	FB	B	BBL	3.21976E-05	BDL			3.01745E-06	FB	B	DLL	1.4724E-05
421	W	Calculated	mg/dscm	BDL			0.000165421	B	BBL		0.000270597	BBL			0.000419828	B	DLL		0.000285282
422	Y	Calculated	mg/dscm	FB	B	ADL	2.0709E-05	BDL			2.23852E-06	FB	B	BBL	2.39398E-05	FB	B	DLL	1.56291E-05
423	Zn	Calculated	mg/dscm	FB	B	BBL	1.68655E-05	BDL			8.0494E-05	FB	BBL		5.01475E-05	FB	B	DLL	4.9169E-05
424	Zr	Calculated	mg/dscm	BDL			1.24104E-05	FB	BBL		5.13792E-05	FB	B	ADL	1.63876E-06	FB	B	DLL	2.18094E-05

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value			
426	Ions																		
427	NH4+	Calculated	mg/dscm	BDL			1.82161E-05	BDL			6.01755E-05	BDL			4.43662E-05	BDL			4.09192E-05
428	Cl-	Calculated	mg/dscm	BDL			1.82161E-05	BDL			6.01755E-05	BDL			4.43662E-05	BDL			4.09192E-05
429	NO3-	Calculated	mg/dscm	FB #	ADL		0.000457298	FB #	ADL		0.000361781	FB #	ADL		0.000665381	FB #	ADL		0.00049482
430	K+	Calculated	mg/dscm	BDL			0.000547597	BDL			0.001805887	BDL			0.001331403	BDL			0.001228296
431	Na+	Calculated	mg/dscm	FB #	ADL		0.000173633	BDL			0.002053314	BDL			0.001526405	FB #	DLL		0.001251118
432	SO42-	Calculated	mg/dscm	BDL			1.82161E-05	BDL			6.01755E-05	BDL			4.43662E-05	BDL			4.09192E-05
433																			
434																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average				
2	Parameter	Type	Units	Value				Value				Value				Value				
435	Reconstructed Mass (applying oxide factors for elements and 1/2 RL for BDL, subtract OC Backup and dilution air blank)																			
436	OC	Calculated	mg/dscm	ADL			0.392934067	ADL			0.164650046	ADL			0.106982486	ADL			0.2215222	
437	EC	Calculated	mg/dscm	ADL			0.027164807	ADL			0.006428686	BDL			0.001013737	DLL			0.011535743	
438	Total C	Calculated	mg/dscm																	
439	OC Backup	Calculated	mg/dscm																	
440	EC Backup	Calculated	mg/dscm																	
441	Total C Backup	Calculated	mg/dscm																	
443	Elements																			
444	Ag	Calculated	mg/dscm	BDL			3.0597E-06	BDL			4.17846E-06	BDL			3.16817E-06	BDL			3.46878E-06	
445	Al	Calculated	mg/dscm	BDL			5.65305E-05	BDL			0.000926323	BDL			6.56781E-05	BDL			0.000349511	
446	As	Calculated	mg/dscm	BDL			1.4414E-06	BDL			1.96844E-06	BDL			1.4925E-06	BDL			1.63412E-06	
447	Au	Calculated	mg/dscm	BDL			8.61991E-06	BDL			3.96175E-06	BDL			3.31117E-05	BDL			1.52311E-05	
448	Ba	Calculated	mg/dscm	BBL			7.82459E-05	BDL			0.000253191	BDL			1.0599E-05	DLL			0.000114012	
449	Br	Calculated	mg/dscm	ADL			0.001033279	ADL			0.00014965	BBL			4.0939E-05	DLL			0.000407956	
450	Ca	Calculated	mg/dscm	ADL			0.000129341	BBL			8.19284E-05	BDL			3.01373E-05	DLL			8.0469E-05	
451	Cd	Calculated	mg/dscm	BBL			7.24933E-05	BDL			0.000107706	BBL			0.000191721	DLL			0.000123973	
452	Ce	Calculated	mg/dscm	BDL			7.72967E-05	BDL			0.000423909	BBL			0.001444975	DLL			0.000648727	
453	Cl	Calculated	mg/dscm	ADL			0.000126299	ADL			8.09692E-05	BBL			0.000210624	DLL			0.000139297	
454	Co	Calculated	mg/dscm	BDL			3.27187E-07	BDL			4.4682E-07	BDL			3.38786E-07	BDL			3.70931E-07	
455	Cr	Calculated	mg/dscm	BBL			2.43719E-05	BDL			5.46747E-05	ADL			5.65575E-05	DLL			4.52014E-05	
456	Cs	Calculated	mg/dscm	BDL			1.17986E-05	BDL			1.87508E-05	ADL			0.000373492	DLL			0.00013468	
457	Cu	Calculated	mg/dscm	BBL			2.86264E-06	BDL			0.000182014	BDL			1.06232E-06	DLL			6.19795E-05	
458	Eu	Calculated	mg/dscm	BDL			0.000616449	BBL			0.003097634	BDL			8.55224E-05	DLL			0.001266535	
459	Fe	Calculated	mg/dscm	ADL			0.000109851	ADL			6.35268E-06	ADL			7.71881E-05	ADL			6.44641E-05	
460	Ga	Calculated	mg/dscm	BDL			1.10171E-06	BDL			1.50455E-06	BDL			1.14077E-06	BDL			1.24901E-06	
461	Hf	Calculated	mg/dscm	BDL			1.38813E-05	BDL			1.89568E-05	BDL			1.43734E-05	BDL			1.57372E-05	
462	Hg	Calculated	mg/dscm	BBL			2.57214E-05	BDL			3.79252E-05	BBL			6.80245E-05	DLL			4.38904E-05	
463	In	Calculated	mg/dscm	BBL			3.6519E-05	BDL			3.698E-06	BDL			2.80388E-06	DLL			1.43403E-05	
464	Ir	Calculated	mg/dscm	BDL			3.01644E-06	BDL			4.11937E-06	BDL			3.12337E-06	BDL			3.41973E-06	
465	K	Calculated	mg/dscm	ADL			0.000316976	ADL			8.17806E-05	BDL			4.68652E-05	DLL			0.000148541	
466	La	Calculated	mg/dscm	BDL			9.24022E-05	BDL			0.000189249	BDL			1.44247E-05	BDL			9.8692E-05	
467	Mg	Calculated	mg/dscm	BDL			0.000266108	BBL			0.014175887	BDL			0.004249266	DLL			0.00623042	
468	Mn	Calculated	mg/dscm	BBL			6.42656E-05	BBL			0.00023102	BBL			0.000169961	BBL			0.000155082	
469	Mo	Calculated	mg/dscm	BDL			1.95046E-06	BDL			3.94074E-05	BDL			2.0196E-06	BDL			1.44592E-05	
470	Na	Calculated	mg/dscm	BDL			0.008536936	BBL			0.063138159	BDL			0.00219041	DLL			0.024621835	
471	Nb	Calculated	mg/dscm	BDL			5.37256E-06	BDL			1.38028E-06	BDL			1.04655E-06	BDL			2.5998E-06	
472	Ni	Calculated	mg/dscm	BDL			6.56973E-07	BBL			3.18498E-05	BDL			6.80264E-07	DLL			1.10624E-05	
473	Pb	Calculated	mg/dscm	BBL			4.14703E-05	BDL			7.92833E-05	ADL			2.34421E-05	DLL			4.80653E-05	
474	Pd	Calculated	mg/dscm	BDL			5.51419E-06	BDL			0.000140971	BDL			5.70968E-06	BDL			5.07315E-05	
475	P	Calculated	mg/dscm	ADL			0.006065043	ADL			0.000108768	BBL			0.000125882	DLL			0.002099897	
476	Rb	Calculated	mg/dscm	BDL			1.77073E-06	BDL			4.50888E-07	ADL			8.44864E-06	DLL			3.55675E-06	
477	S	Calculated	mg/dscm	BDL			3.53535E-06	BDL			4.82802E-06	BDL			3.66068E-06	BDL			4.00801E-06	
478	Sb	Calculated	mg/dscm	BDL			7.8191E-06	BDL			5.66394E-05	BBL			0.000211252	DLL			9.19035E-05	
479	Sc	Calculated	mg/dscm	BDL			3.80194E-05	BDL			0.000627446	BDL			4.00482E-05	BDL			0.000235171	
480	Se	Calculated	mg/dscm	BDL			1.70407E-06	BBL			8.26127E-05	BDL			1.76448E-06	DLL			2.86938E-05	
481	Si	Calculated	mg/dscm	Run 1 silicon excluded - probable contamination												0.000695455				0.001129233
482	Sm	Calculated	mg/dscm	BBL			0.00072893	BBL			0.002640593	BDL			0.001015613	DLL			0.001461712	
483	Sn	Calculated	mg/dscm	BBL			7.25849E-05	BDL			8.64977E-05	BDL			6.94007E-05	DLL			7.61611E-05	
484	Sr	Calculated	mg/dscm	BBL			7.67498E-06	BDL			1.52803E-06	BDL			2.02978E-05	DLL			9.8336E-06	
485	Ta	Calculated	mg/dscm	BDL			1.4373E-05	BDL			1.96283E-05	BDL			1.48825E-05	BDL			1.62946E-05	
486	Tb	Calculated	mg/dscm	BDL			4.74232E-05	BBL			0.001936221	BDL			0.000717378	DLL			0.000900341	
487	Ti	Calculated	mg/dscm	BBL			1.41458E-05	ADL			0.000164527	BDL			1.01287E-06	DLL			5.98951E-05	
488	Tl	Calculated	mg/dscm	BBL			1.41611E-05	BBL			5.09061E-05	BDL			1.08728E-06	DLL			2.20515E-05	
489	U	Calculated	mg/dscm	BDL			2.96307E-06	ADL			1.20814E-05	BBL			0.000105682	DLL			4.02422E-05	
490	V	Calculated	mg/dscm	BDL			7.99501E-06	BBL			5.74804E-05	BDL			2.69344E-06	DLL			2.27229E-05	
491	W	Calculated	mg/dscm	BDL			0.000104306	BBL			0.000341249	BBL			0.000529443	DLL			0.000324999	
492	Y	Calculated	mg/dscm	ADL			2.62994E-05	BDL			1.4214E-06	BBL			3.04022E-05	DLL			1.93743E-05	
493	Zn	Calculated	mg/dscm	BBL			2.51202E-05	BDL			5.99458E-05	BBL			7.4692E-05	DLL			5.32527E-05	
494	Zr	Calculated	mg/dscm	BDL			8.38199E-06	BBL			6.9403E-05	ADL			2.21363E-06	DLL			2.6662E-05	

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
496	Ions																		
497	NH4+	Calculated	mg/dscm	BDL		9.10803E-06		BDL		3.00877E-05		BDL		2.21831E-05		BDL		2.04596E-05	
498	Cl-	Calculated	mg/dscm	BDL		2.34959E-05		BDL		7.7617E-05		BDL		5.72255E-05		BDL		5.27795E-05	
499	NO3-	Calculated	mg/dscm	ADL		0.000457298		ADL		0.000361781		ADL		0.000665381		ADL		0.00049482	
500	K+	Calculated	mg/dscm	BDL		0.000497891		BDL		0.001641963		BDL		0.001210549		BDL		0.001116801	
501	Na+	Calculated	mg/dscm	ADL		0.000415325		BDL		0.002455733		BDL		0.001825558		DLL		0.001565539	
502	SO42-	Calculated	mg/dscm	BDL		1.51763E-05		BDL		5.01337E-05		BDL		3.69626E-05		BDL		3.40908E-05	
503																			
504	Reconstructed mas	Calculated	mg/dscm	DLL		0.439714245		DLL		0.264530174		DLL		0.12297198		DLL		0.27611521	
505	Species mass closure		%			0.536963169				30.12763333				19.34493419				0.993186828	
506																			
507	Reconstructed mass (w/o Run 1 Si)	Calculated	mg/dscm	DLL		0.439714245	FB	DLL		0.264530174	FB	DLL		0.12297198	FB	DLL		0.275738799	
508	Reconstructed mass (w/o Run 1 Si)	Calculated	lb/MMBtu	DLL		0.000888948	FB	DLL		0.000517116	FB	DLL		0.000244214	FB	DLL		0.000550093	
509	Reconstructed mass (w/o Run 1 Si)	Calculated	kg/GJ	DLL		0.000382163	FB	DLL		0.000222311	FB	DLL		0.000104989	FB	DLL		2.36E-04	

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	Parameter	Type	Units	Value				Value				Value				Value			
658	Species Profile (fraction of sum of species, with dilution air blank)																		
659	OC	Calculated	mg/mg	0	ADL	0.893612322	0	ADL	0.622424442	0	ADL	0.86997449	0	ADL	0.802281769				
660	EC	Calculated	mg/mg	0	ADL	0.061778318	FB	0	ADL	0.024302279	0	BDL	0.00824364	0	DLL	0.041778731			
661	Total C	Calculated	mg/mg																
662	OC Backup	Calculated	mg/mg																
663	EC Backup	Calculated	mg/mg																
664	Total C Backup	Calculated	mg/mg																
665																			
666	Elements (as oxides)																		
667	Ag	Calculated	mg/mg	BDL		6.95839E-06	BDL		1.57958E-05	BDL		2.57634E-05	BDL		1.25628E-05				
668	Al	Calculated	mg/mg	BDL		0.000128562	BDL		0.003501768	BDL		0.00053409	BDL		0.001265814				
669	As	Calculated	mg/mg	BDL		3.27805E-06	BDL		7.44128E-06	BDL		1.21369E-05	BDL		5.91824E-06				
670	Au	Calculated	mg/mg	BDL		1.96034E-05	BDL		1.49766E-05	BDL		0.000269262	BDL		5.51621E-05				
671	Ba	Calculated	mg/mg	FB	B	BBL	0.000177947	BDL	0.000957133	BDL		8.61907E-05	FB	B	DLL	0.000412914			
672	Br	Calculated	mg/mg	ADL		0.002349888	FB	ADL	0.000565718	FB	B	BBL	0.000332913	DLL	0.001477484				
673	Ca	Calculated	mg/mg	B	ADL	0.000294148	BBL	0.000309713	BDL	0.000245075	B	DLL	0.000291433						
674	Cd	Calculated	mg/mg	FB	B	BBL	0.000164865	BDL	0.000407159	FB	B	BBL	0.00155906	FB	B	DLL	0.000448991		
675	Ce	Calculated	mg/mg	BDL		0.000175788	BDL		0.001602496	FB	B	BBL	0.011750445	FB	B	DLL	0.002349479		
676	Cl	Calculated	mg/mg	B	ADL	0.000287229	FB	B	ADL	0.000306087	FB	B	BBL	0.001712783	B	DLL	0.00050449		
677	Co	Calculated	mg/mg	BDL		7.4409E-07	BDL		1.68911E-06	BDL		2.75499E-06	BDL		1.34339E-06				
678	Cr	Calculated	mg/mg	FB	B	BBL	5.54267E-05	BDL	0.000206686	ADL	0.000459922	FB	B	DLL	0.000163705				
679	Cs	Calculated	mg/mg	BDL		2.68325E-05	BDL		7.08834E-05	FB	ADL	0.003037209	FB	B	DLL	0.000487769			
680	Cu	Calculated	mg/mg	B	BBL	6.51022E-06	BDL	0.000688063	BDL	8.63869E-06	B	DLL	0.00022447						
681	Eu	Calculated	mg/mg	BDL		0.001401931	FB	B	BBL	0.011709944	BDL	0.000695462	FB	B	DLL	0.00458698			
682	Fe	Calculated	mg/mg	ADL		0.000249825	FB	B	ADL	2.40149E-05	B	ADL	0.000627688	FB	B	ADL	0.000233468		
683	Ga	Calculated	mg/mg	BDL		2.50552E-06	BDL		5.68763E-06	BDL		9.27668E-06	BDL		4.52352E-06				
684	Hf	Calculated	mg/mg	BDL		3.15688E-05	BDL		7.16623E-05	BDL		0.000116883	BDL		5.69949E-05				
685	Hg	Calculated	mg/mg	BBL		5.84956E-05	BDL		0.000143368	BBL		0.000553171	B	DLL	0.000158957				
686	In	Calculated	mg/mg	FB	B	BBL	8.30516E-05	BDL	1.39795E-05	BDL		2.2801E-05	FB	DLL	5.19359E-05				
687	Ir	Calculated	mg/mg	BDL		6.85999E-06	BDL		1.55724E-05	BDL		2.53991E-05	BDL		1.23851E-05				
688	K	Calculated	mg/mg	ADL		0.000720868	FB	B	ADL	0.000309154	BDL	0.000381105	DLL	0.000537966					
689	La	Calculated	mg/mg	BDL		0.000210141	BDL		0.000715416	BDL		0.000117301	BDL		0.00035743				
690	Mg	Calculated	mg/mg	BDL		0.000605183	B	BBL	0.053588924	BDL		0.034554751	B	DLL	0.022564568				
691	Mn	Calculated	mg/mg	BBL		0.000146153	BBL		0.000873322	BBL		0.001382114	BBL		0.000561658				
692	Mo	Calculated	mg/mg	BDL		4.43573E-06	BDL		0.000148971	BDL		1.64233E-05	BDL		5.23664E-05				
693	Na	Calculated	mg/mg	BDL		0.019414736	FB	B	BBL	0.238680367	BDL	0.017812271	FB	DLL	0.089172324				
694	Nb	Calculated	mg/mg	BDL		1.22183E-05	BDL		5.21787E-06	BDL		8.5105E-06	BDL		9.41564E-06				
695	Ni	Calculated	mg/mg	BDL		1.49409E-06	BBL		0.000120402	BDL		5.53186E-06	DLL		4.00643E-05				
696	Pb	Calculated	mg/mg	FB	B	BBL	9.4312E-05	BDL	0.000299714	FB	B	ADL	0.00019063	FB	B	DLL	0.000174077		
697	Pd	Calculated	mg/mg	BDL		1.25404E-05	BDL		0.00053291	BDL		4.64307E-05	BDL		0.000183733				
698	P	Calculated	mg/mg	ADL		0.013793146	FB	ADL	0.000411173	FB	B	BBL	0.001023661	DLL	0.007605149				
699	Rb	Calculated	mg/mg	BDL		4.02701E-06	BDL		1.70449E-06	FB	ADL	6.87038E-05	FB	B	DLL	1.28814E-05			
700	S	Calculated	mg/mg	BDL		8.0401E-06	BDL		1.82513E-05	BDL		2.97684E-05	BDL		1.45157E-05				
701	Sb	Calculated	mg/mg	BDL		1.77822E-05	BDL		0.000214113	FB	B	BBL	0.001717887	FB	B	DLL	0.000332845		
702	Sc	Calculated	mg/mg	BDL		8.64639E-05	BDL		0.002371928	BDL		0.00032567	BDL		0.000851715				
703	Se	Calculated	mg/mg	BDL		3.8754E-06	BBL		0.0003123	BDL		1.43486E-05	DLL		0.00010392				
704	Si	Calculated	mg/mg	ADL		0	FB	B	ADL	0.00590863	FB	B	BBL	0.005655396	DLL	0.004089717			
705	Sm	Calculated	mg/mg	BBL		0.001657736	BBL		0.009982199	BDL		0.008258896	B	DLL	0.005293848				
706	Sn	Calculated	mg/mg	FB	B	BBL	0.000165073	BDL	0.000326986	BDL		0.000564362	FB	B	DLL	0.000275831			
707	Sr	Calculated	mg/mg	B	BBL	1.74545E-05	BDL		5.77639E-06	BDL		0.00016506	B	DLL	3.56141E-05				
708	Ta	Calculated	mg/mg	BDL		3.26871E-05	BDL		7.42008E-05	BDL		0.000121024	BDL		5.90138E-05				
709	Tb	Calculated	mg/mg	BDL		0.00010785	BBL		0.00731947	BDL		0.005833669	B	DLL	0.003260742				
710	Ti	Calculated	mg/mg	FB	B	BBL	3.21703E-05	FB	ADL	0.000621958	BDL	8.23662E-06	FB	B	DLL	0.000216921			
711	Tl	Calculated	mg/mg	FB	B	BBL	3.22053E-05	FB	B	BBL	0.00019244	BDL	8.84165E-06	FB	DLL	7.98634E-05			
712	U	Calculated	mg/mg	BDL		6.73862E-06	B	ADL	4.5671E-05	BBL		0.0008594	B	DLL	0.000145744				
713	V	Calculated	mg/mg	BDL		1.81823E-05	FB	B	BBL	0.000217292	BDL	2.19028E-05	FB	B	DLL	8.22952E-05			
714	W	Calculated	mg/mg	BDL		0.000237214	B	BBL	0.001290019	BBL		0.004305398	B	DLL	0.001177043				
715	Y	Calculated	mg/mg	FB	B	ADL	5.98102E-05	BDL	5.37331E-06	FB	B	BBL	0.000247229	FB	B	DLL	7.01676E-05		
716	Zn	Calculated	mg/mg	FB	B	BBL	5.71285E-05	BDL	0.000226612	FB	B	BBL	0.00060739	FB	B	DLL	0.000192864		
717	Zr	Calculated	mg/mg	BDL		1.90624E-05	FB	B	BBL	0.000262363	FB	B	ADL	1.80011E-05	FB	B	DLL	9.65764E-05	
718																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value			
719	Ions (Cl-, K+,Na+ as oxides)																		
720	NH4+	Calculated	mg/mg	BDL			2.07135E-05	BDL			0.00011374	BDL			0.000180392	BDL			7.40981E-05
721	Cl-	Calculated	mg/mg	BDL			5.34344E-05	BDL			0.000293415	BDL			0.000465354	BDL			0.00019115
722	NO3-	Calculated	mg/mg	FB #	ADL		0.001039989	FB #	ADL		0.001367637	FB #	ADL		0.005410836	FB #	ADL		0.001792078
723	K+	Calculated	mg/mg	BDL			0.001132305	BDL			0.006207092	BDL			0.009844101	BDL			0.004044691
724	Na+	Calculated	mg/mg	FB #	ADL		0.000944534	BDL			0.009283377	BDL			0.014845314	FB #	DLL		0.005669875
725	SO42-	Calculated	mg/mg	BDL			3.45139E-05	BDL			0.00018952	BDL			0.000300577	BDL			0.000123466
726																			
727																			

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
1	Modified CTM 39, Site Buick			Run 1				Run 2				Run 3				Average			
2	<u>Parameter</u>	<u>Type</u>	<u>Units</u>	Value				Value				Value				Value			
797	Results for 142-mm filter and recovery rinses (with dilution air blank correction)																		
798	Vds(std)'	Calculated	dscm	6.077199158				28.22057445				31.28221005				21.85999455			
799	mar,probe	Calculated	mg	FB	BDL	0.31	FB	BDL	0.56	FB	BDL	0.55	FB	BDL	0.55	0.473333333			
800	mar,venturi	Calculated	mg	FB	BDL	1.07	FB	BDL	2.55	FB	BDL	1.6	1.74						
801	mwr,chamber	Calculated	mg	FB	BDL	1.77	FB	BDL	1.53	FB	BDL	0.7	1.333333333						
802	mf142mm	Calculated	mg	no fi		0	no fi		0	no fi		0	no fi		0	no fi 0			
803	Cs,probe	Calculated	mg/dscm	FB	BDL	0.125035003	FB	BDL	0.320418761	FB	BDL	0.261847994	0.235767252						
804	Cs,venturi	Calculated	mg/dscm	FB	BDL	0.431572429	FB	BDL	1.459049713	FB	BDL	0.761739619	0.884120587						
805	Cs,chamber	Calculated	mg/dscm	FB	BDL	0.713909532	FB	BDL	0.875429828	FB	BDL	0.333261083	0.640866814						
806	Cs,142mmf	Calculated	mg/dscm	no fi		-0.010481358	no fi		-0.027402228	no fi		-0.01763982	no fi -0.018507802						
807																			
808	Results for 142mm and 47mm filters with recovery rinses (with dilution air blank correction)																		
809	mf47q,est	Calculated	mg	0.760346654				0.010041442				0.009032633				0.25980691			
810	Cs,f+r,total	Calculated	mg/dscm	FB	DLL	1.872443598	FB	DLL	2.638963313	FB	DLL	1.347793984	FB	DLL	1.953066965	1.953066965			
811	Es,f+r,total	Calculated	lb/MMBtu	FB	DLL	0.003785425	FB	DLL	0.00515877	FB	DLL	0.002676626	FB	DLL	0.003873607	0.003873607			
812	Es,f+r,total	Calculated	kg/GJ	FB	DLL	0.001627372	FB	DLL	0.002217779	FB	DLL	0.001150694	FB	DLL	0.001665282	0.001665282			
816																			
817	Results for 142mm and 47mm filters without recovery rinses (with dilution air blank correction)																		
818	Cs,f,total	Calculated	mg/dscm	0.601926635				-0.015934989				-0.009054713				0.192312311			
819	Es,f,total	Calculated	lb/MMBtu	0.001216885				-3.11505E-05				-1.7982E-05				0.000389251			
820	Es,f,total	Calculated	kg/GJ	0.000523144				-1.33917E-05				-7.73056E-06				0.000167341			

APPENDIX B
U.S. EPA AP-42 EMISSION FACTOR DATA
SUMMARIES

Parameter	Units	Value	Value	Value (1)	Value (2)
Data set		fPM	cPM	f+cPM	f+cPM
Number of units tested		5	5	5	5
Mean	kg/GJ	8.16E-04	2.03E-03	2.84E-03	2.84E-03
Median	kg/GJ	6.12E-04	2.22E-03		3.61E-03
Geometric mean	kg/GJ	7.46E-04	1.19E-03		2.18E-03
Minimum	kg/GJ	4.93E-04	2.54E-04	7.47E-04	7.47E-04
Maximum	kg/GJ	1.44E-03	4.70E-03	6.14E-03	5.23E-03
Standard deviation	kg/GJ	4.04E-04	1.84E-03	1.88E-03	1.93E-03
COV	%	50	91	91	68
Confidence level	%	95%	95%		95%
Measurement bias	%	6.5	6.5		6.5
t factor (2 tail)		2.78	2.78		2.78
t factor (1 tail)		1.53	1.53		1.53
Total uncertainty	%	62	113	129	85
Total uncertainty	kg/GJ	5.05E-04	2.28E-03	2.34E-03	2.40E-03
95% confidence upper bound	kg/GJ	1.10E-03	3.29E-03		4.18E-03
Data distribution		normal	normal		normal
99% confidence upper prediction limit	kg/GJ	2.48E-03	9.56E-03		1.08E-02

(1) by combining fPM + cPM factors


(2) by combining fPM+cPM unit average results

AP-42 Data Gas Turbines
Unit averages

FacilityID	UnitID	Make	Model	Rating (MW)	Fuel	Controls	Pollutant	Run ID	Test Date	Test Method	Test Run	Test Run Emission	In (Run Value)
											Emission Value	Value	
											lb/MMBtu	kg/GJ	
WDNR Fon du Lac	WDNR0098-1	ABB	GT11N1	86	natural gas	Water injection	fPM	Average	4/18/1994	EPA 5	0.001423911	0.0006121461573	-7.398539485
WDNR Fon du Lac	WDNR0098-2	ABB	GT11N1	86	natural gas	Water injection	fPM	Average	4/18/1994	EPA 5	0.001146864	0.0004930419774	-7.614916241
WDNR Fon du Lac	WDNR0099-1	ABB	GT11N1	86	natural gas	Water injection	fPM	Average	6/12/1994	EPA 5	0.002332621	0.0010028046025	-6.904954602
WDNR Fon du Lac	WDNR0099-2	ABB	GT11N1	86	natural gas	Water injection	fPM	Average	6/12/1994	EPA 5	0.003352109	0.0014410874203	-6.542357297
WDNR Fon du Lac	WDNR0102-1	ABB	GT11N1	86	natural gas	Water injection	fPM	Average	4/16/1996	EPA 5	0.001230803	0.0005291278058	-7.544280556

x

Unit Averages, AP-42, Gas Turbines, Natural gas

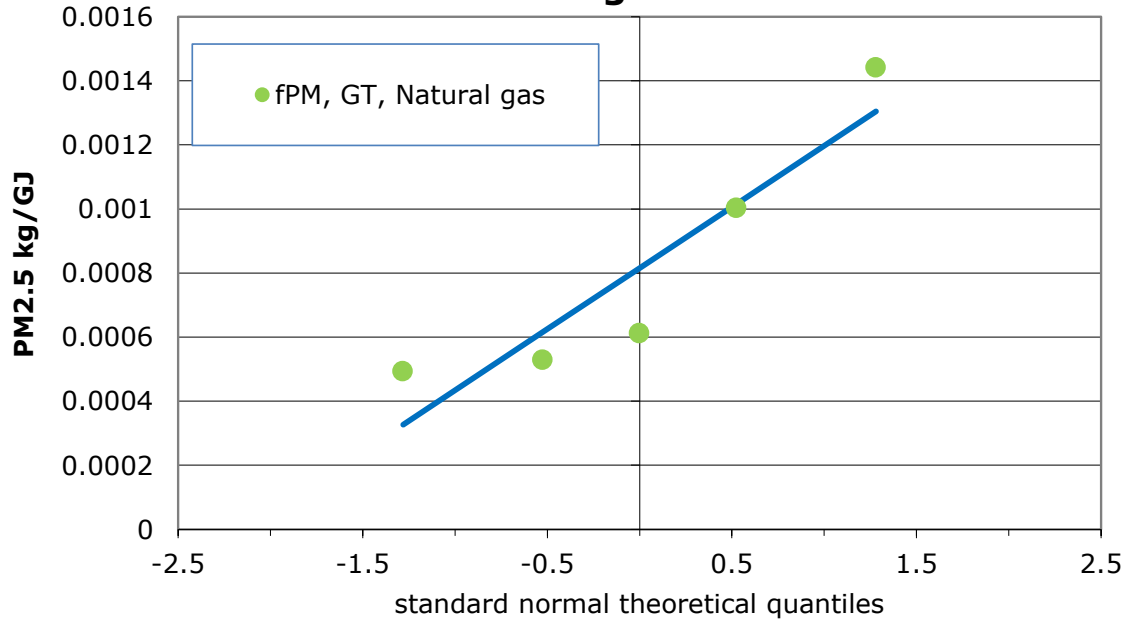

<u>Raw Statistics</u>	
Number of Valid Observations	5
Number of Distinct Observations	5
Minimum	4.93E-04
Maximum	1.44E-03
Mean of Raw Data	8.16E-04
Standard Deviation of Raw Data	4.04E-04
Khat	5.75
Theta hat	1.42E-04
Kstar	2.433
Theta star	3.35E-04
Mean of Log Transformed Data	-7.201
Standard Deviation of Log Transformed Data	0.461
<u>Normal GOF Test Results</u>	
Correlation Coefficient R	0.925
Shapiro Wilk Test Statistic	0.848
Shapiro Wilk Critical (0.05) Value	0.762
Approximate Shapiro Wilk P Value	N/A
Lilliefors Test Statistic	0.293
Lilliefors Critical (0.05) Value	0.396
Data appear Normal at (0.05) Significance Level	


AP-42 Data Gas Turbines

Unit averages

FacilityID	UnitID	Make	Model	Rating (MW)	Fuel	Controls	Pollutant	Run ID	Test Date	Test Method	Test Run	Test Run Emission	In (Run Value)
											Emission Value	Value	
											lb/MMBtu	kg/GJ	
WDNR Fon du Lac	WDNR0098-1	ABB	GT11N1	86	natural gas	Water injection	cPM	Average	4/18/1994	EPA 5 back half	0.000814236	0.0003500436672	-7.957452648
WDNR Fon du Lac	WDNR0098-2	ABB	GT11N1	86	natural gas	Water injection	cPM	Average	4/18/1994	EPA 5 back half	0.000591123	0.0002541266799	-8.277677676
WDNR Fon du Lac	WDNR0099-1	ABB	GT11N1	86	natural gas	Water injection	cPM	Average	6/12/1994	EPA 5 back half	0.006061204	0.0026057396217	-5.95003872
WDNR Fon du Lac	WDNR0099-2	ABB	GT11N1	86	natural gas	Water injection	cPM	Average	6/12/1994	EPA 5 back half	0.005162558	0.0022194077444	-6.110514901
WDNR Fon du Lac	WDNR0102-1	ABB	GT11N1	86	natural gas	Water injection	cPM	Average	4/16/1996	EPA 5 back half	0.01093901	0.0047027314937	-5.35961177

x

Unit Averages, AP-42, Gas Turbines, Natural gas

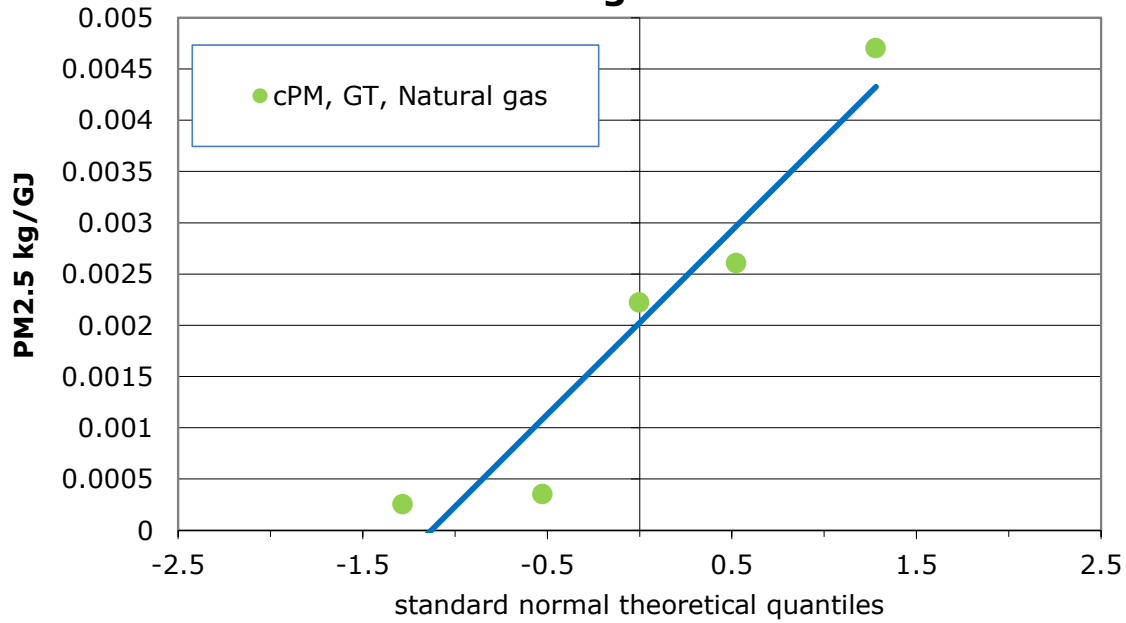


<u>Raw Statistics</u>	
Number of Valid Observations	5
Number of Distinct Observations	5
Minimum	2.54E-04
Maximum	4.70E-03
Mean of Raw Data	2.03E-03
Standard Deviation of Raw Data	1.84E-03
Khat	1.08
Theta hat	1.88E-03
Kstar	0.565
Theta star	3.58E-03
Mean of Log Transformed Data	-6.731
Standard Deviation of Log Transformed Data	1.301
<u>Normal GOF Test Results</u>	
Correlation Coefficient R	0.958
Shapiro Wilk Test Statistic	0.909
Shapiro Wilk Critical (0.05) Value	0.762
Approximate Shapiro Wilk P Value	N/A
Lilliefors Test Statistic	0.219
Lilliefors Critical (0.05) Value	0.396
Data appear Normal at (0.05) Significance Level	

AP-42 Data Gas Turbines
Unit averages

FacilityID	UnitID	Make	Model	Rating (MW)	Fuel	Controls	Pollutant	Run ID	Test Date	Test Method	Test Run	Test Run Emission	ln (Run Value)
											Emission Value	Value	
											lb/MMBtu	kg/GJ	
WDNR Fon du Lac	WDNR0098-1	ABB	GT11N1	86	natural gas	Water injection	f+cPM	Average	4/18/1994	EPA5 + back half	0.002238147	0.0009621898245	-6.946298804
WDNR Fon du Lac	WDNR0098-2	ABB	GT11N1	86	natural gas	Water injection	f+cPM	Average	4/18/1994	EPA5 + back half	0.001737987	0.0007471686572	-7.199219619
WDNR Fon du Lac	WDNR0099-1	ABB	GT11N1	86	natural gas	Water injection	f+cPM	Average	6/12/1994	EPA5 + back half	0.008393825	0.0036085442242	-5.62445085
WDNR Fon du Lac	WDNR0099-2	ABB	GT11N1	86	natural gas	Water injection	f+cPM	Average	6/12/1994	EPA5 + back half	0.008514667	0.0036604951646	-5.61015685
WDNR Fon du Lac	WDNR0102-1	ABB	GT11N1	86	natural gas	Water injection	f+cPM	Average	4/16/1996	EPA5 + back half	0.012169813	0.0052318592995	-5.252988557

x

Unit Averages, AP-42, Gas Turbines, Natural gas

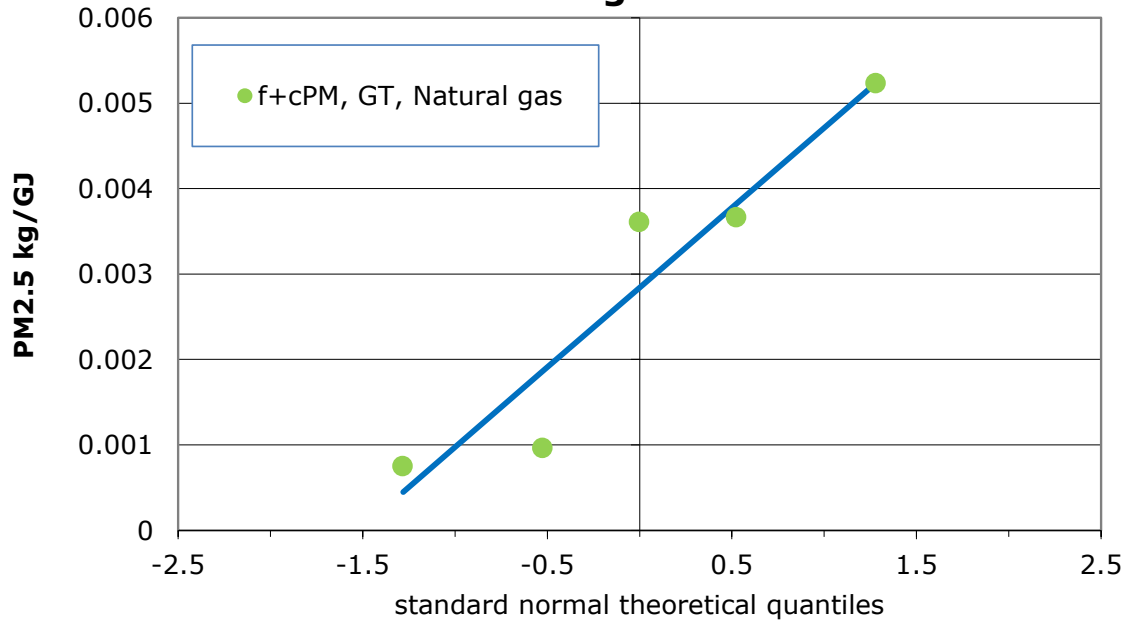

<u>Raw Statistics</u>	
Number of Valid Observations	5
Number of Distinct Observations	5
Minimum	7.47E-04
Maximum	5.23E-03
Mean of Raw Data	2.84E-03
Standard Deviation of Raw Data	1.93E-03
Khat	2.049
Theta hat	1.39E-03
Kstar	0.953
Theta star	2.98E-03
Mean of Log Transformed Data	-6.127
Standard Deviation of Log Transformed Data	0.881
<u>Normal GOF Test Results</u>	
Correlation Coefficient R	0.949
Shapiro Wilk Test Statistic	0.886
Shapiro Wilk Critical (0.05) Value	0.762
Approximate Shapiro Wilk P Value	N/A
Lilliefors Test Statistic	0.254
Lilliefors Critical (0.05) Value	0.396
Data appear Normal at (0.05) Significance Level	

Natural Gas

Emission Factor Report for

PM-filterable with Steam/Water Injection

21-Jun-16

ID	Manufacturer	Model	Rating (MW)	Load (%)	EF (lb/MMBtu)	Count of Runs	ND Count	Control Device
WDNR0102-1	ABB	GT11N1	86	100	1.23E-03	3	0	Water Injection for NOx control.
WDNR0099-2	ABB	GT11N1	86	100	3.35E-03	3	0	Water Injection for NOx control.
WDNR0099-1	ABB	GT11N1	86	100	2.33E-03	2	0	Water Injection for NOx control.
WDNR0098-2	ABB	GT11N1	86	100	1.15E-03	3	0	Water Injection for NOx control.
WDNR0098-1	ABB	GT11N1	86	100	1.42E-03	3	0	Water Injection for NOx control.

Avg EF =	1.90E-03
Count =	5
Std Dev =	9.39E-04
RSD(%) =	49.5%

Natural Gas

Emission Factor Report for PM-condensibles with Steam/Water Injection

21-Jun-16

ID	Manufacturer	Model	Rating (MW)	Load (%)	EF (lb/MMBtu)	Count of Runs	ND Count	Control Device
WDNR0102-1	ABB	GT11N1	86	100	1.10E-02	3	0	Water Injection for NOx control.
WDNR0099-2	ABB	GT11N1	86	100	5.16E-03	3	0	Water Injection for NOx control.
WDNR0099-1	ABB	GT11N1	86	100	6.06E-03	2	0	Water Injection for NOx control.
WDNR0098-2	ABB	GT11N1	86	100	5.91E-04	3	0	Water Injection for NOx control.
WDNR0098-1	ABB	GT11N1	86	100	8.15E-04	3	0	Water Injection for NOx control.

Avg EF = 4.73E-03
Count = 5
Std Dev = 4.29E-03
RSD(%) = 90.9%

AP-42 Data - 4-stroke RICE


Parameter	Units	Value	Value	Value (1)
Pollutant		fPM	cPM	fPM+cPM
Number of units tested		5	2	
Mean	kg/GJ	2.46E-03	4.26E-03	6.73E-03
Median	kg/GJ	2.45E-03	4.26E-03	
Geometric mean	kg/GJ	5.54E-04	4.01E-03	
Minimum	kg/GJ	1.90E-05	2.82E-03	2.84E-03
Maximum	kg/GJ	5.28E-03	5.70E-03	1.10E-02
Standard deviation	kg/GJ	2.45E-03	2.03E-03	3.18E-03
COV	%	99	48	47
Confidence level	%	95%	95%	
Measurement bias	%	6.5	6.5	
t factor (2 tail)		2.78	12.71	
t factor (1 tail)		1.53	3.08	
Total uncertainty	%	124	428	446
Total uncertainty	kg/GJ	3.04E-03	1.83E-02	1.85E-02
95% confidence upper bound	kg/GJ	4.15E-03	8.69E-03	
Data distribution		normal	normal	
99% confidence upper prediction limit	kg/GJ	1.25E-02	8.35E-02	

(1) By combining fPM + cPM factors

AP-42 Data 4-stroke RICE

Unit averages

FacilityID	UnitID	Category	Make	Model	Rating	Fuel	Controls	Pollutant	Run ID	Test Date	Test Method	Test Run Emission
												Value
												lb/MMBtu
GRI Site 3A	29.38x	4SLB	Cooper Bessemer	LSV-16 turbo	4200	natural gas	None	fPM		6/16/1994	201	0.000044183379
GRI Site 3A	29.34x	4SLB	Cooper Bessemer	LSV-16 turbo	4200	natural gas	None	fPM		6/15/1994	201	0.000109506219
Elk Hills Naval Petroleum Reserve No. 1	102.1	4SRB	Waukesha	L7042 GSIU	1500	natural gas	PCC	fPM		5/25/1993	5	0.012288658317
Elk Hills Naval Petroleum Reserve No. 1	102.2	4SRB	Waukesha	L7042 GSIU	1500	natural gas	PCC	fPM		7/22/1993	5	0.005706347534
Elk Hills Naval Petroleum Reserve No. 1	133	4SRB	Waukesha	L7042 GSIU	1500	natural gas	PCC	fPM		5/26/1993	5	0.010508330643

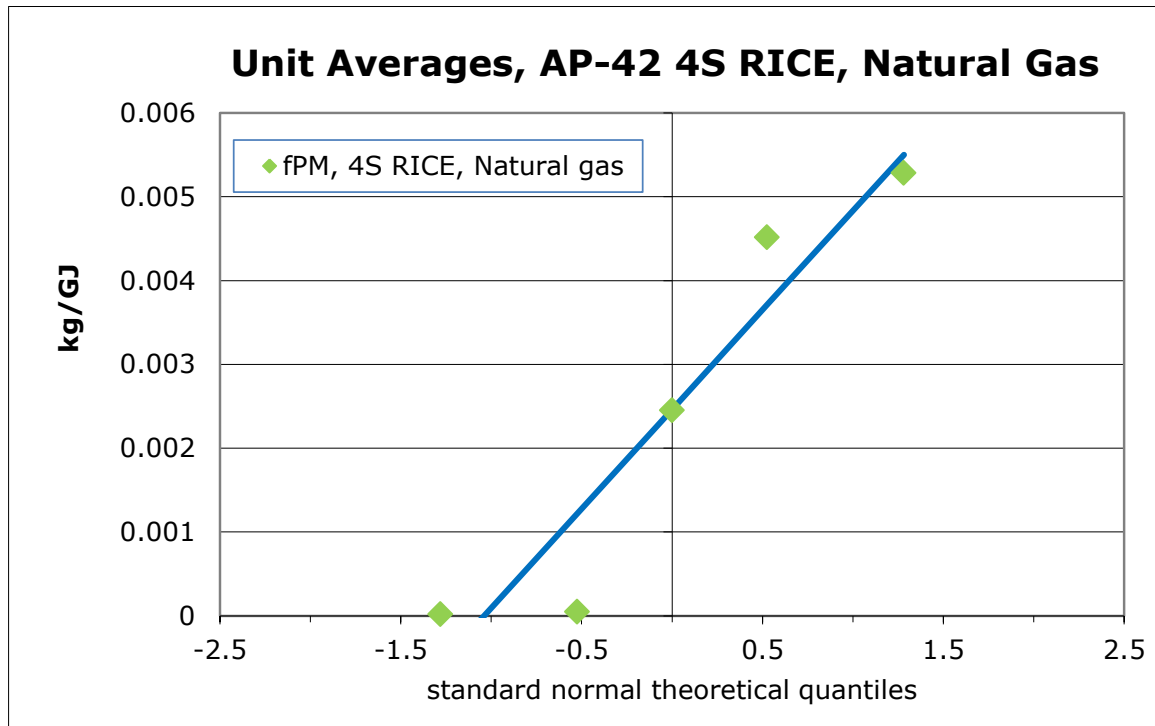

<u>Raw Statistics</u>	
Number of Valid Observations	5
Number of Distinct Observations	5
Minimum	1.90E-05
Maximum	0.00528
Mean of Raw Data	0.00246
Standard Deviation of Raw Data	2.45E-03
Khat	0.435
Theta hat	5.66E-03
Kstar	0.307
Theta star	0.00802
Mean of Log Transformed Data	-7.498
Standard Deviation of Log Transformed Data	2.7
<u>Normal GOF Test Results</u>	
Correlation Coefficient R	0.951
Shapiro Wilk Test Statistic	0.874
Shapiro Wilk Critical (0.05) Value	0.762
Approximate Shapiro Wilk P Value	N/A
Lilliefors Test Statistic	0.238
Lilliefors Critical (0.05) Value	0.396
Data appear Normal at (0.05) Significance Level	

AP-42 Data 4-stroke RICE


Unit averages

FacilityID	UnitID	Category	Make	Model	Rating	Fuel	Controls	Pollutant	Run ID	Test Date	Test Method	Test Run Emission Value	Test Run Emission Value
												lb/MMBtu	kg/GJ
GRI Site 3A	29.38x	4SLB	Cooper Bessemer	LSV-16 turbo	4200	natural gas	None	o+icPM		6/16/1994	202	0.006570373153	0.002824633994
GRI Site 3A	29.34x	4SLB	Cooper Bessemer	LSV-16 turbo	4200	natural gas	None	o+icPM		6/15/1994	202	0.013255013665	0.005698392058

AP-42 Data - 4-stroke RICE

Parameter	Units	Value
Pollutant		cPM
Number of units tested		2
Mean	kg/GJ	4.26E-03
Median	kg/GJ	4.26E-03
Geometric mean	kg/GJ	4.01E-03
Minimum	kg/GJ	2.82E-03
Maximum	kg/GJ	5.70E-03
Standard deviation	kg/GJ	2.03E-03
COV	%	48
Confidence level	%	95%
Measurement bias	%	6.5
t factor (2 tail)		12.71
t factor (1 tail)		3.08
Total uncertainty	%	428
Total uncertainty	kg/GJ	1.83E-02
95% confidence upper bound	kg/GJ	8.69E-03
Data distribution		normal
99% confidence upper prediction limit	kg/GJ	8.35E-02

Unit Averages, AP-42 4S RICE, Natural Gas

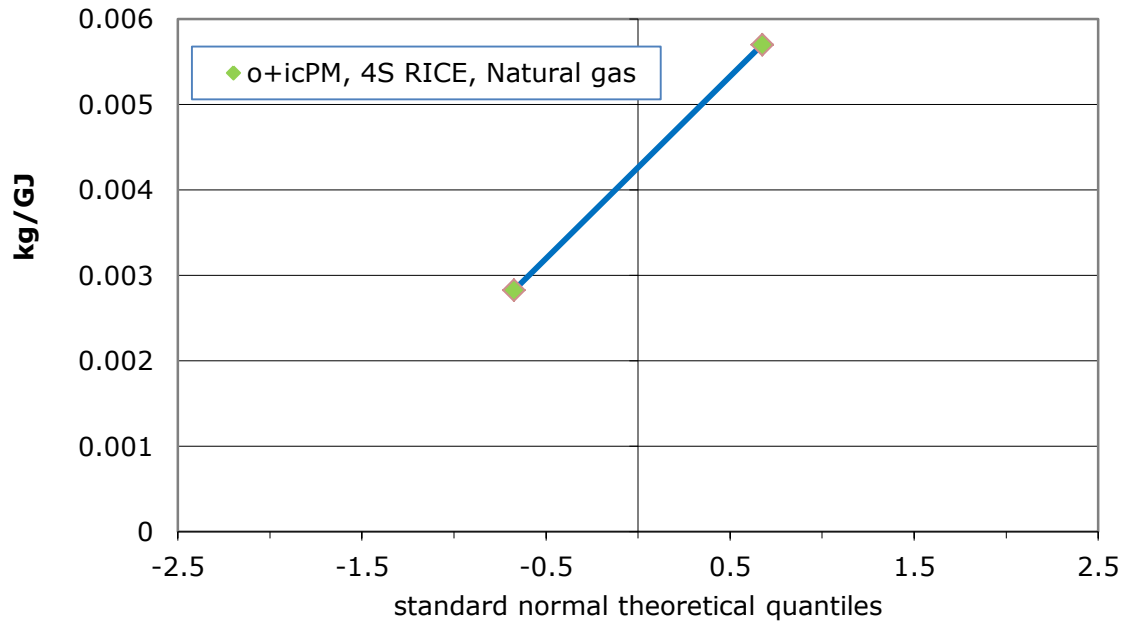

Engine Family: 4SRB

Emission Factor Report for			PM-10			with PCC		<i>30-Jun-16</i>	
ID	Manufacturer	Model	Rating (HP)	Load (%)	EF	(lb/MMBtu)	Count of Runs	ND Count	
133	Waukesha	L7042 GSIU	1500	67		1.05E-02	3	0	
102.2	Waukesha	L7042 GSIU	1500	63		5.70E-03	2	0	
102.1	Waukesha	L7042 GSIU	1500	66		1.23E-02	3	0	
					Avg EF = 9.50E-03 Std Dev = 3.41E-03 Count = 3 RSD(%) = 35.9%				

Engine Family: 4SLB

Emission Factor Report for			PM-10		with No Control		<i>03-Mar-16</i>		
ID	Manufacturer	Model	Rating (HP)	Load (%)	EF	(lb/MMBtu)	Count of Runs	ND Count	
29.38x	Cooper Bessemer	LSV-16	4200	99		1.10E-04	1	0	
29.34x	Cooper Bessemer	LSV-16	4200	101		4.42E-05	1	0	
					Avg EF = 7.71E-05 Std Dev = 4.65E-05 Count = 2 RSD(%) = 60.3%				

Engine Family: 4SLB

Emission Factor Report for PM-Organic Condensibles with No Control							<i>30-Jun-16</i>	
ID	Manufacturer	Model	Rating (HP)	Load (%)	EF (lb/MMBtu)	Count of Runs	ND Count	
29.38x	Cooper Bessemer	LSV-16	4200	99	2.19E-03	1	0	
29.34x	Cooper Bessemer	LSV-16	4200	101	6.63E-03	1	0	
					Avg EF =	4.41E-03		
					Std Dev =	3.14E-03		
					Count =	2		
					RSD(%) =	71.2%		

Engine Family: 4SLB

Emission Factor Report for PM-Inorganic Condensable with No Control							<i>30-Jun-16</i>	
ID	Manufacturer	Model	Rating (HP)	Load (%)	EF (lb/MMBtu)	Count of Runs	ND Count	
29.38x	Cooper Bessemer	LSV-16	4200	99	4.38E-03	1	0	
29.34x	Cooper Bessemer	LSV-16	4200	101	6.63E-03	1	0	
					Avg EF =	5.50E-03		
					Std Dev =	1.59E-03		
					Count =	2		
					RSD(%) =	28.9%		

APPENDIX C
GE ENERGY GAS TURBINE TEST DATA
SUMMARY

Table C-1: Paired CTM 39 PM2.5 result for a gas turbine combined cycle unit– 47-mm filter only (2008).

	Fuel Heat Input	O2	Exhaust Gas Temperature	PM2.5 mass (A-TMF)*	PM2.5 mass (A-TMF)*	PM2.5 mass (B-TMF)*	PM2.5 mass (B-TMF)*
	MMBtu/hr	%vol, dry	°F	µg/dscm	lb/MMBtu	µg/dscm	lb/MMBtu
Run 1	1561	13.81	228	62.69	9.92E-05	33.79	5.35E-05
Run 2	1577	13.87	215	13.78	2.20E-05	-10.38	-1.66E-05
Run 3	1560	13.85	213	13.44	2.14E-05	-26.76	-4.26E-05
Run 4	1560	13.84	215	6.76	1.08E-05	6.81	1.08E-05
Run 5	1567	13.84	216	6.92	1.10E-05	-23.19	-3.68E-05
Run 6	1560	13.87	214	65.36	1.04E-04	259.36	4.14E-04
Run 7	1536	13.51	215	-16.47	-2.50E-05	-23.6	-3.58E-05
Run 8	1513	13.86	219	-14.99	-2.39E-05	43.55	6.94E-05
Run 9	1545	13.77	215	199.1	3.13E-04	-30.4	-4.78E-05
Average	1553.2	13.80	216.7	37.40	5.92E-05	25.46	4.09E-05
Average-A & B						31.43	5.00E-05

*A and B represent results for each in a pair of modified CTM 39 sampling trains that collected samples simultaneously.

Table C-2: PM2.5 species results for modified CTM 39 Train A – GE Energy test program (2008).

Parameter	Units	A	A	A	A	A	A	A	A	A	A
		Run 1	Run 2	Run 3	Run 4	Run 5	Run 6	Run 7	Run 8	Run 9	Average
Organic carbon	µg/dscm	196.53	212.66	166.42	142.13	220.31	212.23	128.8	220.91	235.28	192.81
Elemental carbon	µg/dscm	9.46	15.57	8.44	5.16	28.34	10.47	15.79	19.9	31.61	16.08
Ammonium	µg/dscm	2.34	1.95	3.2	3.19	4.26	1.86	1.8	2.03	2.45	2.56
Chloride	µg/dscm	1.3	2.19	2.23	2.92	3.2	1.47	0.5	4.09	2.7	2.29
Nitrate	µg/dscm	1.7	0.45	1.76	0.69	1.49	1.94	1.61	1.38	1.36	1.38
Sulfate	µg/dscm	2.64	1.84	2.07	1.99	3.81	2.23	1.92	1.66	2.36	2.28
Al	µg/dscm	1.27	0.46	ND	0.47	ND	ND	0.49	ND	0.59	0.66
Br	µg/dscm	ND	0.11	ND	ND	ND	ND	ND	ND	ND	0.11
Ca	µg/dscm	ND	0.17	ND	2.18	ND	0.28	0.68	ND	1.38	0.94
Cl	µg/dscm	ND	ND	ND	0.52	0.37	0.15	0.27	ND	0.79	0.42
Cr	µg/dscm	ND	ND	ND	ND	ND	0.08	ND	ND	0.06	0.07
Cu	µg/dscm	ND	ND	ND	ND	0.17	ND	ND	ND	ND	0.17
Fe	µg/dscm	0.18	0.34	ND	0.37	0.2	0.29	0.28	ND	1.48	0.45
K	µg/dscm	ND	ND	ND	0.21	ND	ND	ND	ND	0.22	0.22
Mo	µg/dscm	ND	ND	ND	0.19	ND	ND	ND	ND	ND	0.19
Ni	µg/dscm	ND	ND	ND	ND	0.06	ND	ND	ND	0.04	0.05
Pb	µg/dscm	ND	ND	ND	0.22	ND	ND	ND	ND	ND	0.22
Rb	µg/dscm	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
S	µg/dscm	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Se	µg/dscm	0.15	ND	ND	ND	ND	ND	ND	ND	ND	0.15
Si	µg/dscm	5.35	1.21	ND	1.62	ND	1.84	1.07	ND	1.01	2.02
Sm	µg/dscm	ND	0.1	ND	ND	ND	ND	ND	ND	ND	0.10
Sr	µg/dscm	0.15	0.14	ND	0.11	ND	ND	ND	0.15	ND	0.14
Ti	µg/dscm	ND	0.07	ND	ND	ND	ND	ND	0.08	0.08	0.08
V	µg/dscm	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Y	µg/dscm	0.1	ND	ND	ND	ND	ND	ND	0.12	ND	0.11
Zn	µg/dscm	ND	ND	ND	0.25	0.69	ND	0.14	ND	0.1	0.30

Table C-3: PM2.5 species results for modified CTM 39Train B – GE Energy test program (2008).

		B	B	B	B	B	B	B	B	B	B
		Run 1	Run 2	Run 3	Run 4	Run 5	Run 6	Run 7	Run 8	Run 9	Average
Organic carbon	µg/dscm	217.11	247	193.39	399.9	186.02	493.09	154.15	233.8	181.77	256.25
Elemental carbon	µg/dscm	3.15	16.68	32.25	10.03	6.67	58.4	30.61	45.3	28.76	25.76
Ammonium	µg/dscm	2.37	2.1	3.23	6.12	2.85	2.23	1.93	2.02	2.37	2.80
Chloride	µg/dscm	2.41	0.28	1.86	1.35	1.31	1.01	1.96	1.98	0.48	1.40
Nitrate	µg/dscm	2.56	1.85	5.77	1.24	1.59	2.88	0.91	1.3	2.38	2.28
Sulfate	µg/dscm	3.15	3.65	2.48	15.98	3.07	2.8	2.45	2.68	1.44	4.19
Al	µg/dscm	ND	ND	ND	ND	ND	1.78	0.45	0.73	ND	0.99
Ca	µg/dscm	ND	ND	ND	ND	ND	0.21	0.15	0.22	ND	0.19
Cl	µg/dscm	ND	ND	ND	ND	ND	0.14	0.29	ND	ND	0.22
Fe	µg/dscm	0.17	0.29	ND	0.67	ND	0.6	1.22	1.4	ND	0.73
K	µg/dscm	ND	ND	ND	ND	ND	0.16	0.12	ND	ND	0.14
Ni	µg/dscm	0.04	0.05	ND	ND	0.05	ND	ND	ND	ND	0.05
Rb	µg/dscm	ND	ND	ND	ND	ND	ND	ND	ND	0.06	0.06
S	µg/dscm	ND	ND	ND	ND	ND	0.52	ND	ND	ND	0.52
Si	µg/dscm	ND	ND	0.57	2.3	ND	17.22	0.81	3.36	1.17	4.24
Sr	µg/dscm	0.13	ND	ND	ND	ND	ND	ND	ND	ND	0.13
Ti	µg/dscm	ND	ND	0.06	ND	ND	ND	0.06	0.07	0.07	0.07
V	µg/dscm	0.01	ND	ND	0.01	ND	ND	ND	ND	0.01	0.01
Y	µg/dscm	0.11	ND	ND	ND	ND	ND	0.09	ND	ND	0.10
Zn	µg/dscm	ND	ND	ND	ND	ND	0.07	0.08	0.09	ND	0.08

APPENDIX D
API RICE TEST DATA SUMMARY

Table D-1: API reciprocating engine test results – two-stroke lean burn engine (2003).

Parameter	Units	Run 1	Run 2	Run 3	Average
Fuel Flow Rate (60 °F, 14.5 psia)	1000 scfd	400.1	399.0	402.4	400.5
Fuel heat input	MMBtu/hr	17.76	17.78	17.80	17.78
Engine speed	RPM	322	--	--	322
Engine load	hp	2261	2264	2267	2264
Fuel HHV (Dry, 14.696 psia, 60 °F)	Btu/scf	1068.7	1072.7	1065.1	1068.8
Total fuel sulfur (STP)	gr/100 scf	0.006	0.004	0.009	0.0063
O ₂	%vol	14.4	14.3	14.6	14.5
Exhaust temperature	°F	589	589	589	589
Stack gas flow rate	dscfm	8400	8220	8700	8440
PM2.5 (TMF)	mg/dscm	9.92E+00	1.08E+01	1.07E+01	1.05E+01
PM2.5 (TMF)	lb/hr	3.10E-01	3.33E-01	3.46E-01	3.30E-01
PM2.5 (TMF)	lb/MMBtu	1.75E-02	1.87E-02	1.94E-02	1.85E-02
PM2.5 (TMF)	kg/GJ	7.51E-03	8.05E-03	8.35E-03	7.97E-03
PM2.5 (probe/venturi)	mg/dscm	4.34E-01	1.22E+00	7.96E-01	8.17E-01
PM2.5 (probe/venturi)	lb/hr	1.36E-02	3.75E-02	2.57E-02	2.56E-02
PM2.5 (TMF/probe/venturi)	mg/dscm	1.04E+01	1.20E+01	1.15E+01	1.13E+01
PM2.5 (TMF/probe/venturi)	lb/hr	3.24E-01	3.70E-01	3.71E-01	3.55E-01
PM2.5 (TMF/probe/venturi)	lb/MMBtu	1.82E-02	2.08E-02	2.09E-02	2.00E-02
PM2.5 (TMF/probe/venturi)	kg/GJ	7.84E-03	8.96E-03	8.97E-03	8.59E-03
Organic Carbon	mg/dscm	8.22E+00	7.95E+00	8.37E+00	8.18E+00
Elemental Carbon	mg/dscm	6.32E-02	9.36E-02	4.65E-02	6.78E-02
Backup OC	mg/dscm	4.27E-01	4.74E-01	6.17E-01	5.06E-01
Acenaphthene	mg/dscm	9.65E-05	1.37E-04	1.02E-04	1.12E-04
Acenaphthylene	mg/dscm	5.28E-04	6.12E-04	5.44E-04	5.61E-04
Anthracene	mg/dscm	4.52E-05	6.05E-05	6.02E-05	5.53E-05
Anthraquinone	mg/dscm	3.63E-04	3.97E-04	3.86E-04	3.82E-04
Anthrone	mg/dscm	ND	ND	ND	ND e
Benz(a)anthracene-7,12-dionene	mg/dscm	ND	7.54E-05	4.63E-05	6.09E-05

Table D-1: API reciprocating engine test results – two-stroke lean burn engine (2003).

Parameter	Units	Run 1	Run 2	Run 3	Average	
Benanthrone	mg/dscm	1.97E-04	ND	2.34E-04	2.15E-04	
Biphenyl	mg/dscm	2.11E-04	2.67E-04	1.93E-04	2.24E-04	
Dibenzofuran	mg/dscm	2.96E-04	3.02E-04	2.50E-04	2.83E-04	
1,3+1,6+1,7-dimethylnaphthalene	mg/dscm	1.47E-03	1.63E-03	1.29E-03	1.46E-03	
2,6+2,7-dimethylnaphthalene	mg/dscm	6.05E-04	6.55E-04	5.23E-04	5.95E-04	
1,4+1,5+2,3-dimethylnaphthalene	mg/dscm	5.61E-04	6.36E-04	4.92E-04	5.63E-04	
1,2-dimethylnaphthalene	mg/dscm	2.13E-04	2.90E-04	2.21E-04	2.41E-04	
C-dimethylphenanthrene	mg/dscm	2.16E-04	2.27E-04	1.33E-04	1.92E-04	
D-dimethylphenanthrene	mg/dscm	8.70E-05	1.15E-04	9.03E-05	9.75E-05	
1,7-dimethylphenanthrene	mg/dscm	3.91E-05	5.70E-05	4.29E-05	4.63E-05	
E-dimethylphenanthrene	mg/dscm	3.01E-05	2.07E-05	ND	2.54E-05	
1+2-ethylnaphthalene	mg/dscm	8.18E-04	8.49E-04	7.10E-04	7.92E-04	
Fluoranthene	mg/dscm	4.41E-05	7.95E-05	7.70E-05	6.69E-05	
Fluorene	mg/dscm	2.53E-04	2.24E-04	2.44E-04	2.40E-04	
9-fluorenone	mg/dscm	8.19E-04	8.25E-04	9.29E-04	8.58E-04	
D-MePy/MeFl	mg/dscm	ND	5.75E-06	ND	5.75E-06	e
2-Methylbiphenyl	mg/dscm	6.11E-04	7.13E-04	6.75E-04	6.66E-04	
4-Methylbiphenyl	mg/dscm	1.31E-04	1.17E-04	1.14E-04	1.21E-04	
3-Methylbiphenyl	mg/dscm	3.16E-04	3.54E-04	ND	3.35E-04	
A-methylfluorene	mg/dscm	2.49E-04	2.11E-04	2.93E-04	2.51E-04	
B-methylfluorene	mg/dscm	1.24E-04	1.38E-04	1.58E-04	1.40E-04	
2-methylnaphthalene	mg/dscm	2.71E-03	2.88E-03	2.50E-03	2.70E-03	
1-methylnaphthalene	mg/dscm	2.13E-03	2.26E-03	1.95E-03	2.11E-03	
C-methylphenanthrene	mg/dscm	2.20E-04	2.44E-04	1.67E-04	2.11E-04	
2-methylphenanthrene	mg/dscm	2.06E-04	2.04E-04	1.59E-04	1.90E-04	
1-methylphenanthrene	mg/dscm	1.83E-04	1.13E-04	1.38E-04	1.45E-04	a
A-methylphenanthrene	mg/dscm	1.22E-04	1.27E-04	1.09E-04	1.19E-04	
4-methylpyrene	mg/dscm	5.91E-05	6.16E-05	2.84E-05	4.97E-05	a
Naphthalene	mg/dscm	6.03E-03	6.06E-03	5.38E-03	5.82E-03	
Phenanthrene	mg/dscm	5.17E-04	5.51E-04	4.66E-04	5.11E-04	

Table D-1: API reciprocating engine test results – two-stroke lean burn engine (2003).

Parameter	Units	Run 1	Run 2	Run 3	Average	
Pyrene	mg/dscm	4.07E-05	1.12E-04	6.78E-05	7.34E-05	
B-trimethylnaphthalene	mg/dscm	2.71E-04	3.21E-04	2.43E-04	2.79E-04	
C-trimethylnaphthalene	mg/dscm	2.60E-04	2.79E-04	2.42E-04	2.60E-04	a
E-trimethylnaphthalene	mg/dscm	2.35E-04	2.22E-04	1.89E-04	2.15E-04	
J-trimethylnaphthalene	mg/dscm	1.44E-04	1.66E-04	1.52E-04	1.54E-04	
F-trimethylnaphthalene	mg/dscm	1.55E-04	1.36E-04	1.23E-04	1.38E-04	
A-trimethylnaphthalene	mg/dscm	1.11E-04	1.34E-04	1.12E-04	1.19E-04	
2,3,5-I-trimethylnaphthalene	mg/dscm	1.16E-04	5.82E-05	1.80E-05	6.40E-05	a
2,4,5-trimethylnaphthalene	mg/dscm	ND	2.01E-05	ND	2.01E-05	e
Xanthone	mg/dscm	2.77E-04	3.30E-04	2.96E-04	3.01E-04	
Al	mg/dscm	1.96E-04	ND	ND	1.96E-04	e
Ba	mg/dscm	6.74E-04	ND	5.96E-04	6.35E-04	b
Br	mg/dscm	7.19E-05	5.34E-05	6.85E-05	6.46E-05	
Ca	mg/dscm	1.27E-02	1.38E-02	1.55E-02	1.40E-02	
Cl	mg/dscm	4.11E-04	4.66E-04	3.69E-04	4.15E-04	b d
Cr	mg/dscm	9.03E-05	2.22E-05	ND	5.62E-05	
Cu	mg/dscm	1.93E-03	2.35E-05	2.26E-04	7.26E-04	a d
Fe	mg/dscm	7.78E-04	ND	ND	7.78E-04	e
K	mg/dscm	5.96E-04	3.38E-04	2.21E-04	3.85E-04	a
Mg	mg/dscm	2.34E-04	6.68E-04	8.86E-05	3.30E-04	a b d
Mo	mg/dscm	1.51E-03	1.69E-03	1.92E-03	1.71E-03	
Na	mg/dscm	3.42E-04	3.25E-04	ND	3.33E-04	a b d
P	mg/dscm	1.38E-03	8.52E-04	1.30E-03	1.18E-03	
Rb	mg/dscm	9.51E-06	8.90E-06	1.35E-05	1.06E-05	
S	mg/dscm	2.15E-02	2.21E-02	2.27E-02	2.21E-02	
Si	mg/dscm	2.69E-03	8.44E-03	1.16E-02	7.57E-03	a d
Sr	mg/dscm	ND	7.28E-06	2.88E-05	1.80E-05	
U	mg/dscm	ND	ND	3.02E-05	3.02E-05	e
Y	mg/dscm	ND	ND	4.15E-05	4.15E-05	e
Zn	mg/dscm	4.24E-03	4.53E-03	5.07E-03	4.61E-03	
Zr	mg/dscm	ND	ND	5.45E-05	5.45E-05	e

Table D-1: API reciprocating engine test results – two-stroke lean burn engine (2003).

Parameter	Units	Run 1	Run 2	Run 3	Average			
Sulfate	mg/dscm	2.07E-02	2.29E-02	2.15E-02	2.17E-02			
Nitrate	mg/dscm	8.81E-03	1.60E-02	2.62E-02	1.70E-02			
Chloride	mg/dscm	4.24E-03	3.44E-03	5.59E-03	4.42E-03	a	b	
Ammonium	mg/dscm	5.64E-03	7.10E-03	5.63E-03	6.12E-03			
Soluble Na	mg/dscm	6.06E-04	1.55E-03	5.04E-03	2.40E-03	a	b	d

a - 95% confidence lower bound of the average concentration is less than the dilution sampler blank concentration.

b - 95% confidence lower bound of the average concentration is less than the field blank concentration.

d - 95% confidence lower bound of the average concentration is less than the ambient concentration.

e - Insufficient data to calculate 95% confidence lower bound of the average concentration (i.e. zero or one valid run).

Table D-2: API reciprocating engine test results – four-stroke rich burn engine (2003).

Run	Units	Run 1	Run 2	Run 3	Average	
Fuel Flow Rate (60 °F, 14.5 psia)	1000 scfd	279.4	284.6	281.8	281.9	
Fuel heat input	MMBtu/hr	12.36	12.60	12.48	12.48	
Engine speed	RPM	313	320	320	318	
Engine load	hp	1220	1244	1232	1232	
Fuel HHV (Dry, 14.696 psia, 60 °F)	Btu/scf	1062.8	1061.6	1066.1	1063.5	
Total fuel sulfur (STP)	gr/100 scf	0.01	0.011	0.011	0.0107	
O ₂	%vol	11.0	11.4	11.2	11.2	
Exhaust temperature	°F	652	657	667	659	
Stack gas flow rate	dscfm	4040	4330	4210	4190	
PM2.5 (TMF)	mg/dscm	1.44E+00	1.26E+00	9.02E-01	1.20E+00	
PM2.5 (TMF)	lb/hr	2.04E-02	1.89E-02	1.31E-02	1.75E-02	
PM2.5 (TMF)	lb/MMBtu	1.65E-03	1.50E-03	1.05E-03	1.40E-03	
PM2.5 (TMF)	kg/GJ	7.09E-04	6.45E-04	4.53E-04	6.02E-04	
PM2.5 (probe/venturi)	mg/dscm	2.80E-01	5.41E-01	2.00E-01	3.40E-01	
PM2.5 (probe/venturi)	lb/hr	3.96E-03	8.14E-03	2.91E-03	5.00E-03	
PM2.5 (TMF/probe/venturi)	mg/dscm	1.72E+00	1.80E+00	1.10E+00	1.54E+00	
PM2.5 (TMF/probe/venturi)	lb/hr	2.43E-02	2.70E-02	1.61E-02	2.25E-02	
PM2.5 (TMF/probe/venturi)	lb/MMBtu	1.97E-03	2.15E-03	1.29E-03	1.80E-03	
PM2.5 (TMF/probe/venturi)	kg/GJ	8.47E-04	9.22E-04	5.53E-04	7.74E-04	
Organic Carbon	mg/dscm	1.05E+00	9.19E-01	7.27E-01	8.99E-01	
Elemental Carbon	mg/dscm	1.35E-02	1.66E-02	4.99E-02	2.67E-02	d
Backup OC	mg/dscm	1.66E-01	1.71E-01	1.65E-01	1.68E-01	
Acenaphthene	mg/dscm	4.59E-05	ND	ND	4.59E-05	e
Acenaphthylene	mg/dscm	4.36E-04	6.74E-04	4.21E-04	5.10E-04	
Anthracene	mg/dscm	2.37E-05	3.88E-05	1.09E-05	2.45E-05	
Anthraquinone	mg/dscm	1.68E-04	1.62E-04	1.61E-04	1.64E-04	
Anthrone	mg/dscm	ND	ND	ND	ND	e
Benzanthrone	mg/dscm	ND	5.19E-05	ND	5.19E-05	e
Biphenyl	mg/dscm	1.37E-04	2.70E-04	1.81E-04	1.96E-04	
Dibenzofuran	mg/dscm	ND	9.47E-05	9.20E-05	9.34E-05	

Table D-2: API reciprocating engine test results – four-stroke rich burn engine (2003).

Run	Units	Run 1	Run 2	Run 3	Average	
C-dimethylphenanthrene	mg/dscm	4.54E-05	5.39E-05	7.12E-05	5.68E-05	a
D-dimethylphenanthrene	mg/dscm	ND	ND	4.94E-05	4.94E-05	e
1+2-ethylnaphthalene	mg/dscm	1.53E-04	2.16E-04	2.18E-04	1.95E-04	
Fluoranthene	mg/dscm	7.64E-05	9.37E-05	9.36E-05	8.79E-05	
Fluorene	mg/dscm	1.38E-04	1.70E-04	1.43E-04	1.50E-04	
9-fluorenone	mg/dscm	2.36E-04	2.81E-04	2.37E-04	2.51E-04	
C-MePy/MeFl	mg/dscm	2.06E-06	8.06E-06	9.35E-06	6.49E-06	
2-Methylbiphenyl	mg/dscm	7.94E-04	7.24E-04	5.48E-04	6.88E-04	
4-Methylbiphenyl	mg/dscm	5.11E-05	5.84E-05	5.93E-05	5.63E-05	
B-methylfluorene	mg/dscm	ND	8.06E-05	ND	8.06E-05	e
2-methylnaphthalene	mg/dscm	3.99E-04	6.30E-04	5.22E-04	5.17E-04	
1-methylnaphthalene	mg/dscm	2.78E-04	4.52E-04	3.51E-04	3.60E-04	
C-methylphenanthrene	mg/dscm	6.09E-05	6.80E-05	8.94E-05	7.28E-05	a
1-methylphenanthrene	mg/dscm	2.53E-05	3.02E-05	4.94E-05	3.50E-05	a
2-methylphenanthrene	mg/dscm	2.84E-05	4.53E-05	2.60E-05	3.32E-05	a
4-methylpyrene	mg/dscm	1.55E-05	1.56E-05	2.18E-05	1.76E-05	a
Naphthalene	mg/dscm	2.09E-03	4.18E-03	2.88E-03	3.05E-03	
Phenanthrene	mg/dscm	3.49E-04	4.08E-04	3.04E-04	3.53E-04	
Pyrene	mg/dscm	6.72E-06	1.56E-05	4.78E-05	2.34E-05	
B-trimethylnaphthalene	mg/dscm	3.25E-05	5.14E-05	5.10E-05	4.50E-05	a
C-trimethylnaphthalene	mg/dscm	2.48E-05	4.58E-05	5.72E-05	4.26E-05	
E-trimethylnaphthalene	mg/dscm	2.32E-05	3.63E-05	5.04E-05	3.66E-05	a
J-trimethylnaphthalene	mg/dscm	1.19E-05	2.37E-05	3.28E-05	2.28E-05	a
F-trimethylnaphthalene	mg/dscm	8.77E-06	2.07E-05	2.55E-05	1.83E-05	a
2,3,5+I-trimethylnaphthalene	mg/dscm	ND	ND	6.76E-06	6.76E-06	e
Xanthone	mg/dscm	4.75E-05	4.99E-05	ND	4.87E-05	
Al	mg/dscm	ND	6.08E-04	ND	6.08E-04	e
Ba	mg/dscm	ND	ND	5.10E-04	5.10E-04	e
Br	mg/dscm	7.12E-06	1.04E-05	6.25E-06	7.92E-06	
Ca	mg/dscm	1.02E-02	7.76E-03	6.25E-03	8.06E-03	
Cl	mg/dscm	ND	3.87E-04	ND	3.87E-04	e

Table D-2: API reciprocating engine test results – four-stroke rich burn engine (2003).

Run	Units	Run 1	Run 2	Run 3	Average		
Co	mg/dscm	1.25E-04	5.52E-04	1.11E-04	2.63E-04		
Cr	mg/dscm	1.47E-04	1.99E-04	7.29E-05	1.40E-04		
Cu	mg/dscm	9.57E-04	6.49E-04	2.40E-05	5.43E-04	a	d
Fe	mg/dscm	2.43E-03	1.02E-01	1.06E-03	3.51E-02	a	d
K	mg/dscm	1.40E-04	4.35E-04	4.23E-05	2.06E-04	a	d
La	mg/dscm	3.65E-04	ND	ND	3.65E-04	e	
Mg	mg/dscm	2.68E-04	ND	2.36E-04	2.52E-04	b	d
Mn	mg/dscm	3.07E-05	3.06E-04	ND	1.69E-04		
Mo	mg/dscm	1.25E-03	1.04E-03	9.86E-04	1.09E-03		
Na	mg/dscm	2.53E-03	ND	2.89E-04	1.41E-03	a	b d
Ni	mg/dscm	5.46E-05	6.47E-05	ND	5.97E-05		
P	mg/dscm	1.04E-03	6.55E-04	5.06E-04	7.34E-04		
Rb	mg/dscm	ND	5.74E-06	ND	5.74E-06	e	
S	mg/dscm	1.45E-02	1.88E-02	1.29E-02	1.54E-02		
Se	mg/dscm	1.49E-05	1.30E-05	ND	1.40E-05		
Si	mg/dscm	5.48E-02	1.77E-02	2.88E-02	3.38E-02		
Sn	mg/dscm	1.16E-04	1.13E-04	1.75E-04	1.35E-04		
Sr	mg/dscm	ND	9.63E-06	ND	9.63E-06	e	
V	mg/dscm	ND	5.56E-05	ND	5.56E-05	e	
Zn	mg/dscm	3.07E-03	8.85E-03	2.25E-03	4.72E-03		d
Sulfate	mg/dscm	3.77E-02	4.14E-02	3.52E-02	3.81E-02		
Nitrate	mg/dscm	8.94E-03	5.64E-03	2.93E-03	5.83E-03	a	
Chloride	mg/dscm	5.89E-03	4.29E-03	3.69E-03	4.62E-03	a	b
Ammonium	mg/dscm	1.09E-02	1.09E-02	9.97E-03	1.06E-02		
Soluble Na	mg/dscm	2.66E-04	2.56E-04	3.07E-04	2.76E-04	a	b

a - 95% confidence lower bound of the average concentration is less than the dilution sampler blank concentration.

b - 95% confidence lower bound of the average concentration is less than the field blank concentration.

d - 95% confidence lower bound of the average concentration is less than the ambient concentration.

e - Insufficient data to calculate 95% confidence lower bound of the average concentration (i.e. zero or one valid run).

Table D-3: API reciprocating engine test results - 4SLB (2003).

Run	Units	Run 1	Run 2	Run 3	Average
Fuel Flow Rate (60 °F, 14.5 psia)	1000 scfd	225.1	224.3	224.9	224.8
Fuel heat input	MMBtu/hr	9.94	9.89	9.96	9.93
Engine speed	RPM	924	933	934	930
Engine load	hp	1553	1546	1557	1552
Fuel HHV (Dry, 14.696 psia, 60 °F)	Btu/scf	1064.9	1066.2	1065.9	1065.7
Total fuel sulfur (STP)	gr/100 scf	0.039	0.003	0.009	0.0170
O ₂	%vol	12.5	12.3	12.1	12.3
Exhaust temperature	°F	703	721	718	714
Stack gas flow rate	dscfm	3650	3580	3530	3587
PM2.5 (TMF)	mg/dscm	5.47E+00	3.30E+00	2.25E+00	3.68E+00
PM2.5 (TMF)	lb/hr	7.39E-02	4.24E-02	2.90E-02	4.84E-02
PM2.5 (TMF)	lb/MMBtu	7.44E-03	4.29E-03	2.91E-03	4.88E-03
PM2.5 (TMF)	kg/GJ	3.20E-03	1.84E-03	1.25E-03	2.10E-03
PM2.5 (probe/venturi)	mg/dscm	ND	1.69E-01	1.85E-01	1.77E-01
PM2.5 (probe/venturi)	lb/hr	ND	2.16E-03	2.38E-03	2.27E-03
PM2.5 (TMF/probe/venturi)	mg/dscm	5.47E+00	3.47E+00	2.44E+00	3.79E+00
PM2.5 (TMF/probe/venturi)	lb/hr	7.39E-02	4.46E-02	3.14E-02	5.00E-02
PM2.5 (TMF/probe/venturi)	lb/MMBtu	7.44E-03	4.51E-03	3.15E-03	5.03E-03
PM2.5 (TMF/probe/venturi)	kg/GJ	3.20E-03	1.94E-03	1.35E-03	2.16E-03
Organic Carbon	mg/dscm	3.39E+00	2.98E+00	2.04E+00	2.80E+00
Elemental Carbon	mg/dscm	ND	1.66E-02	ND	1.66E-02 e
Backup OC	mg/dscm	2.34E-01	2.90E-01	2.71E-01	2.65E-01
Anthraquinone	mg/dscm	3.96E-04	7.45E-04	8.18E-04	6.53E-04
Anthrone	mg/dscm	ND	ND	ND	ND e
Benz(a)anthracene-7,12-dionene	mg/dscm	9.01E-05	ND	ND	9.01E-05 e
Benzanthrone	mg/dscm	1.17E-04	ND	ND	1.17E-04 e
Biphenyl	mg/dscm	1.34E-04	1.39E-04	ND	1.36E-04
Dibenzofuran	mg/dscm	2.17E-04	2.50E-04	1.65E-04	2.11E-04
C-dimethylphenanthrene	mg/dscm	5.75E-05	1.03E-04	7.52E-05	7.86E-05 a
D-dimethylphenanthrene	mg/dscm	ND	5.26E-05	4.75E-05	5.01E-05 a

Table D-3: API reciprocating engine test results - 4SLB (2003).

Run	Units	Run 1	Run 2	Run 3	Average			
1+2-ethylnaphthalene	mg/dscm	2.15E-04	2.01E-04	ND	2.08E-04			
Fluoranthene	mg/dscm	2.40E-05	3.65E-05	3.67E-05	3.24E-05			
9-fluorenone	mg/dscm	1.47E-03	1.88E-03	1.75E-03	1.70E-03			
D-MePy/MeFl	mg/dscm	ND	2.92E-06	3.60E-06	3.26E-06	a		
2-Methylbiphenyl	mg/dscm	4.70E-04	5.21E-04	5.19E-04	5.03E-04			
4-Methylbiphenyl	mg/dscm	2.65E-05	5.99E-05	ND	4.32E-05			
B-methylfluorene	mg/dscm	7.60E-05	7.89E-05	ND	7.75E-05	a		
2-methylnaphthalene	mg/dscm	6.84E-04	6.09E-04	3.57E-04	5.50E-04			
1-methylnaphthalene	mg/dscm	3.74E-04	3.16E-04	1.78E-04	2.90E-04			
C-methylphenanthrene	mg/dscm	7.66E-05	1.49E-04	1.43E-04	1.23E-04	a		
1-methylphenanthrene	mg/dscm	2.70E-05	3.51E-05	4.75E-05	3.65E-05	a		
2-methylphenanthrene	mg/dscm	3.90E-05	4.53E-05	1.08E-05	3.17E-05	a		
4-methylpyrene	mg/dscm	1.10E-05	2.87E-05	3.55E-05	2.51E-05	a		
Naphthalene	mg/dscm	3.37E-03	2.36E-03	2.39E-03	2.71E-03			
Phenanthrene	mg/dscm	1.56E-04	1.66E-04	9.44E-05	1.39E-04			
C-trimethylnaphthalene	mg/dscm	4.10E-05	4.72E-05	5.77E-05	4.87E-05			
B-trimethylnaphthalene	mg/dscm	4.55E-05	6.13E-05	3.85E-05	4.85E-05	a		
J-trimethylnaphthalene	mg/dscm	2.80E-05	3.80E-05	3.31E-05	3.30E-05	a		
E-trimethylnaphthalene	mg/dscm	3.05E-05	3.89E-05	2.29E-05	3.08E-05	a		
F-trimethylnaphthalene	mg/dscm	2.50E-05	3.07E-05	1.74E-05	2.44E-05	a		
2,4,5-trimethylnaphthalene	mg/dscm	2.25E-05	ND	1.62E-05	1.94E-05	a		
A-trimethylnaphthalene	mg/dscm	7.51E-06	1.56E-05	ND	1.16E-05			
2,3,5+I-trimethylnaphthalene	mg/dscm	4.00E-06	9.73E-06	ND	6.87E-06			
Xanthone	mg/dscm	3.04E-04	4.29E-04	4.42E-04	3.92E-04			
Ag	mg/dscm	6.96E-05	ND	ND	6.96E-05	e		
Al	mg/dscm	1.01E-02	ND	ND	1.01E-02	e		
Ba	mg/dscm	3.72E-04	3.41E-04	7.03E-04	4.72E-04	b	d	
Br	mg/dscm	8.07E-05	2.35E-05	1.27E-05	3.90E-05		d	
Ca	mg/dscm	1.45E-02	7.93E-03	8.38E-03	1.03E-02			
Cd	mg/dscm	1.12E-04	ND	ND	1.12E-04	e		
Cl	mg/dscm	3.29E-03	2.91E-04	6.32E-04	1.40E-03	a	b	d

Table D-3: API reciprocating engine test results - 4SLB (2003).

Run	Units	Run 1	Run 2	Run 3	Average		
Co	mg/dscm	2.14E-03	2.25E-05	4.60E-05	7.36E-04		
Cr	mg/dscm	6.31E-04	1.65E-05	5.44E-05	2.34E-04		
Cu	mg/dscm	2.82E-03	1.55E-03	7.92E-04	1.72E-03	a	d
Fe	mg/dscm	6.01E-01	1.62E-03	2.07E-04	2.01E-01	a	d
K	mg/dscm	2.68E-03	8.09E-05	6.94E-05	9.45E-04	a	d
La	mg/dscm	ND	3.91E-04	3.59E-04	3.75E-04		
Mg	mg/dscm	ND	2.44E-04	7.12E-04	4.78E-04	b	d
Mn	mg/dscm	1.65E-03	ND	ND	1.65E-03	e	
Mo	mg/dscm	1.77E-03	1.47E-03	1.57E-03	1.60E-03		
Na	mg/dscm	ND	ND	1.63E-03	1.63E-03	e	
Ni	mg/dscm	4.69E-04	3.13E-05	6.07E-05	1.87E-04		
P	mg/dscm	ND	3.74E-04	7.34E-04	5.54E-04	b	
Rb	mg/dscm	2.67E-05	1.72E-05	ND	2.19E-05		
S	mg/dscm	5.47E-02	2.72E-03	2.95E-03	2.01E-02	a	d
Se	mg/dscm	5.60E-05	ND	ND	5.60E-05	e	
Si	mg/dscm	4.53E-02	2.49E-02	7.25E-03	2.58E-02	a	d
Sn	mg/dscm	9.72E-05	8.41E-05	ND	9.07E-05		
Sr	mg/dscm	4.19E-05	1.95E-05	ND	3.07E-05		
V	mg/dscm	2.66E-04	ND	ND	2.66E-04	e	
Y	mg/dscm	1.09E-05	2.78E-05	ND	1.94E-05		
Zn	mg/dscm	4.96E-02	1.62E-03	1.58E-03	1.76E-02		d
Zr	mg/dscm	ND	1.81E-05	ND	1.81E-05	e	
Sulfate	mg/dscm	7.68E-02	5.57E-03	6.34E-03	2.96E-02	a	d
Nitrate	mg/dscm	1.29E-02	4.58E-03	8.50E-03	8.65E-03	a	
Chloride	mg/dscm	1.01E-02	2.61E-03	3.64E-03	5.47E-03	a	b d
Ammonium	mg/dscm	1.34E-02	ND	ND	1.34E-02	e	
Soluble Na	mg/dscm	8.72E-04	3.23E-04	8.06E-04	6.67E-04	a	b

- a - 95% confidence lower bound of the average concentration is less than the dilution sampler blank concentration.
- b - 95% confidence lower bound of the average concentration is less than the field blank concentration.
- d - 95% confidence lower bound of the average concentration is less than the ambient concentration.
- e - Insufficient data to calculate 95% confidence lower bound of the average concentration (i.e. zero or one valid run).

APPENDIX E
CEPEI 2012 TECHNICAL MEMORANDUM

Fine Particulate Emissions from Natural Gas-Fired Combustion Sources: Alternative PM_{2.5} Emission Factors

Technical Memorandum

Prepared for:



**Canadian Energy Partnership
for Environmental Innovation
(CEPEI)**

Prepared by:



innovative environmental solutions, inc.

October 2012

TABLE OF CONTENTS

Executive Summary	1
1. Introduction.....	3
2. Fine Particulate Emission Factors Background and U.S. EPA AP-42 Factors	4
3. Summary of the U.S. Collaborative PM _{2.5} Test Program	6
3.1. Project Overview, Objectives and Summary of Conclusions.....	6
3.2. Fine Particulate Test Methods Overview	8
3.3. Summary of PM _{2.5} Test Results and Emission Factors and Comparison to AP-42	8
4. Discussion and Recommended PM _{2.5} Emission Factors for Natural Gas-Fired Sources	15
4.1. Conclusions Regarding Dilution Tunnel Results	15
4.2. Discussion and Recommended PM _{2.5} Emission Factors	17
 <u>Appendices</u>	
A: Summary of AP-42 Particulate Matter Emission Factors, Ratings, and Data Sources for Natural Gas-Fired Combustion	19
B: Primary Technical Documents from the U.S. Collaborative PM _{2.5} Emissions Project (with links to documents on CEC's website).....	21

LIST OF TABLES

1. Summary of PM _{2.5} Emissions Data from Dilution Tunnel Test for All Gas-Fired Units.....	10
2. Comparison of PM _{2.5} Emission Factors from Dilution Tunnel Tests by Unit Type and Fuel Type for Gas-Fired Boilers, Process Heaters, and Turbines.....	12
3. Comparison of PM _{2.5} Emission Factors from Dilution Tunnel Tests for Natural Gas-Fired Boilers, Process Heaters, and Turbines.....	13
4. Comparison of Dilution Tunnel PM _{2.5} Emission Factors to AP-42 Emission Factors	13
5. Annual PM _{2.5} emissions (kg per year) for example natural gas-fired equipment based on dilution tunnel emission factors (95% confidence upper bound) or AP-42	14

LIST OF FIGURES

1. PM _{2.5} Speciation for Gas-fired Boilers and Process Heaters	15
---	----

EXECUTIVE SUMMARY

There is very little data available on fine particulate (PM_{2.5}) emissions from natural gas-fired sources. Thus, emission factors from the U.S. EPA AP-42 document are the common reference when estimating PM_{2.5} emissions from natural gas-fired sources. Since PM_{2.5} emissions are low, there was little historical concern for these emissions and minimal effort expended to improve emission factors. However, as PM_{2.5} emissions are more closely scrutinized the accuracy of AP-42 emission factors gains importance, especially since it has been shown that results from traditional PM_{2.5} methods likely introduce significant positive bias when measuring the very low emissions from gas-fired sources. An assessment of these factors and review of alternative emission factors is warranted.

The only notable alternative data to that used for AP-42 emission factor development is from a U.S. collaborative project conducted from 2001 to 2005. The multi-party project included state and federal agencies and used advanced dilution tunnel methods to characterize PM_{2.5} emissions from natural gas-fired equipment. The project concluded that dilution tunnel results are more appropriate than emission factors based on conventional methods, such as the AP-42 emission factors. Based on the conclusions from the U.S. collaborative project, it is apparent that dilution tunnel results are the preferred alternative to AP-42 emission factors.

The U.S. collaborative project dilution tunnel tests measured PM_{2.5} emissions, and present PM_{2.5} mass rates as well as speciated data that identify the chemical components that comprise PM_{2.5} emissions. An understanding of combustion chemistry and the species measured indicates that particulate from gas-fired sources is fine particulate (<2.5 μm). Thus, coarser particulate was not measured in the collaborative project and results are not presented using protocol sometimes associated with conventional test methods (e.g., “filterable” or “condensable” emissions).

There are considerations that need to be addressed when defining the emission factor because the selection of the factor may have both policy and technical implications. In addition, the context for data use is important (e.g., source estimate, source emission limit, national inventory). AP-42 emission factors are typically the average of the emissions data used, and EPA cautions against using AP-42 factors for establishing permit limits. However, AP-42 factors are used for that purpose because alternatives are not available. This memorandum presents the 95% confidence limit upper bound or maximum value from dilution tunnel data as alternatives to AP-42 factors. Emission factors are presented for boilers, process heaters, and turbines, but there is little difference in the PM_{2.5} emissions for these different source types based on the data from the U.S. collaborative project. The differences in source-specific emission factors likely include measurement uncertainty as a significant contributor. Natural gas-fired reciprocating engine emissions are a data gap. The AP-42 data for reciprocating engines is based on three or fewer tests from Gas Research Institute testing that was not focused on particulate measurement, and dilution tunnel results are not available.

The summary of dilution tunnel PM_{2.5} emission factors for natural gas-fired sources includes:

- Boilers: 2.7×10^{-4} kg/GJ (0.27 g/GJ) based on the maximum (Note: kg/GJ units are used for other factors presented in this section);
 - The average emission factor is 1.4×10^{-4} kg/GJ and the value based on the 95% confidence upper bound is 2.3×10^{-4} kg/GJ;
- Process Heaters: 1.34×10^{-4} kg/GJ (based on the maximum);

- The average emission factor is 6.9×10^{-5} kg/GJ and the 95% confidence upper bound value is 1.4×10^{-4} kg/GJ (note that the 95% confidence interval upper bound emission factor is larger than the maximum due to the small number of samples – i.e., three tests);
- Turbines: 2.3×10^{-4} kg/GJ (based on the maximum);
 - The average emission factor is 7.1×10^{-5} kg/GJ and the 95% confidence upper bound value is 1.1×10^{-4} kg/GJ;
- If all of the natural gas-fired data are considered as a single dataset, the maximum emission factor is 2.7×10^{-4} kg/GJ (0.27 g/GJ), and the average emission factor is 9.6×10^{-5} kg/GJ (0.096 g/GJ). The 95% confidence upper bound emission factor is 1.3×10^{-4} kg/GJ (0.13 g/GJ).

As shown in Table 1 of this memorandum, the range of the dilution tunnel test data is relatively narrow, especially when considering the very low level of mass emissions measured. To improve lower detection limits and improve performance when sampling streams with low mass emissions, dilution tunnel testing uses methods with detection limits commensurate with ambient test methods rather than stack test methods. For example, the mass measured with dilution tunnel tests would typically be below method detection limits for conventional exhaust stack reference methods.

Since the measurement results include uncertainty associated with the low levels measured and limited data is available (i.e., 32 tests), and the test results fall within a relatively narrow band without obvious outliers, the data imply similar emissions for gas-fired sources regardless of the source type. As noted in conclusions from the U.S. collaborative project reports:

- For gas-fired sources, dilution sampling indicates fine particulate mass emissions are extremely low and probably similar to ambient air $PM_{2.5}$ concentrations in many cases.
- The most important factor affecting $PM_{2.5}$ variability is *not* equipment type, operating condition, or emission controls, but rather due to test methods, with the method choice (i.e., traditional impinger methods versus dilution tunnel) and sampling artifacts related to sulfur species the most important factors affecting variability in $PM_{2.5}$ emission results.

Conclusions regarding test methods indicate that dilution tunnel results for gas-fired sources are more representative of actual emissions than conventional test methods that serve as the basis for AP-42 emission factors. These conclusions also indicate that the test method from which emission estimates are derived may be a primary basis for perceptions about the significance of $PM_{2.5}$ emissions from a source. If unit or facility emissions are assessed based on the lower emission factor from dilution tunnel tests, different conclusions may be reached regarding the significance of a source when compared to estimates based on AP-42 factors. Thus, care should be taken to ensure that test method flaws do not erroneously impact regulatory decisions.

Since the dilution tunnel results are significantly lower than AP-42 emission factors and uncertainty is inherent for such low measurements, conservatism may be desired for $PM_{2.5}$ emission estimates. Thus, the *maximum* emission factor from the data set or specific source type may be considered as a preferred alternative for emission estimates. The maximum emission factors for natural gas-fired sources include:

- Boilers: 2.7×10^{-4} kg/GJ (0.27 g/GJ);
- Process heaters: 1.3×10^{-4} kg/GJ (0.13 g/GJ); and
- Turbines: 2.3×10^{-4} kg/GJ (0.23 g/GJ).

1.0 Introduction

According to the U.S. EPA AP-42 document¹ (AP-42 document), an “emission factor is a representative value that attempts to relate the quantity of a pollutant released to the atmosphere with an activity associated with the release of that pollutant. . . . Such factors facilitate estimation of emissions from various sources of air pollution.” The AP-42 document is a primary reference used throughout the world for estimating emissions of common pollutants. In the AP-42 document, EPA cautions about the use of AP-42 emission factors, indicating:

“Emission factors in AP-42 are neither EPA-recommended emission limits (e. g., best available control technology or BACT, or lowest achievable emission rate or LAER) nor standards (e. g., National Emission Standard for Hazardous Air Pollutants or NESHAP, or New Source Performance Standards or NSPS). Use of these factors as source-specific permit limits and/or as emission regulation compliance determinations is not recommended by EPA.”

However, AP-42 emission factors are commonly used for exactly this purpose when other information is not available, and AP-42 emission factors serve as de facto standards in many cases. For fine particulate emissions from natural gas-fired combustion, very little data is available. Thus, AP-42 emission factors have been the common reference when estimating fine particulate emissions from natural gas-fired sources. Since emissions are low, there was little historical concern for these emissions and minimal effort has been expended to conduct tests. However, as fine particulate emissions face additional scrutiny, the veracity of the AP-42 fine particulate emission factors has become more important. An assessment of these factors and review of alternatives is warranted.

Fine particulate matter is defined as particulate with an aerodynamic mean diameter of 2.5 microns or less (PM_{2.5}). Understanding PM_{2.5} emissions is more complex than other conventional pollutants, because PM_{2.5} is comprised of a mixture of chemical species. In some cases, the species are directly emitted as particulate, and in other cases (e.g., aerosols) the pollutants condense in the atmosphere as the stack plume cools. In addition, secondary PM_{2.5} can be formed from atmospheric reactions (i.e., “direct” emissions are a PM_{2.5} precursor).

For combustion sources, the common constituents of PM_{2.5} include sulfate, nitrate, ammonium, elemental carbon, organic compounds, and other inorganic materials. In addition, sulfate, nitrate, and ammonium are formed in the atmosphere from SO₂, NO_x, and ammonia emissions. These emissions, which are considered PM_{2.5} precursors, are not counted as “primary” emissions as represented in PM_{2.5} emission factors. Elemental carbon, organic and inorganic compounds, and sulfate, nitrate and ammonium are the “direct” or primary emissions represented by emission factors, and this includes species that condense as the combustion exhaust plume cools to ambient temperature. Since it is a gaseous fuel, natural gas combustion has characteristically low particulate emissions with all of the particulate considered PM_{2.5}.

The Canadian Energy Partnership for Environmental Innovation (CEPEI) has recently investigated U.S. PM_{2.5} regulatory criteria, the U.S. EPA AP-42 document PM_{2.5} emission factors, challenges with measuring PM_{2.5} from gas-fired sources, and data other than the AP-42 emission factors, including a U.S. collaborative project that measured PM_{2.5} emissions using a

¹ AP-42, Compilation of Air Pollutant Emission Factors, Volume 1, Stationary and Area Point Source, U.S. EPA Office of Air Quality Planning and Standards (January 1995).

dilution tunnel test method. Other than the U.S collaborative project, AP-42 tests, and a handful of similar test results based on conventional test methods, review of available fine particulate emissions data and emission factors did not identify significant additional data. In an ongoing effort to improve PM_{2.5} emission estimates for natural gas-fired combustion sources, this technical memorandum considers alternative PM_{2.5} emission factors for natural gas-fired sources. The memo includes:

- Background on the U.S. EPA AP-42 emissions factor and similar data based on conventional test methods;
- Background on a U.S. collaborative project and its results, including a summary of test data acquired using a dilution tunnel test method, comparison to AP-42, and conclusions and recommendations regarding these results;
- Discussion and recommendations regarding alternative PM_{2.5} emission factors for natural gas-fired turbines, boilers, and heaters.

Following this introductory section of the memo, Section 2 provides background on the AP-42 emission factors and potential biases in historical data. Section 3 provides a test methods overview, and also provides an overview of emissions data and emission factors from a collaborative multi-party project that included U.S. federal, state and industry participants. The U.S. collaborative project used a dilution tunnel to measure PM_{2.5} emissions from gas-fired and oil-fired sources. Section 4 discusses alternative PM_{2.5} emission factors for natural gas-fired sources and recommends alternatives based on available data.

2.0 Fine Particulate Emission Factors Background and U.S. EPA AP-42 Factors

PM_{2.5} is typically comprised of a number of constituents that include sulfate, nitrate, ammonium, elemental carbon, semi-volatile organic compounds, and other inorganic materials (e.g., ash from solid and liquid fuels). Natural gas is comprised of simple hydrocarbons and is typically 90% by volume or more methane (CH₄) with ethane, ethylene, propane, butane, carbon dioxide and nitrogen comprising the balance. Trace levels of higher hydrocarbons and contaminants (e.g., hydrogen sulfide, benzene) may also be present. Since it is a gaseous and ash free fuel, natural gas combustion emits very low levels of particulate that challenge test method detection limits. Trace levels of PM_{2.5} constituents including nitrate, sulfate, and semi-volatile organics can form in the byproducts from natural gas combustion.

Most available data on natural gas combustion PM_{2.5} emissions was acquired using conventional test methods that measure the total mass of all constituents that comprise fine particulate, with “filterable” particulate (i.e., constituents captured on a sample system filter) measured separately from “condensable” particulate, which passes through the filter and is captured in a cooled impinger train. These methods are available on the U.S. Environmental Protection Agency (EPA) website (e.g., see Method 5, Method 5I, and Method 202 at <http://www.epa.gov/ttn/emc/promgate.html>). A measurement bias has been demonstrated when using Method 202 for natural gas-fired sources due to a sampling artifact that can inappropriately categorize trace levels of SO₂ from fuel sulfur (i.e., from H₂S and mercaptans used as an odorant) as sulfate. Although the absolute level of this bias (i.e., absolute mass emissions) is small, the relative bias can be significant due to the low overall PM_{2.5} emissions. An advanced method used in recent testing can measure total mass from a *dilution tunnel system*, as well as the various constituents or species that comprise particulate.

“Dilution tunnel” methods simulate plume chemistry, and the method “separates” the resulting stream into a number of parallel sample lines and applies species-specific methods to measure and speciate the emissions using available refined sample collection and analytical techniques. For natural gas combustion, the trace emission levels challenge detection limits, even though methods analogous to ambient test methods are used for sample collection and analysis. As discussed in Section 3, the EPA supported a program that used a dilution tunnel to measure natural gas combustion $PM_{2.5}$ emissions.

The U.S. collaborative project dilution tunnel tests measured $PM_{2.5}$ emissions, and present $PM_{2.5}$ mass rates as well as speciated data that identify the chemical components that comprise $PM_{2.5}$ emissions. An understanding of combustion chemistry and the species measured indicates that particulate from gas-fired sources is fine particulate ($<2.5 \mu m$). Thus, coarser particulate was not measured in the collaborative project and results are not presented using protocol sometimes associated with conventional test methods (e.g., “filterable” or “condensable” emissions).

For estimating emissions for permitting, project analysis, or other related activities, emission factors are used. For more common natural gas combustion pollutants such as NO_x or CO, equipment providers (e.g., turbine or engine manufacturers) provide emissions factors for new equipment. Emission factors for trace pollutants such as natural gas combustion $PM_{2.5}$ will typically not be available from the equipment manufacturer. In this case, the most common reference for industrial equipment emissions factors is the EPA “AP-42 document”. The document is titled “Compilation of Air Pollutant Emission Factors, Volume 1, Stationary Point and Area Sources,” and source-specific sections are updated periodically. On-line access is available at: <http://www.epa.gov/ttnchie1/ap42/> .

For turbines and reciprocating engines, the most recent AP-42 updates were published in 2000, and 1998 for boilers and process heaters. Since the update process typically takes multiple years, this means the data and analysis are well over a decade old, and no revisions are anticipated in the next several years. The particulate emission factors include condensable and filterable fractions. Based on an understanding of natural gas constituents and combustion chemistry, condensable emissions should comprise the majority of fine particulate in natural gas combustion exhaust. That is, filterable particulate should be less than condensable particulate.

Previous memos discussed AP-42 $PM_{2.5}$ emission factors in more detail, and an AP-42 overview is provided in Appendix A. The AP-42 document rates the emission factors and data used to develop the factors. The AP-42 emission factors for natural gas-fired sources are presented in Appendix A along with a discussion of the emission factor rating and the rating scheme. Section 3 compares AP-42 factors with other factors from the U.S. collaborative project and shows the implications for emission rates for example combustion sources.

3.0 Summary of the U.S. Collaborative PM_{2.5} Test Program

3.1 Project Overview, Objectives and Summary of Conclusions

In response to uncertainties regarding PM_{2.5} emission factors for gas-fired sources, a collaborative U.S. program investigating technical issues associated with fine particulate emission factors and measurement methods was initiated in 2001 and completed in 2005 (hereinafter referred to as the “collaborative project”). The collaborative project was funded by the California Energy Commission (CEC), New York State Energy Research and Development Authority (NYSERDA), and Gas Research Institute (GRI). The project was integrated with a similar effort that included the U.S. Department of Energy (DOE) and American Petroleum Institute (API). Thus, five funding agencies that include the U.S. federal government, state governments, and industry trade associations played a vital role in project oversight, management, and execution. The project team also included the U.S. EPA in an advisory role and academic and scientific leaders on fine particulate measurement as team members or technical advisors. This information is delineated in the project reports discussed below.

The collaboration was initiated because NYSERDA and GRI were generally concerned with emission factor and measurement issues, and additional data were desired to better characterize emissions and source apportionment to inform policy. For California, a need for additional data was identified following 2000 – 2001 electricity shortages in the state (i.e., brownouts and rolling blackouts). This resulted in a number of energy project applications for new in-state capacity, with the capacity primarily based on natural gas-fired turbines. CEC was concerned that the associated emissions may exacerbate fine particulate nonattainment. Using AP-42 PM_{2.5} emission factors to estimate emissions raised concerns regarding marginal increases in in-state inventory that could result from larger turbines that would have replaced electricity imported from other states. There was also a concern that positive bias in AP-42 emission factors was artificially inflating the potential inventory and a better understanding of PM_{2.5} emissions and the cause of turbine PM_{2.5} emissions variability was desired.

The project objectives included:

- Development of improved dilution sampling methods for measuring total mass and speciated PM_{2.5} emissions;
- Completing a field test campaign to gather emissions data for gas-fired and oil-fired sources;
- Comparison of results obtained with dilution tunnels and traditional EPA methods (e.g., compare to AP-42 and other available results);
- Identification and characterization of PM_{2.5} emissions, and development of emission factors and speciation profiles, including precursors and organic aerosols, for use in source-receptor and source apportionment analysis; and
- Characterization of PM_{2.5} emissions variability and uncertainty for gas-fired units, including understanding the sources of emissions variations and the contribution of test method artifacts.

The testing was completed over two years, and multiple detailed, peer-reviewed technical reports were developed. The reports are available at CEC and NYSERDA websites, and significant additional detail is available in the reports. There are thirteen primary project reports, technical

memos, and host site test reports that comprise over 1,400 pages of material. The documents and weblinks to the CEC site are tabulated in Appendix B, and the general link to the CEC website is:

http://www.energy.ca.gov/pier/project_reports/CEC-500-2005-032_to_44.html

The primary reference used for this memo is the Final Report², which summarizes the program results. Additional documents (see Appendix B) include:

- A fine particulate dilution sampling test protocol.
- Four topical reports/memorandums addressing:
 - A literature review of source sampling and analysis methods for characterizing organic aerosols and fine particulate emission profiles;
 - The design and validation testing of a mini-dilution sampler;
 - An assessment of sources of PM_{2.5} emissions data variability in gas turbines; and
 - An assessment of the impact of operating parameters on PM_{2.5} emissions from natural gas-fired combined cycle and cogeneration power plants.
- Seven field test reports.

A summary of the project conclusions from the project reports and related summaries from the CEC and NYSERDA websites include:

- Traditional EPA test methods and the dilution tunnel method provide very different results;
- Data from traditional methods should not be mixed with speciation profiles from dilution sampling methods;
- PM_{2.5} emissions from gas-fired sources are extremely low and challenge the capability of test methods;
- For traditional impinger-based methods, tests confirmed a positive bias from SO₂ capture for the condensable test method (i.e., from Method 202 impingers) and “dissolved SO₂ to sulfate” liquid-phase conversion, where SO₂ from trace sulfur in natural gas is inappropriately captured as PM_{2.5};
- As expressed by NYSERDA, existing PM_{2.5} inventories (based on AP-42 emission factors) are inadequate for developing air quality management plans;
- The multi-million dollar collaborative project provides significant data, and emission factors from that project are recommended as alternatives to AP-42 factors. Nevertheless, additional efforts may be desired to develop source emission profiles and mass emission rates that serve as a basis for scientifically sound emission inventories.

These conclusions, which are supported by state and federal agencies focused on protecting the public interest, include compelling conclusions regarding dilution tunnel test results and historical (e.g., AP-42) data. In Section 4 of this memo, additional discussion and more detailed conclusions are presented regarding collaborative project results that address the technical veracity of the emissions data and its use for emission factors.

² England, G.C., “Development of Fine Particulate Emission Factors and Speciation Profiles for Oil and Gas-fired Combustion Systems”, Final Report (October 2004).

3.2 Fine Particulate Test Methods Overview

Supplemental technical reports from the collaborative project include detailed discussion of traditional “impinger based” test methods and dilution tunnel methods. An overview is provided here.

The conventional test methods for measuring PM_{2.5} are EPA Method 5 and EPA Method 202 (or equivalent or derivative methods) to measure filterable and condensable particulate, respectively. Filterable particulate is in particulate form as a solid or liquid at the elevated temperatures within the exhaust stack. Condensable particulate are those chemical compounds that are gaseous at stack temperatures but condense at ambient temperature to form particulate. The Method 202 sample train is intended to condense and measure those emissions. According to the U.S. EPA, condensable particulate is all considered to be less than one micron (i.e., PM_{1.0} or smaller).

It has been demonstrated that potential biases in the Method 202 can result in trace levels of sulfur in natural gas that is emitted as SO₂ being “measured” as sulfate particulate rather than as SO₂ (a gaseous, non-particulate pollutant). Exhaust SO₂ from natural gas combustion is very low and results from trace amounts of hydrogen sulfide and sulfur from mercaptans that are used to odorize natural gas being converted to SO₂ during combustion. Although the low level of SO₂ emissions is not a regulatory concern from combustion of pipeline quality natural gas, since fine particulate emissions are also very low, the bias from SO₂ can comprise a significant portion of PM_{2.5} “measured” from natural gas combustion. This is explained further in the project reports.

In recent years, “dilution tunnel” methods have been developed that measure fine particulate by simulating plume chemistry in a holding chamber before measuring the sample where condensation of particulate species has occurred. The stream from the holding chamber can then be measured in multiple parallel samples that apply species-specific methods to measure PM_{2.5} mass and/or speciate the emissions using available refined sample collection and analytical techniques, including ambient measurement methods.

The collaborative project test team included members from the Desert Research Institute (DRI), a primary developer of “laboratory scale” dilution tunnel hardware and test methods. A more compact dilution sampler was developed and utilized for the project. The compact dilution tunnel results agreed well with the larger laboratory-scale dilution sampler and showed much lower results than conventional test methods.

The collaborative project concluded that dilution sampling techniques are more appropriate for obtaining a representative particulate matter sample from combustion systems for determining PM_{2.5} emission rate and chemical speciation. For natural gas combustion, the project also concluded that trace PM_{2.5} emission levels challenge detection limits and results are often similar to ambient air.

3.3 Summary of PM_{2.5} Test Results and Emission Factors

A primary goal of the collaborative project was to develop emission factors and speciation profiles using dilution sampling methods for PM_{2.5} emissions. Precursor emissions (i.e., NO_x, VOCs) were also measured, but those emissions are not addressed in this memo.

Dilution tunnel methods were used for tests at seven different sites to characterize fine particulate emission rates and speciation. Fuels tested include natural gas, refinery gas, low sulfur diesel, and residual (no. 6) fuel oil. This report focuses on gas-fired sources, specifically natural gas-fired sources (i.e., excluding refinery gas). The project tested 32 gas-fired units and in total included the following types of units:

- Gas-fired boilers and steam generators,
- Gas-fired combined cycle and cogeneration power plants,
- Gas-fired process heaters,
- No. 6 oil-fired boilers, and
- Diesel engines.

The testing program and units tested were dependent upon available host sites and the sources tested and associated emission controls are not an ideal list. For example, turbines tested included exhaust emission control (selective catalytic reduction, oxidation catalyst), and a natural gas-fired reciprocating engine was not tested due to funding limitations. A detailed description of the sites and units tested are provided in the project reports. As noted in those reports, particulate emissions are so low that operational factors do not appear consequential when considering emissions impacts, and the results indicate similar PM_{2.5} emission rates for all gas-fired units tested. This is shown in results discussed below.

Although the list of tested sources is not ideal, the collaborative project provides the most robust emissions data available on trace PM_{2.5} emissions from natural gas combustion. These data and results can be reviewed to identify appropriate emission factors.

Summary of Collaborative Project Results

Table 1 summarizes the PM_{2.5} emissions data from dilution tunnel testing of natural gas and refinery gas-fired emission sources including boilers, steam generators, process heaters, and turbine combined cycle and cogeneration power plants. The table lists the data from the lowest to highest emission factor, presented in kilograms per gigajoule (kg/GJ) and grams per gigajoule (g/GJ) where gigajoules are based on the heat input using the higher heating value (HHV) of the fuel. HHV is the convention for emission factors.

Thirty-two gas-fired units were tested, including 20 natural gas-fired units and 12 refinery gas-fired units. Many of the units were equipped with air pollution control equipment as indicated in the table. Refer to the final project report and related host site-specific reports for additional detail on the tests and PM_{2.5} emissions data for gas-fired combustion sources.

The purpose of this memorandum is to assess alternative PM_{2.5} emission factors for *natural gas-fired* sources, but results for both natural gas and refinery gas are presented in Table 1 and Table 2. All gas-fired data are shown so that the effect of fuel type and source type on emission factors can be reviewed to assess whether there are significant differences in the data.

Table 1 indicates an average PM_{2.5} emission factor of 9.0×10^{-5} kg/GJ (0.09 g/GJ) when considering all of the gas-fired tests and an emission factor based on the 95% confidence interval upper bound of 1.2×10^{-4} kg/GJ (0.12 g/GJ). The maximum from all tests is 2.7×10^{-4} kg/GJ

(0.27 g/GJ). Additional discussion is provided below on the range of emission factors and considerations for emission factor choice for emission estimates.

Table 1. Summary of PM_{2.5} Emissions Data from Dilution Tunnel Tests for All Gas-Fired Units.

Source Category	Test Site	Source Description	PM _{2.5} EF in kg/GJ and [g/GJ]
Process Heaters	Site B	RG-fired Process Heater	3.0 x 10 ⁻⁶ [0.0030]
Boilers & Steam Gens	Site C	NG-fired Steam Generator	7.3 x 10 ⁻⁶ [0.0073]
Process Heaters	Site B	RG-fired Process Heater	9.9 x 10 ⁻⁶ [0.0099]
Process Heaters	Site Charlie	NG-fired Process Heater w/SCR	1.1 x 10 ⁻⁵ [0.011]
Process Heaters	Site Alpha	RG-fired Process Heater	1.9 x 10 ⁻⁵ [0.019]
Process Heaters	Site Alpha	RG-fired Process Heater	2.1 x 10 ⁻⁵ [0.021]
Combined Cycle (CC) & Cogen PPs	Site Bravo	NG-fired CCPP w/ supp firing, Ox catalyst & SCR	2.2 x 10 ⁻⁵ [0.022]
Boilers & Steam Gens	Site C	NG-fired Steam Generator	2.4 x 10 ⁻⁵ [0.024]
Process Heaters	Site Alpha	RG-fired Process Heater	2.6 x 10 ⁻⁵ [0.026]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	3.6 x 10 ⁻⁵ [0.036]
Boilers & Steam Gens	Site C	NG-fired Steam Generator	4.1 x 10 ⁻⁵ [0.041]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	4.2 x 10 ⁻⁵ [0.042]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	4.7 x 10 ⁻⁵ [0.047]
Process Heaters	Site B	RG-fired Process Heater	5.6 x 10 ⁻⁵ [0.056]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	5.6 x 10 ⁻⁵ [0.056]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	6.4 x 10 ⁻⁵ [0.064]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	6.4 x 10 ⁻⁵ [0.064]
Process Heaters	Site Charlie	NG-fired Process Heater w/SCR	6.9 x 10 ⁻⁵ [0.069]
CC & Cogen PPs	Site Bravo	NG-fired CCPP w/ supp firing, Ox catalyst & SCR	6.9 x 10 ⁻⁵ [0.069]
CC & Cogen PPs	Site Echo	NG-fired CCPP w/ lean premix comb, supp firing, Ox catalyst & SCR	7.7 x 10 ⁻⁵ [0.077]
CC & Cogen PPs	Site Golf	RG-fired Cogen PP w/supp firing, Ox catalyst & SCR	9.0 x 10 ⁻⁵ [0.090]
Boilers & Steam Gens	Site A	RG-fired Boiler	1.2 x 10 ⁻⁴ [0.12]
Process Heaters	Site Charlie	NG-fired Process Heater w/SCR	1.3 x 10 ⁻⁴ [0.13]

Table 1. (continued)

Source Category	Test Site	Source Description	PM _{2.5} EF in kg/GJ and [g/GJ]
CC & Cogen PPs	Site Golf	RG-fired Cogen PP w/supp firing, Ox catalyst & SCR	1.4 x 10 ⁻⁴ [0.14]
CC & Cogen PPs	Site Golf	RG-fired Cogen PP w/supp firing, Ox catalyst & SCR	1.5 x 10 ⁻⁴ [0.15]
Boilers & Steam Gens	Site Delta	Dual Fuel Boiler (NG)	1.6 x 10 ⁻⁴ [0.16]
Boilers & Steam Gens	Site A	RG-fired Boiler	1.6 x 10 ⁻⁴ [0.16]
Boilers & Steam Gens	Site A	RG-fired Boiler	1.8 x 10 ⁻⁴ [0.18]
CC & Cogen PPs	Site Bravo	NG-fired CCPP w/ supp firing, Ox catalyst & SCR	2.3 x 10 ⁻⁴ [0.23]
Boilers & Steam Gens	Site Delta	Dual Fuel Boiler (NG)	2.4 x 10 ⁻⁴ [0.24]
Boilers & Steam Gens	Site Delta	Dual Fuel Boiler (NG)	2.5 x 10 ⁻⁴ [0.25]
Boilers & Steam Gens	Site Delta	Dual Fuel Boiler (NG)	2.7 x 10 ⁻⁴ [0.27]
Average (mean)			9.0 x 10⁻⁵ [0.090]
Upper Bound (at 95% Confidence Level)			1.2 x 10⁻⁴ [0.12]

Table 1 includes all of the gas-fired units (i.e., boilers, process heaters and turbines with and without post-combustion controls) and includes both natural gas-fired and refinery gas-fired units. Table 2 segregates the results by fuel and unit type and presents the average emission factor, upper bound emission factor at a 95% confidence level, and maximum emission factor. The same AP-42 emission factor applies for boilers and process heaters, so those emission sources are presented grouped and individually in Table 2.

Since the dilution tunnel results are significantly lower than AP-42 emission factors and uncertainty is inherent to such low measurements, conservatism may be desired for PM_{2.5} emission estimates. Tables below present *maximum* emission factors from the dataset, average emission factors, and/or emission factors based on a 95% confidence interval upper bound. The basis for the emission estimate (e.g., source permitting, national inventory, etc.) should be considered when evaluating the preferred emission factor for a particular analysis or estimate.

Table 2. Comparison of PM_{2.5} Emission Factors from Dilution Tunnel Tests by Unit Type and Fuel Type for Gas-Fired Boilers, Process Heaters, and Turbines.

Type of Unit	Fuel	Test Count	Average PM _{2.5} in kg/GJ and [g/GJ]	PM _{2.5} (95% CI) in kg/GJ and [g/GJ]	Maximum PM _{2.5} in kg/GJ and [g/GJ]
All	All Gas	32	9.0 x 10 ⁻⁵ [0.090]	1.2 x 10 ⁻⁴ [0.12]	2.7 x 10 ⁻⁴ [0.27]
All	Natural Gas	20	9.6 x 10 ⁻⁵ [0.096]	1.3 x 10 ⁻⁴ [0.13]	2.7 x 10 ⁻⁴ [0.27]
All	Refinery Gas	12	8.2 x 10 ⁻⁵ [0.082]	1.2 x 10 ⁻⁴ [0.12]	1.8 x 10 ⁻⁴ [0.18]
Boiler and Heater	All Gas	19	9.5 x 10 ⁻⁵ [0.095]	1.4 x 10 ⁻⁴ [0.14]	2.7 x 10 ⁻⁴ [0.27]
Boiler and Heater	Natural Gas	10	1.2 x 10 ⁻⁴ [0.12]	1.8 x 10 ⁻⁴ [0.18]	2.7 x 10 ⁻⁴ [0.27]
Boiler and Heater	Refinery Gas	9	6.7 x 10 ⁻⁵ [0.067]	1.1 x 10 ⁻⁴ [0.11]	1.8 x 10 ⁻⁴ [0.18]
Boiler	All Gas	10	1.5 x 10 ⁻⁴ [0.15]	2.1 x 10 ⁻⁴ [0.21]	2.7 x 10 ⁻⁴ [0.27]
Boiler	Natural Gas	7	1.4 x 10 ⁻⁴ [0.14]	2.3 x 10 ⁻⁴ [0.23]	2.7 x 10 ⁻⁴ [0.27]
Boiler	Refinery Gas	3	1.5 x 10 ⁻⁴ [0.15]	1.9 x 10 ⁻⁴ [0.19]	1.8 x 10 ⁻⁴ [0.18]
Process Heater	All Gas	9	3.7 x 10 ⁻⁵ [0.037]	6.2 x 10 ⁻⁵ [0.062]	1.3 x 10 ⁻⁴ [0.13]
Process Heater	Natural Gas	3	6.9 x 10 ⁻⁵ [0.069]	1.4 x 10 ⁻⁴ [0.14]	1.3 x 10 ⁻⁴ [0.13]
Process Heater	Refinery Gas	6	2.3 x 10 ⁻⁵ [0.023]	3.7 x 10 ⁻⁵ [0.04]	5.6 x 10 ⁻⁵ [0.056]
Turbine	All Gas	13	8.4 x 10 ⁻⁵ [0.084]	1.2 x 10 ⁻⁴ [0.12]	2.3 x 10 ⁻⁴ [0.23]
Turbine	Natural Gas	10	7.1 x 10 ⁻⁵ [0.071]	1.1 x 10 ⁻⁴ [0.11]	2.3 x 10 ⁻⁴ [0.23]
Turbine	Refinery Gas	3	1.3 x 10 ⁻⁴ [0.13]	1.6 x 10 ⁻⁴ [0.16]	1.5 x 10 ⁻⁴ [0.15]

To facilitate comparison, Table 3 summarizes the same information for natural gas-fired units (i.e., omits refinery gas). Table 4 compares the dilution tunnel average emission factor and 95% confidence upper bound emission factor to AP-42 emission factors for each unit type.

Table 3. Comparison of PM_{2.5} Emission Factors from Dilution Tunnel Tests for Natural Gas-Fired Boilers, Process Heaters, and Turbines.

Type of Unit	Fuel	Test Count	Average PM _{2.5} in kg / GJ and [g/GJ]	PM _{2.5} (95% CI) ¹ in kg / GJ and [g/GJ]
All	Natural Gas	20	9.6 x 10 ⁻⁵ [0.096]	1.3 x 10 ⁻⁴ [0.13]
Boiler and Heater	Natural Gas	10	1.2 x 10 ⁻⁴ [0.12]	1.8 x 10 ⁻⁴ [0.18]
Boiler	Natural Gas	7	1.4 x 10 ⁻⁴ [0.14]	2.3 x 10 ⁻⁴ [0.23]
Process Heater	Natural Gas	3	6.9 x 10 ⁻⁵ [0.069]	1.4 x 10 ⁻⁴ [0.14]
Turbine	Natural Gas	10	7.1 x 10 ⁻⁵ [0.071]	1.1 x 10 ⁻⁴ [0.11]

¹ Emission factor based on the 95% confidence interval upper bound is presented in Tables 3, 4 and 5.

Table 4. Comparison of Dilution Tunnel PM_{2.5} Emission Factors to AP-42 Emission Factors.

Type of Unit	Fuel	Dilution Tunnel Emission Factor		AP-42 PM _{2.5} EF in kg / GJ and [g/GJ]	EF Ratio: AP-42 / Dil. Tunnel (95% CI)
		Average PM _{2.5} in kg / GJ and [g/GJ]	PM _{2.5} (95% CI) in kg / GJ and [g/GJ]		
Boiler and Heater	Natural Gas	1.2 x 10 ⁻⁴ [0.12]	1.8 x 10 ⁻⁴ [0.18]	3.2 x 10 ⁻³ [3.2]	18
Boiler	Natural Gas	1.4 x 10 ⁻⁴ [0.14]	2.3 x 10 ⁻⁴ [0.23]	3.2 x 10 ⁻³ [3.2]	14
Process Heater	Natural Gas	6.9 x 10 ⁻⁵ [0.069]	1.4 x 10 ⁻⁴ [0.14]	3.2 x 10 ⁻³ [3.2]	23
Turbine	Natural Gas	7.1 x 10 ⁻⁵ [0.071]	1.1 x 10 ⁻⁴ [0.11]	2.8 x 10 ⁻³ [2.8]	25

Table 5 provides another comparison by presenting the annual “potential to emit” (i.e., based on 8,760 annual operating hours) PM_{2.5} emissions in kilograms per year for types and sizes of typical equipment based on the AP-42 emission factor and 95% confidence upper bound emission factor from the collaborative project. This shows that emissions are much less than one metric ton annually for gas-fired units as large as 30 MW based on the dilution tunnel 95% confidence upper bound emission factor and lower if the average emission factor is used for the calculation.

Table 5. Annual PM_{2.5} emissions (kg per year) for example natural gas-fired equipment based on dilution tunnel emission factors (average and 95% confidence upper bound) or AP-42.

Unit Type	Example Size	PM _{2.5} Emissions ¹ (kg/year) Dil.Tun. (Average) EF	PM _{2.5} Emissions ¹ (kg/year) Dil.Tun. (95% CI) EF	PM _{2.5} Emissions ¹ (kg/year) AP-42 EF
Natural gas-fired boiler	10 MW	147	242	3364
Natural gas-fired boiler	0.5 MW	7	12	168
Natural gas-fired process heater	10 MW	73	147	3364
Natural gas-fired process heater	0.5 MW	4	7	168
Natural gas-fired turbine	4 MW	30	46	1177
Natural gas-fired turbine	10 MW	75	116	2943
Natural gas-fired turbine	30 MW	224	347	8830

¹Emission calculation based on potential to emit (8760 annual operating hours) and an assumed HHV-based heat rate of 12,000 kJ/kW-hr (8500 Btu/hp-hr).

These results demonstrate the significant difference between test results using dilution tunnel methods and conventional methods. Table 1 indicates relatively consistent emissions for boilers, process heaters, and turbines, including units with post-combustion emission controls – i.e., considering the challenges associated with measuring such low levels of particulate, the test data fall within a relatively narrow band and there are no outliers. The comparison to AP-42 demonstrates significantly different emission factors, and reinforces the conclusion in the collaborative project report on variability in gas-fired turbine test results. That report concluded that the most important factor affecting PM_{2.5} variability is *not* equipment type, operating condition, or emission controls, but rather due to test methods, with the method choice (i.e., traditional impinger methods versus dilution tunnel) and artifacts related to sulfur species the most important factors affecting variability in PM_{2.5} emission results. This is a significant conclusion, which confirms that the test method from which the emissions data is derived may be the primary basis for conclusions about the significance of PM_{2.5} emissions. If unit or facility emissions are assessed based on the lower emission factor from dilution tunnel tests, different conclusions may be reached regarding the significance of a source. Or, considering this from another perspective, care should be taken to ensure that test method flaws do not erroneously impact regulatory decisions.

Detailed discussion is provided in the project reports on chemical speciation for the dilution tunnel results and data using conventional impinger-based methods. An example, which is typical for the dilution tunnel results, is shown in Figure 1. This figure shows the composite speciation profile for the average emissions factor for boilers and process heaters. The primary constituents are organic carbon species, which is a logical expectation for natural gas-fired sources. These speciation data show a much smaller sulfate percentage, which is typically

reported as 50% to 70% of the total PM_{2.5} from conventional impinger based methods. More detailed discussion of sulfur artifacts is available in the collaborative project final report and test methods report³, and in the literature⁴.

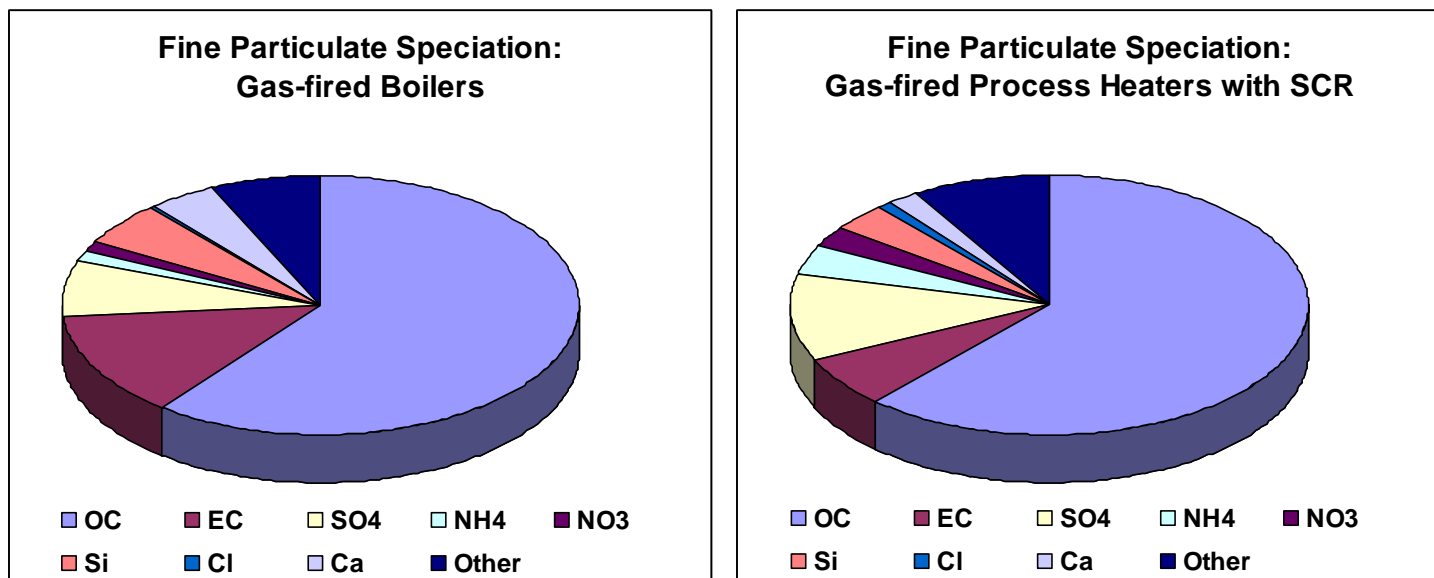


Figure 1. PM_{2.5} Speciation for Gas-fired Boilers and Process Heaters.

4.0 Discussion and Recommended PM_{2.5} Emission Factors for Natural Gas-Fired Sources

4.1 Conclusions Regarding Dilution Tunnel Results

State and federal environmental and energy staff played a primary role in planning, managing, and executing the U.S. collaborative project, which supports the veracity of the results and conclusions. Government agencies that funded the project include CEC, NYSERDA, and DOE. EPA staff participated as advisors, and leading scientists in the field of PM emissions and measurement were team members or advisors. Findings, conclusions, and recommendations from the project reports: document the ultra-low levels of PM_{2.5} emission from natural gas-fired sources; document the technical superiority of dilution tunnel methods and high bias from sulfur species with conventional impinger based methods; and, conclude that due to the low levels being measured and associated method limitations, dilution tunnel emission factors are more representative than emission factors, such as AP-42 factors, that are based on conventional methods.

The conclusions in the collaborative project reports provide the foundation to recommend dilution tunnel data as preferable to AP-42 emission factors. A number of key conclusions from

³ Chang, O.M.C. and England, G.C., “Development of Fine Particulate Emission Factors and Speciation Profiles for Oil and Gas-fired Combustion Systems, Update: Critical Review of Source Sampling and Analysis Methodologies for Characterizing Organic Aerosol and Fine Particulate Source Emission Profiles.” February 2004.

⁴ Wien, S., England, G., Loos, K., and Ritter, K., “Investigation of Artifacts in Condensable Particulate Measurements for Stationary Combustion Sources”. Proceedings of the Air & Waste Management Association’s 94th Annual Conference and Exhibition, Orlando, Florida, June 2001.

the collaborative project reports which support the technical superiority of dilution tunnel test results are summarized here:

- PM_{2.5} mass (for gas-fired sources).
 - **For gas-fired sources, dilution sampling indicates fine particulate mass emissions are extremely low and probably similar to ambient air PM_{2.5} concentrations in many cases.** [emphasis added]
 - These levels are difficult to *quantify* with high confidence using available test methods. The “measured” data are far below both the estimated minimum detection limit (MDL) and lower quantification limit (LQL) of traditional hot filter/iced impinger methods, and generally between the estimated MDL and LQL of the dilution sampling method.
 - Traditional methods for measuring filterable and condensable particulate matter previously have been shown to be subject to small systematic and random biases (due to sampling artifacts and biases) that are very significant at the extremely low particulate concentrations typical of gas-fired sources.
 - The in-stack MDL and LQL achieved with dilution sampling are far lower than can be achieved by traditional hot filter/iced impinger methods due to the avoidance of such biases and greater analytical sensitivity.
 - **Therefore, the PM_{2.5} concentration in stack gases from gas-fired sources measured using dilution sampling is far lower than that measured by traditional methods. While a degree of systematic and random bias in the dilution sampling measurements remains (primarily due to background PM_{2.5} in the dilution air), these results for gas-fired sources are considered more representative of actual emissions.** [emphasis added]
 - Many of the stack PM_{2.5} results could not be clearly distinguished from measurement background; in these cases, the true stack PM_{2.5} is difficult to quantify by any of the methods used in this study.
 - Background PM_{2.5} in the purified dilution air may be significant relative to the stack PM_{2.5} for sources with extremely low stack PM_{2.5} concentrations. This is more a consequence of the nature of the clean sources tested than of inherent limitations in the method.
 - The results from dilution sampling show that PM_{2.5} differences due to size, load, gas fuel composition, duct burners, and various other differences (design, location, weather, etc.) are very small – especially in comparison to the wide PM_{2.5} range exhibited in existing data.
- Particle Size. The test results for gas-fired units indicate that substantially all of the particulate matter in the stack was smaller than 2.5 micrometers. In-stack cyclones with 10 and 2.5 µm cutpoints were used in most tests; however, the results are generally below the MDL.
- Dilution Sampling Method Readiness. Tests comparing the dilution sampler to an existing benchmark dilution sampler showed that the two samplers yield results that are the same at the 95 percent confidence level. However, further testing is needed to better quantify systematic and random variation, especially for applications with extremely low (less than approximately 1 to 2 mg/dscm) particulate concentrations. Measurement background levels in the dilution air were found to be significant in some tests relative to stack concentrations for gas-fired sources.

- Use of PM_{2.5} Emission Factors and Speciation Profiles.
 - The current population of data for each source category is small, but this project provided a good start toward developing robust emission factors and speciation profiles. To date, it is the most comprehensive study completed and similar projects have not been undertaken since this project was completed.
 - However, because of the small number of units tested (one to three), the emission factors may not be representative of either any individual unit or the entire population of units in each category (although this is frequently a limitation of many published emission factors).

[Note that the data set from the collaborative project is larger and more robust than the data used for AP-42 emissions factors.]

4.2 Discussion and Recommended PM_{2.5} Emission Factors

Based on the conclusions from the U.S. collaborative project, it is apparent that dilution tunnel results are the preferred data that provide an alternative to AP-42 emission factors. There are considerations that need to be addressed when defining the emission factor because the selection of the factor may have both policy and technical implications, and the context for data use is important. For example, AP-42 emission factors typically average the relevant emissions data, and EPA cautions against using AP-42 factors for establishing permit limits. EPA notes that if AP-42 factors truly represent the population, it would be expected that half of the sources would emit at a level higher than the AP-42 average factor.

This memorandum presents the 95% confidence upper bound and maximum emission factors from dilution tunnel data as alternatives to using an average factor or AP-42 factor, and recommends using maximum emission factors from dilution tunnel tests. Emission factors are presented for boilers, process heaters, and turbines, but it appears that there is little difference in the PM_{2.5} emissions for different source types, and different values for source-specific emission factors likely include measurement uncertainty as a significant contributor. Although AP-42 factors are more than an order of magnitude higher than dilution tunnel-based factors (see Tables 4 and 5), the associated PM_{2.5} emissions for gas-fired sources are still relatively low.

The context and subsequent requirements associated with the emission factor choice are important. For example, conducting dilution tunnel tests are very costly and the methods are not main stream. Thus, “compliance tests” to validate compliance with an emission limit would be a difficult if not infeasible proposition at this time. Similarly, test methods and data sources cannot be mixed – e.g., results from conventional impinger-based methods should not be used to assess whether a unit meets an emission level based on dilution tunnel emission factors.

The summary of dilution tunnel PM_{2.5} emission factors (in kg/GJ) for natural gas-fired sources, as shown in Tables 2 and 3 follows, and use of the maximum emission factor by source type is recommended:

- Boilers: 2.7×10^{-4} kg/GJ (based on the maximum emission factor);
 - The average emission factor is 1.4×10^{-4} kg/GJ;
 - The 95% confidence interval upper bound emission factor is 2.3×10^{-4} kg/GJ;
- Process Heaters: 1.3×10^{-4} kg/GJ (based on the maximum emission factor);

- The average emission factor is 6.9×10^{-5} kg/GJ;
 - The 95% confidence interval upper bound emission factor is 1.4×10^{-4} kg/GJ (note that the 95% confidence interval upper bound is larger than the maximum due to the small number of samples – i.e., three tests);
- Turbines: 2.3×10^{-4} kg/GJ (based on the maximum emission factor);
 - The average emission factor is 7.1×10^{-5} kg/GJ;
 - The 95% confidence interval upper bound emission factor is 1.1×10^{-4} kg/GJ;
- If all of the natural gas-fired data are considered as a single dataset, the maximum emission factor is 2.7×10^{-4} kg/GJ, the 95% confidence upper bound emission factor is 1.3×10^{-4} kg/GJ, and the average emission factor is 9.6×10^{-5} kg/GJ.

APPENDIX A

Summary of AP-42 Particulate Matter Emission Factors, Ratings, and Data Sources for Natural Gas-Fired Combustion

A summary of the emission factors (MMBtu is HHV based), ratings, and data sources follow:

- Natural gas-fired Turbine:
 - 4.7×10^{-3} lb/MMBtu condensable
 - 1.9×10^{-3} lb /MMBtu filterable
 - 6.6×10^{-3} lb /MMBtu total (2.8×10^{-3} kg/GJ)
 - “C” rating from EPA rating for both filterable and condensable
 - Particulate test data from three tests of one, 86 MW ABB turbine in Wisconsin
- Natural gas-fired boiler / process heater:
 - 5.7 lb/10⁶ SCF natural gas condensable
 - 1.9 lb/10⁶ SCF natural gas filterable
 - 7.6 lb/10⁶ SCF natural gas total (3.2×10^{-3} kg/GJ assuming 1020 Btu/SCF natural gas HHV)
 - “B” rating for filterable and “D” rating for condensable
 - Particulate test data: 21 tests from multiple units for filterable; four tests for condensable
- Natural gas-fired two-stroke lean burn reciprocating engine:
 - 9.91×10^{-3} lb/MMBtu condensable
 - 3.84×10^{-2} lb/MMBtu filterable
 - 4.83×10^{-2} lb/MMBtu total (2.1×10^{-2} kg/GJ)
 - “C” rating for filterable and “E” rating for condensable
 - Filterable particulate test data from three engine tests with one result more than an order of magnitude higher than the other two (note: based on the rating scheme discussed below, this should be D rather than C rating); condensable factor based on 4-stroke lean burn data
- Natural gas-fired four-stroke lean burn reciprocating engine:
 - 9.91×10^{-3} lb/MMBtu condensable
 - 7.71×10^{-5} lb/MMBtu filterable
 - 9.99×10^{-3} lb/MMBtu total (4.3×10^{-3} kg/GJ)
 - “D” rating for both filterable and condensable
 - Particulate test data from two tests at one site

The EPA rating scheme is subjective. In general, a factor rated lower than “B” is based on limited data and a limited source sample size. EPA describes these rating for the emission factor (A through E) and associated data (A through D), where the data ranking ranges from “sound methodology and validated results” for “A” data to “generally unaccepted methodology but may provide an order of magnitude estimate” for D quality data.

The ratings for data and emission factor ratings are described in the AP-42 document introduction (see <http://www.epa.gov/ttn/chief/ap42/c00s00.pdf>). For *data* ratings:

- A = Tests are performed by a sound methodology and are reported in enough detail for adequate validation.
- B = Tests are performed by a generally sound methodology, but lacking enough detail for adequate validation.
- C = Tests are based on an unproven or new methodology, or are lacking a significant amount of background information.
- D = Tests are based on a generally unacceptable method, but the method may provide an order-of-magnitude value for the source.

The related *emission factor* ratings are:

- A — Excellent. Factor is developed from A- and B-rated source test data taken from many randomly chosen facilities in the industry population. The source category population is sufficiently specific to minimize variability.
- B — Above average. Factor is developed from A- or B-rated test data from a "reasonable number" of facilities. Although no specific bias is evident, it is not clear if the facilities tested represent a random sample of the industry. As with an A rating, the source category population is sufficiently specific to minimize variability.
- C — Average. Factor is developed from A-, B-, and/or C-rated test data from a reasonable number of facilities. Although no specific bias is evident, it is not clear if the facilities tested represent a random sample of the industry. As with the A rating, the source category population is sufficiently specific to minimize variability.
- D — Below average. Factor is developed from A-, B- and/or C-rated test data from a small number of facilities, and there may be reason to suspect that these facilities do not represent a random sample of the industry. There also may be evidence of variability within the source population.
- E — Poor. Factor is developed from C- and D-rated test data, and there may be reason to suspect that the facilities tested do not represent a random sample of the industry. There also may be evidence of variability within the source category population.

With the exception of the B rating for boiler *filterable* emissions, which is paired with a D rating for *condensable* emissions, the AP-42 emission factors for natural gas-fired sources are rated C or lower. Thus, there is considerable uncertainty associated with the AP-42 fine particulate emissions factors for gas-fired sources, and biases (e.g., from sulfur) are likely in at least some of the data. Because of measurement limitations (e.g., positive bias, measurement of mass differential that is near instrument detection limits), it is likely that the AP-42 emission factors provide a conservative estimate of PM_{2.5} emissions for natural gas-fired sources. Caution should be used if it is concluded that equipment emissions based on AP-42 emission factors are significant enough to warrant further consideration. As discussed in this document, alternative emission factors based on a project that used dilution tunnel testing should be considered.

APPENDIX B

Primary Technical Documents from the U.S. Collaborative PM_{2.5} Emissions Project (with links to documents on CEC's website)

Report / Document Title	Page Count	File Size
Final Report:		
Final Report – Development of Fine Particulate Emission Factors and Speciation Profiles for Oil- and Gas-Fired Combustion Systems	130	0.9 MB
Supplemental Technical Reports:		
Critical Review of Source Sampling and Analysis Methodologies for Characterizing Organic Aerosol and Fine Particulate Source Emission Profiles	165	1.4 MB
Pilot-Scale Dilution Sampler Design and Validation Tests (Laboratory Study)	81	1.4 MB
Topical Reports / Technical Memos:		
Technical Memorandum: Conceptual Model of Sources of Variability in Combustion Turbine PM10 Emissions Data	65	0.7 MB
Impact of Operating Parameters on Fine Particulate Emissions from Natural Gas-Fired Combined Cycle and Cogeneration Power Plants	51	0.5 MB
Fine Particulate Test Protocol	38	0.5 MB
Site Test Reports:		
Test Results for a Gas-Fired Process Heater (Site Alpha)	114	1.0 MB
Test Results for a Combined Cycle Power Plant with Supplementary Firing, Oxidation Catalyst and SCR at Site Bravo	159	1.1 MB
Test Results for a Gas-Fired Process Heater with Selective Catalytic NOx Reduction (Site Charlie)	119	1.1 MB
Test Results for a Dual-Fuel-Fired Commercial Boiler (Site Delta)	176	1.3 MB
Test Results for a Combined Cycle Power Plant with Oxidation Catalyst and SCR at Site Echo	141	1.0 MB
Test Results for a Diesel Fuel-Fired Compression Ignition Reciprocating Engine with a Diesel Particulate Filter at Site Foxtrot	86	0.7 MB
Test Results for a Cogeneration Plant with Supplementary Firing, Oxidation Catalyst and SCR at Site Golf	91	0.7 MB